


# WITHDRAWABLE VCB

**VACUUM  
CIRCUIT  
BREAKER**

15 kV, ...31,5 kA, ...1250 A

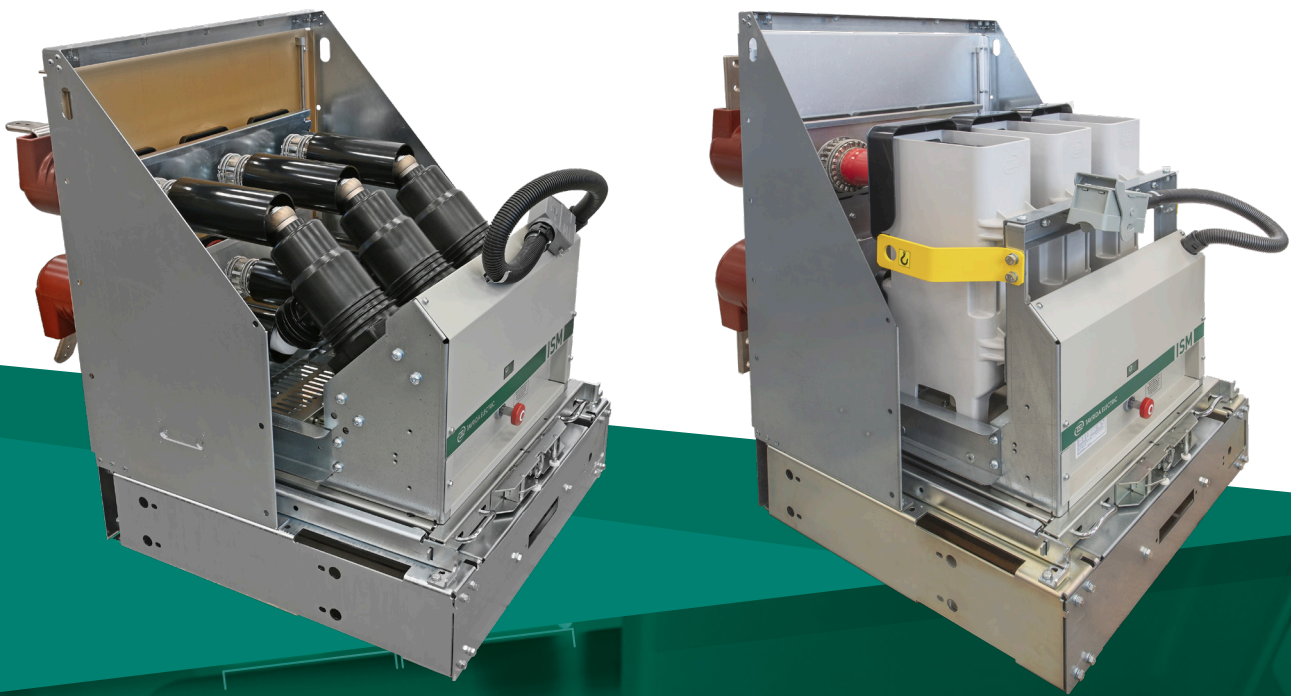

**TECHNICAL MANUAL**

**VERSION 2**



# Contents

<b>1. Introduction</b>	5
1.1 Abbreviations	6
1.2 Definitions	7
1.3 Disclaimers	7
1.4 Precautions	7
1.5 Warranty	8
<b>2. Product Handling</b>	9
2.1 Transportation	10
2.2 Storage	10
2.3 Unpacking and Inspection	10
2.3.1 Unpacking and Checking the VCB	10
2.3.2 VCB Packaging and Scope of Supply	16
2.3.3 CM Packaging (not in the Scope of Supply)	17
2.3.4 CBkit_Plug_1 Scope of Supply	18
2.4 Handling	20
<b>3. Product Coding and Labels</b>	21
3.1 Circuit Breaker	22
3.1.1 Control Module	25
3.1.2 Auxiliary Plugs Kit	27
<b>4. Technical Parameters</b>	29
<b>5. Design, Installation and Operation</b>	37
5.1 Design	38
5.1.1 Draw-Out Unit	38
5.1.2 Fixed Parts (Cradle) for Withdrawable VCB	39
5.1.3 Control Module	41
5.2 Installation the Primary Part	42
5.2.1 Protective Earthing	42
5.2.2 Primary Connections	42
5.3 Installation the Secondary part	43
5.3.1 VCB Secondary Connections	43
5.3.2 DOU Auxiliary Circuits Connector Counterpart Installation	46
5.3.3 Secondary Cables Between Auxiliary Circuits Connector Counterpart and the CM	46
5.3.4 CM Installation	47
5.3.5 CM Secondary Connections	48
5.3.6 Auxiliary Supply	49
5.4 Operation	50
5.4.1 VCB Racking In and Out of the Switchgear	50
5.4.2 ISM Closing	51
5.4.3 ISM Opening	51
5.4.4 ISM Emergency Opening	52
<b>6. Functionality</b>	53
6.1 Interlocks	54
6.2 CM Indication	55
6.2.1 CM Relay Contacts Operation	57
<b>7. Commissioning</b>	59
<b>8. Maintenance and Troubleshooting</b>	67
8.1 Primary Circuits	68
8.2 Secondary Circuits	71
8.3 Troubleshooting	71
<b>9. Disposal</b>	73
<b>Appendix 1. Type Tests</b>	75
<b>Appendix 2. Withdrawable VCB Package Dimensions</b>	79
<b>Appendix 3. Overall Drawings</b>	81
<b>Appendix 4. Secondary Schemes</b>	89
<b>List of Changes</b>	94





# 1. Introduction

This Technical Manual describes the Withdrawable Vacuum Circuit Breakers manufactured by Tavrida Electric.

Tavrida Electric MD Circuit Breakers are designed for rated voltages up to 15 kV.

Withdrawable Vacuum Circuit Breakers are designed for indoor installation in air-insulated switchgear panels and are intended to perform switching operations in network rated and faulty modes.

The breakers consist of the following main components:

- Indoor Switching Module (ISM) - The air-insulated ISM incorporates Tavrida Electric vacuum interrupters incorporated in solid dielectric insulator controlled by per phase monostable magnetic actuators. No SF-6 or oil insulation is used in the ISM.
- Control Module (CM) - The CM is a microprocessor-based controller that provides ISM operation, protection and data logging functions.
- Kits - The kits of components are used to provide Withdrawable Vacuum Circuit Breakers application properties.

This manual contains information on switching operations, required check-ups and maintenance, as well as service and disposal procedures. The purpose of the document is to provide necessary product information for users providing installation, commissioning and utilizing installed equipment.

Other technical documents which cover the product:

Document name	Target audience	Purpose of the document
Routine Test Certificate	Customer procurement service	Provide information on supplied equipment serial numbers.

## 1.1 Abbreviations

AC	Actuator Coil
AS	Auxiliary Switch
BIL	Basic Insulation Level
EMC	Electromagnetic Compatibility
CM	Control Module
CO	Close - Open Operations Cycle
DOU	Draw-Out Unit
Com	Common point of Contact
I/O	Input / Output
ISM	Indoor Switching Module
LED	Light Emitting Diode
(P)MCB	Protective Miniature Circuit Breaker
PS	Position Switch
NA	Not Applicable
52a	Normally Open Contact
52b	Normally Closed Contact
PCD	Phase Center Distance
USB	Universal Serial Bus
VCB	Vacuum Circuit Breaker
VI	Vacuum Interrupter

## 1.2 Definitions

### Closing Time

The closing time is the time period from the moment the close command is applied to the CM to the time when all ISM poles make contact.

### Opening Time

The opening time is the time period from the moment the trip command is applied to the CM to the time when all ISM poles are separated.

### Interrupting Time

The interrupting time is the time period from the moment the trip command is applied to the CM to the time when the arcs in all phases are extinguished.

## 1.3 Disclaimers

Tavrida Electric will not accept any claims for damages caused by improper transport, storage as well as unpacking. Transport damage must be reported in writing to the supplier as soon as it is discovered.

The Technical Manual contains information necessary for the installation, commissioning and operation of the withdrawable vacuum circuit breakers. Please read the Technical Manual carefully before starting and to adhere the instructions and the relevant regulations to ensure the proper use of the withdrawable vacuum circuit breakers. Tavrida Electric will not accept any claims for damages caused by improper usage of the withdrawable vacuum circuit breakers. In case of special configurations, please contact Tavrida Electric prior to usage of the withdrawable vacuum circuit breakers.

## 1.4 Precautions

- Before selecting the circuit breaker, please check whether the installation place (Contact interfaces, pole centre and terminal centre distances, fixed contact shutters operating mechanism, and the surroundings) is suitable for the withdrawable vacuum circuit breakers.
- Installation, operation and maintenance shall only be carried out by trained and experienced personnel who are familiar with the equipment and the electrical safety requirements.
- During installation, commissioning, operation and maintenance of the equipment the relevant legal regulations (such as DIN/VDE/IEC), accident prevention regulations and the connecting conditions of the electric utilities shall be followed.
- Take note that during operation of the withdrawable vacuum circuit breakers certain parts are subject to dangerous voltage. Mechanical parts, also remote-controlled, can move quickly. Failure to comply may result in death, severe personal injury or damage to equipment.
- Pay attention to the hazard statements located throughout the Technical Manual.
- The operating conditions of the withdrawable vacuum circuit breakers shall comply with the technical data specified in the Technical Manual.
- Personnel installing, operating and maintaining the equipment shall be familiar with the Technical Manual and its contents.

## 1.5 Warranty

Unless otherwise stated in the contract, the warranty period is stated in Standard Warranty Policy. If otherwise agreed to, the contract conditions apply. No warranty is given in the following cases:

- a) The warranty period has run out during the period of storage with the customer.
- b) The operating conditions, ambient conditions, transport and storage conditions have not been adhered to according to the application description or the Installation and Operating Instructions.
- c) An unauthorized manipulation of the device has been carried out, such as opening the housing or damaging the seal.
- d) The device has not been properly installed, such as incorrect connection of supply voltage of auxiliary circuits.

## 2. Product Handling

## 2.1 Transportation

The VCBs are transported in the original package only. Any kind of transport and combinations thereof are applicable.

Transportation shall be provided in waterproof compartments. If air transportation is used all products shall be transported inside heated, pressurized compartments. Packages with goods shall be handled in accordance with the handling symbols. Loading procedures for VCB package shall be carried out only using forklifts, hoists or cranes. During transportation the VCB must not be subjected to sharp impacts or dropped.

## 2.2 Storage

If immediate installation is not possible, the VCB shall be stored in the original packing under the following conditions:

- The ISM is switched off (main contacts in the open position);
- Desiccant must be placed inside the packaging;
- Storage must be dry, well ventilated and the room temperature should be between  $-40^{\circ}\text{C}$  and  $+55^{\circ}\text{C}$ .

Average humidity measured over a 1 year period shall not exceed 75% at  $50^{\circ}\text{C}$ . If the storage term exceeds one year from the production date, it is recommended to perform the procedure of CM electrolytic capacitor conditioning:

- Apply power to the CM for 20 seconds;
- Switch off the power supply and wait for 60 seconds;
- Repeat the above actions 2 times;
- Apply power to the CM continuously for 8 hours.

This procedure shall be performed annually during CM storage.

## 2.3 Unpacking and Inspection

### 2.3.1 Unpacking and Checking the VCB

Before unpacking, check the package for damage. Removal of the products from the original packaging must be carried out with care and in accordance with lifting procedures. Every VCB component shall be checked for completeness against the packing list included within the routine test certificate supplied with the CM and VCB.

Unloading procedures for VCB shall be carried out by hoists or cranes only. Methods of lifting the VCB out of the package are shown below and must be strictly followed.

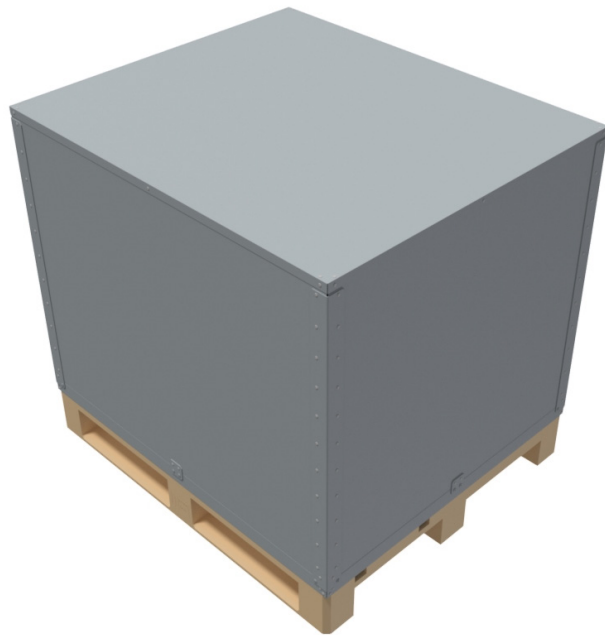


Figure 1  
**Withdrawable VCB Package**

Unscrew the packing metal holder's fastening screws as shown below and remove the package cover



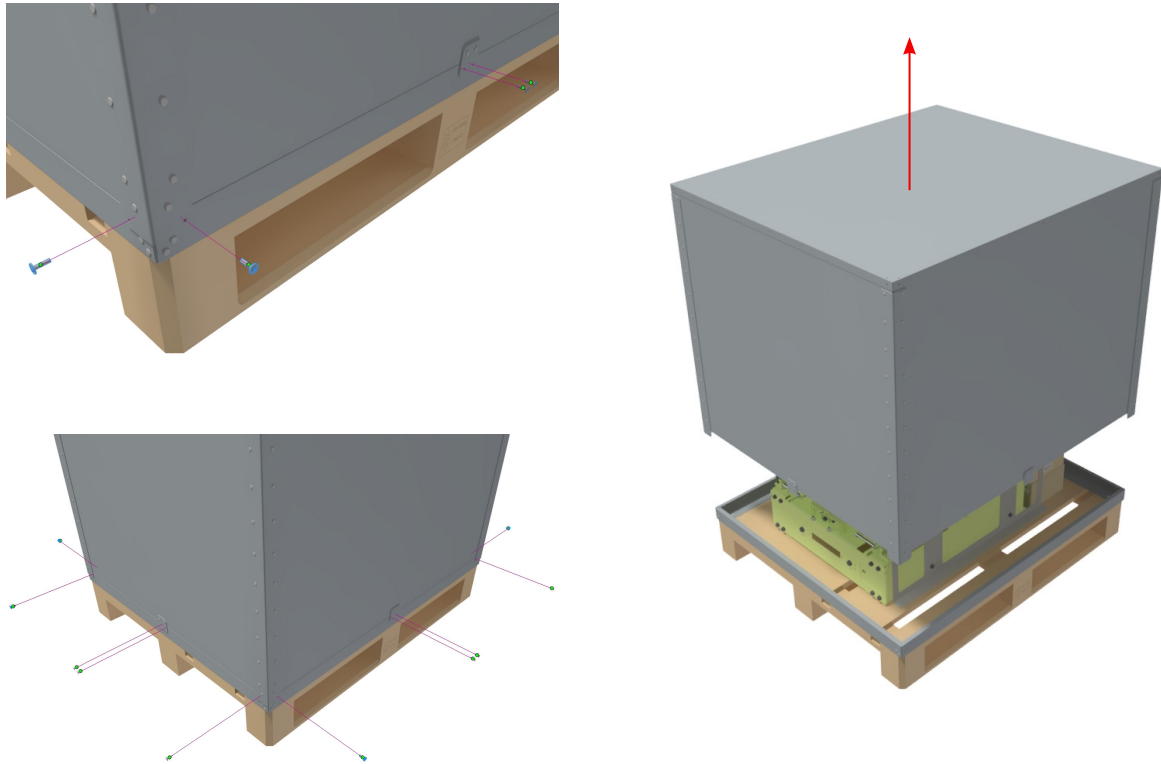


Figure 2  
**Unpacking of VCB**

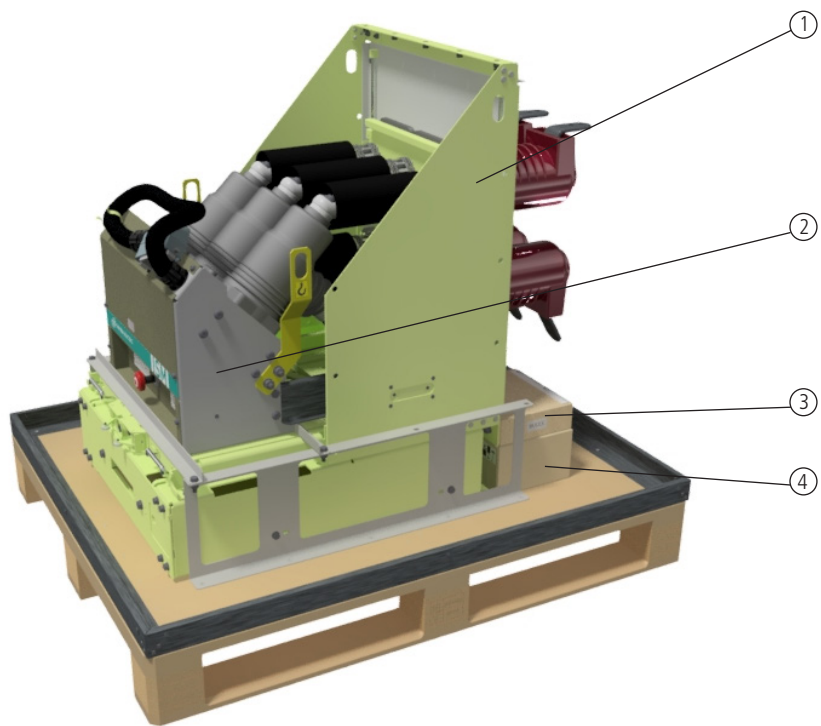


1. Fixed Parts (Cradle)
2. Withdrawable VCB
3. CM
4. CBkit\_Plug\_1


Figure 3  
**VCB Components on the Pallet**

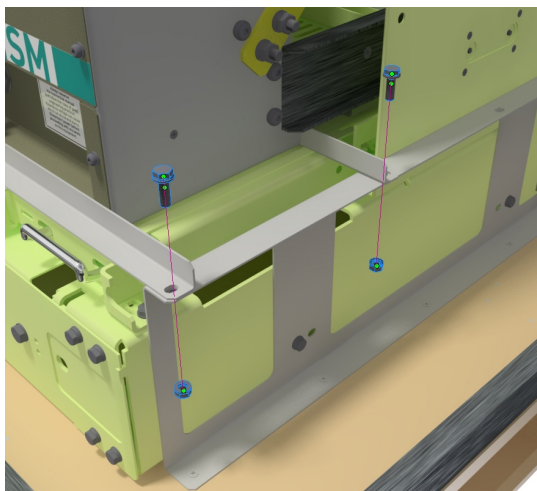

a)

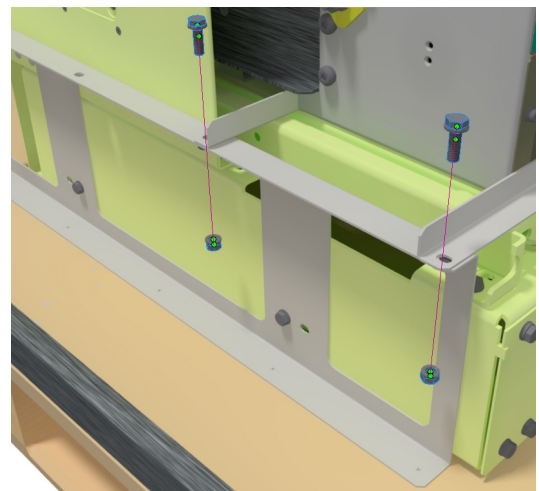

b)

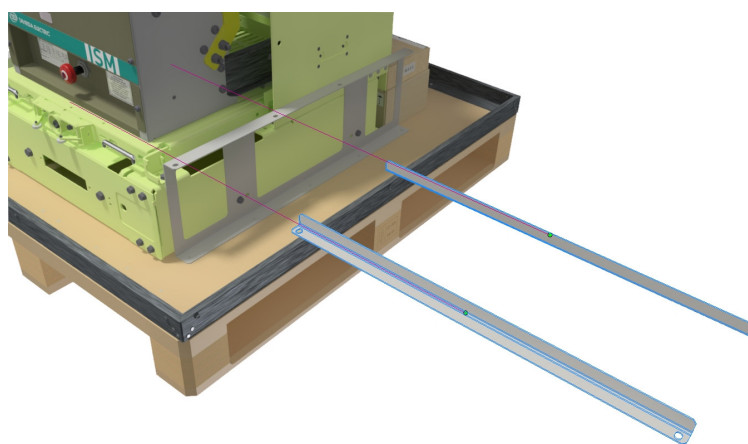


c)


Figure 4  
**Extracting Holder Drawout Breaker**




Lifting of the withdrawable VCB:

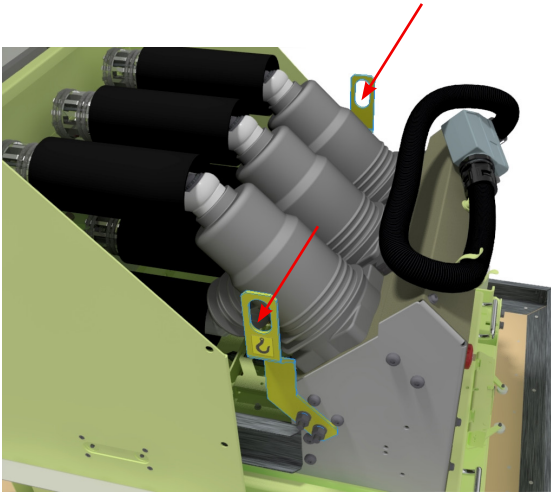

a)

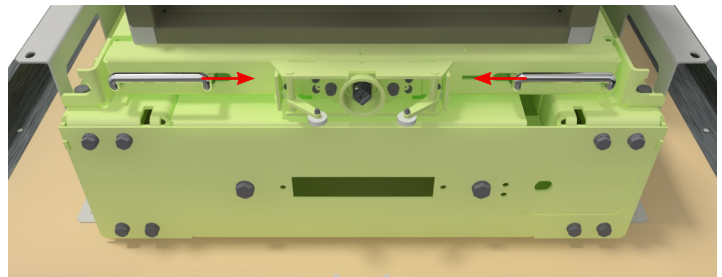

b)

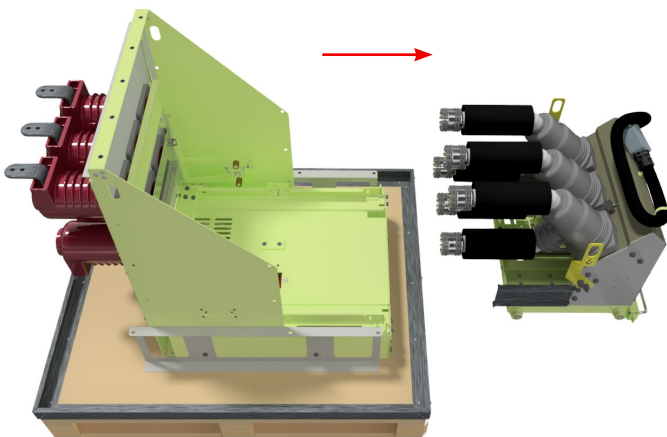


c)




d)


Figure 5  
Extracting Drawout Breaker from Cradle

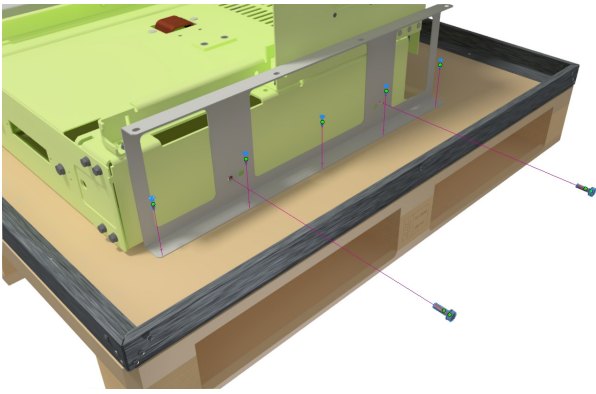


a)

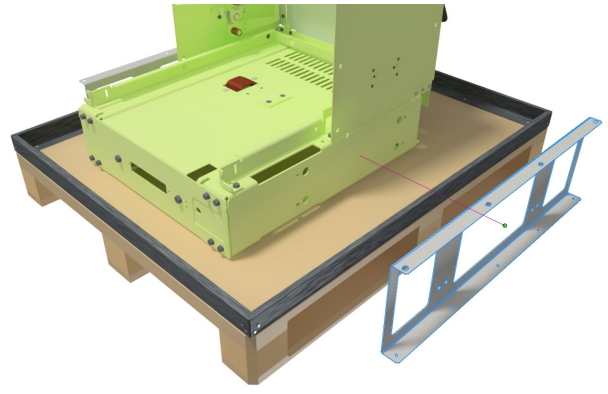


b)

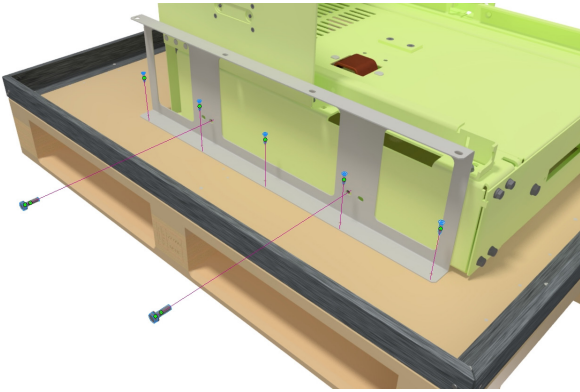

c)

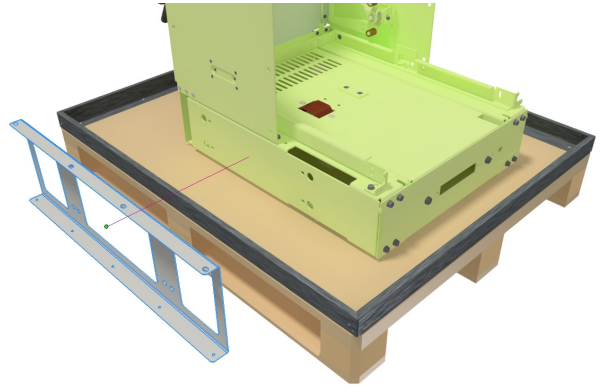

d)

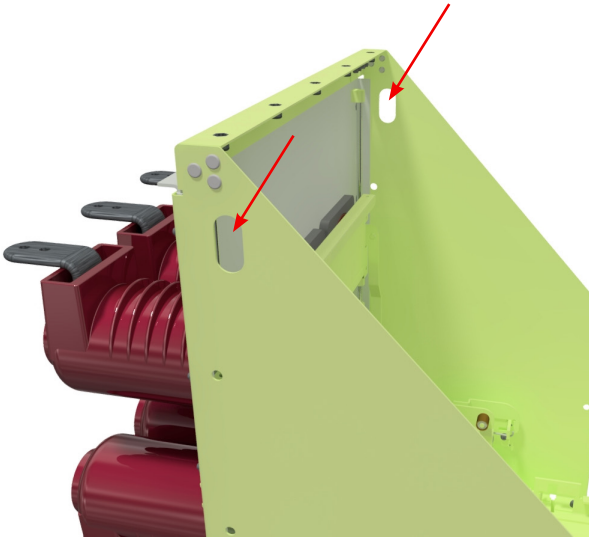


e)




f)

Figure 6  
Removing the Cradle from the Pallet

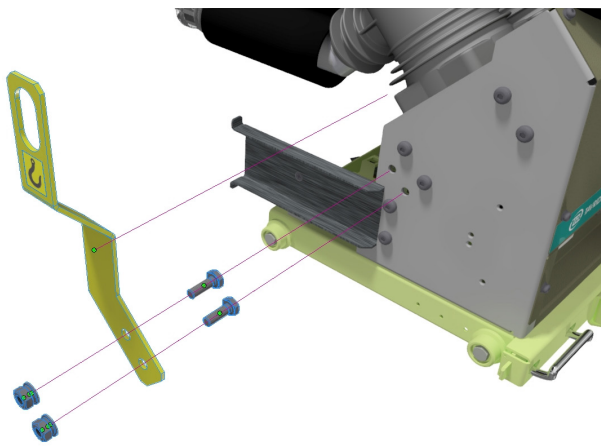

a)

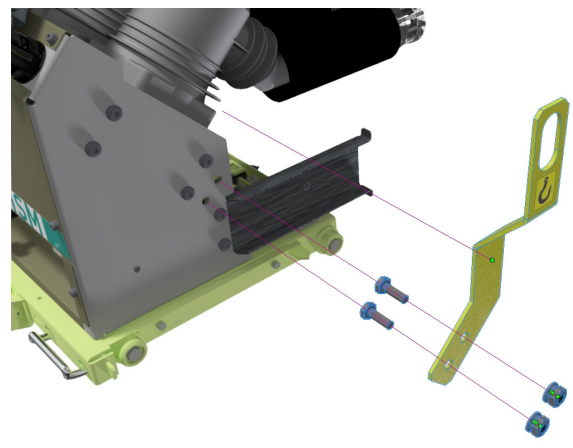

b)



c)

Figure 7

**Removal of Lifting Brackets of the VCB**

To lift and handle the circuit-breaker and cradle, proceed as shown in Figure 5 d) and Figure 6 f) . The special lifting tool is not supplied.

The lifting brackets of the VCB should be removed before using the withdrawable VCB (Figure 7).

All items should be checked visually for:

- Mechanical damage, scratches, discoloration, corrosion.

Any transport damage must be reported immediately to the carrier in writing. Damages shall be photographically documented.

## 2.3.2 VCB Packaging and Scope of Supply

The VCB is placed in a metal box on the pallet (Figure 10) with following labels:

- Handling symbols label for transport and storage of the delivery unit (Figure 8).
- Labels for manufacturers and product information (Figure 9).

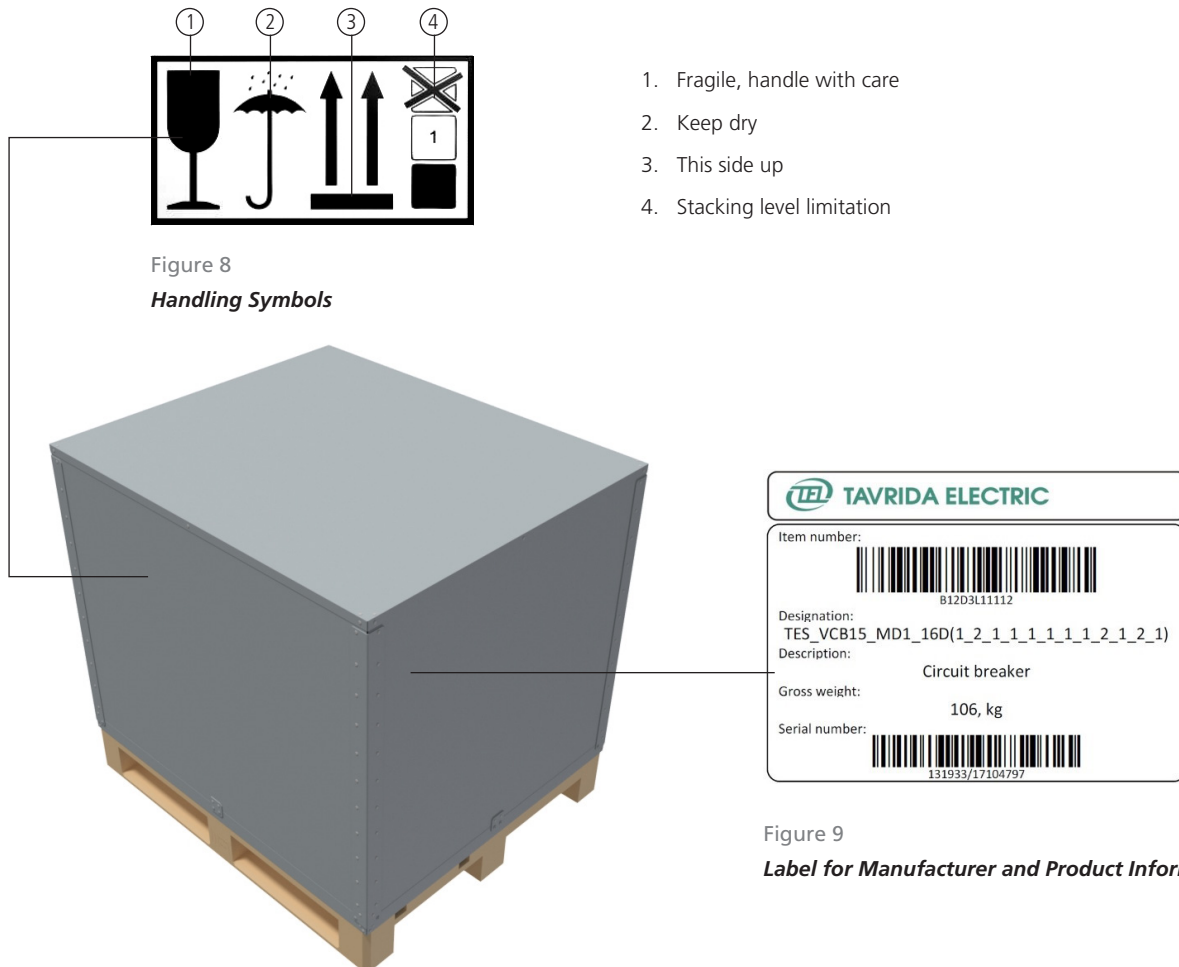


Figure 10  
**VCB Package**

The VCB delivery set contains:

1. Fixed Parts (Cradle)
2. Withdrawable VCB
3. CBkit\_Plug\_1




### 2.3.3 CM Packaging (not in the Scope of Supply)

CM is not included in the scope of the supply and should be ordered separately from VCB.



Figure 11  
**CM Packaging**

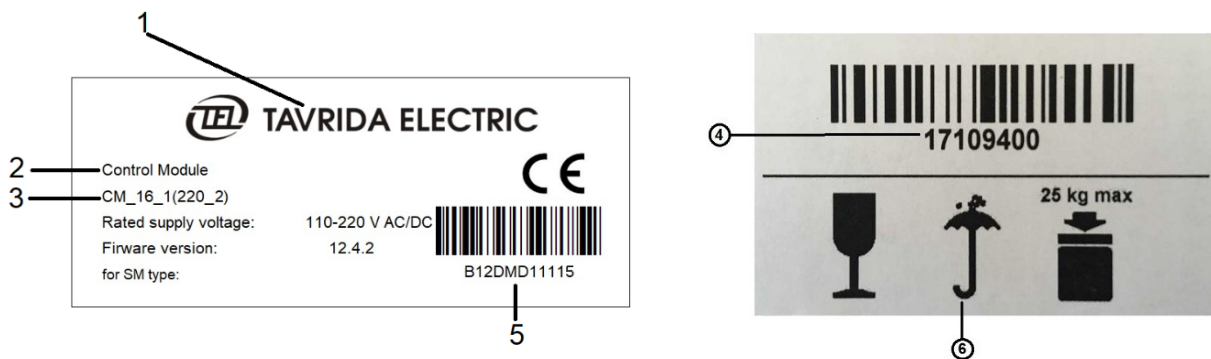

- |                 |                   |                     |
|-----------------|-------------------|---------------------|
| 1. Manufacturer | 3. Type of device | 5. Product code     |
| 2. Product name | 4. Serial number  | 6. Handling symbols |

Figure 12  
**CM Packaging Labels**


Each CM includes the following components:



a) CM



b) Screwdriver

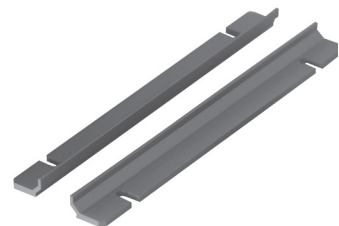

c) Brackets

Figure 13  
**CM Delivery Set**

### 2.3.4 CBkit\_Plug\_1 Scope of Supply

As part of the VCB, the CBkit\_Plug\_1 is placed inside the VCB package. The kit is packed in a cardboard box.



Figure 14  
**CBkit\_Plug\_1 Packaging**


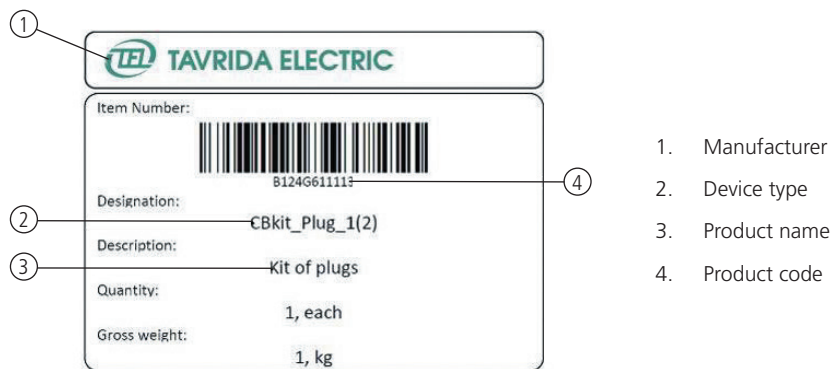


Figure 15  
**CBkit\_Plug\_1 Package Labeling**

## CBkit\_Plug\_1(2) - Metal Plug 72 Pins

CBkit\_Plug\_1(2) includes:

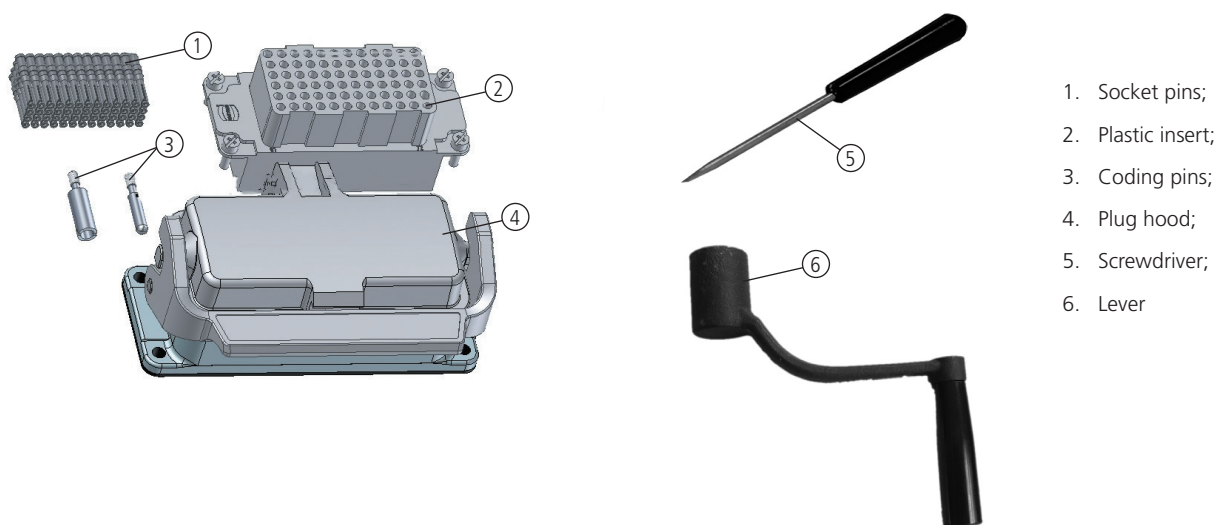


1. Socket pins;
2. Plastic insert;
3. Coding pins;
4. Plug hood;
5. Screwdriver;
6. Lever

Figure 16

**CBkit\_Plug\_1(2) Delivery Det**

## CBkit\_Plug\_1(3) - Metal Plug 108 Pins

CBkit\_Plug\_1(3) includes:

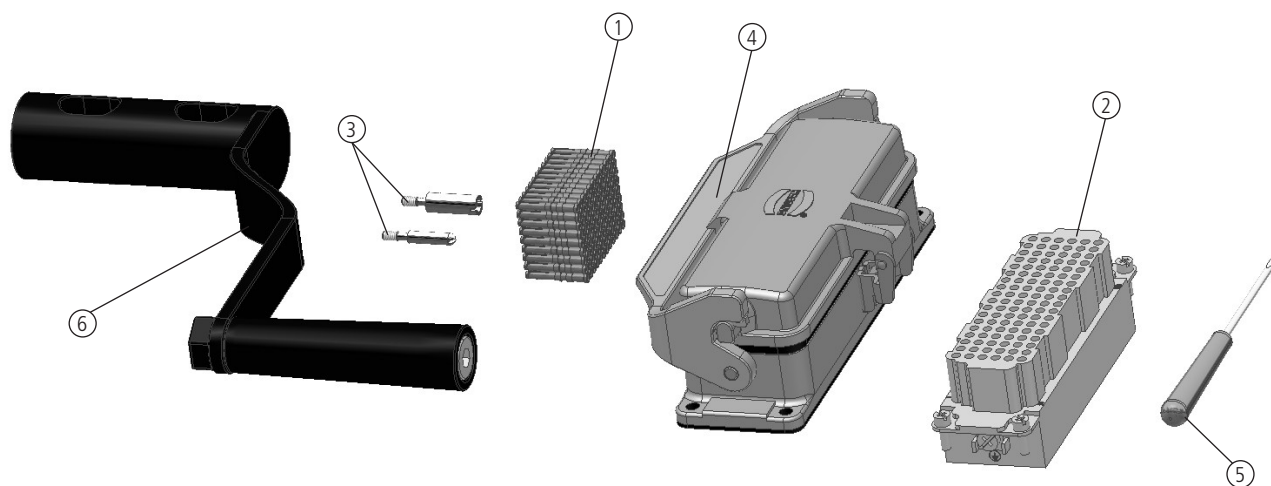

- |                   |                |
|-------------------|----------------|
| 1. Socket pins    | 4. Plug hood   |
| 2. Plastic insert | 5. Screwdriver |
| 3. Coding pins    | 6. Lever       |

Figure 17

**CBkit\_Plug\_1(3) Delivery Det**

## 2.4 Handling

To avoid equipment damage, please follow the handling recommendations listed below:

1. Handling shall be done in accordance with pictorial symbols.
2. Eliminate any drops.
3. Eliminate any mechanical impacts which can cause package damage.
4. Packages have to be stowed to ensure complete tightness. The boxes should be packed tightly so that they cannot shift inside of a container under any transportation conditions.
5. The modules shall be tied up twice with a 16 mm polyester band.




## 3. Product Coding and Labels

# 3.1 Circuit Breaker

## Coding

CR15\_MD1\_16D(Par1\_Par2\_Par3\_Par4\_Par5\_Par6\_Par7\_Par8\_Par9\_Par10\_Par11\_Par12\_Par13)



**Table 1 - Product Group Description**

Code	Description
CR15	Vacuum Circuit Breaker in Cradle with Rated Voltage Up to 15kV

**Table 2 - ISM Type Description**

Code	Description
MD1	Three-Phase Medium Duty Indoor Switching Module with Rated Normal Current Up to 1250 A

**Table 3 - CM and VCB Implementation Type Description**

Code	Description
16D	The 16th Series of Control Module and Draw-Out Type VCB

**Table 4 - Circuit Breaker Parameters Description**

Parameter	Parameter description	Applicable options	Code
Par1	Customization	No Customization	1
Par2	Rated voltage	15 kV	1
Par3	Rated short circuit breaking current	31.5 kA	1
Par4	Rated normal current	1250 A	1
Par5	Phase centre distance	150 mm	1
		210 mm	2
Par6	Terminal centre distance	205 mm	1
Par7	Lower terminal height	260 mm	2
Par8	CM settings	Without CM	2
Par9	Rated auxiliary supply voltage	Without CM	3
Par10	Auxiliary plug	Metal plug - Harting	2
Par11	Optional interlock	Without optional interlock	2
Par12	Earthing switch	Without Earthing switch	1
Par13	Language	English language without CM	3

1) Please contact your local sales representative for information.

CR15\_HD1\_16D(Par1\_Par2\_Par3\_Par4\_Par5\_Par6\_Par7\_Par8\_Par9\_Par10\_Par11\_Par12\_Par13)

	CM and VCB implementation type
	ISM type
	Product group

**Table 5 - Product Group Description**

Code	Description
CR15	Vacuum Circuit Breaker in Cradle with Rated Voltage Up to 15kV

**Table 6 - ISM Type Description**

Code	Description
HD1	Three-Phase Heavy Duty Indoor Switching Module with Rated Normal Current Up to 3150 A

**Table 7 - CM and VCB Implementation Type Description**

Code	Description
16D	The 16th Series of Control Module and Draw-Out Type VCB

**Table 8 - Circuit Breaker Parameters Description**

Parameter	Parameter description	Applicable options	Code
Par1	Customization	No Customization	1
Par2	Rated voltage	15 kV	1
Par3	Rated short circuit breaking current	31.5 kA	1
Par4	Rated normal current	2500 A	1
Par5	Phase centre distance	210 mm	1
		275 mm	2
Par6	Terminal centre distance	310 mm	1
Par7	Lower terminal height	280 mm	1
Par8	CM settings	Without CM	2
Par9	Rated auxiliary supply voltage	Without CM	3
Par10	Auxiliary plug	Metal plug - Harting	2
Par11	Optional interlock	Without optional interlock	1
Par12	Earthing switch	Without Earthing switch	1
Par13	Language	English language without CM	3

1) Please contact your local sales representative for information.

## Labels

Each VCB has an electrical data label which contains the circuit breaker's serial number:


①	 <b>TAVRIDA ELECTRIC</b>									
②	Ur	17.5	kV	Ir	1250	A	P	150	mm	⑩
③	Ud	42	kV	Isc	31.5	kA	M	72	kg	⑪
④	Up	95	kV	tk	4	s	Year	2018		⑫
	Optional interlock:		Without optional		interlock					
⑤	IEC62271-1, IEC62271-100				O - 0.3s - CO - 15s - CO					⑬
⑥	VCB15_MD1_16D									
	Serial number: 131931									
				⑦	⑧	⑨				

Figure 18

### Withdrawable VCB Label

- |   |                                    |
|---|------------------------------------|
| 1. Manufacturer                               | 8. Rated short-circuit current Isc |
| 2. Rated voltage Ur                           | 9. Rated normal current Ir         |
| 3. Rated power frequency withstand voltage Vd | 10. Phase center distance P        |
| 4. Rated impulse withstand voltage Up         | 11. Weight W                       |
| 5. Applicable standards                       | 12. Year of manufacturing          |
| 6. VCB designation and serial number          | 13. Rated operating sequence       |
| 7. Rated duration of short circuit tk         |                                    |

The nameplate contains information about the VCB type, the VCB technical parameters and the serial number.

The placement of the electrical data label is shown below.

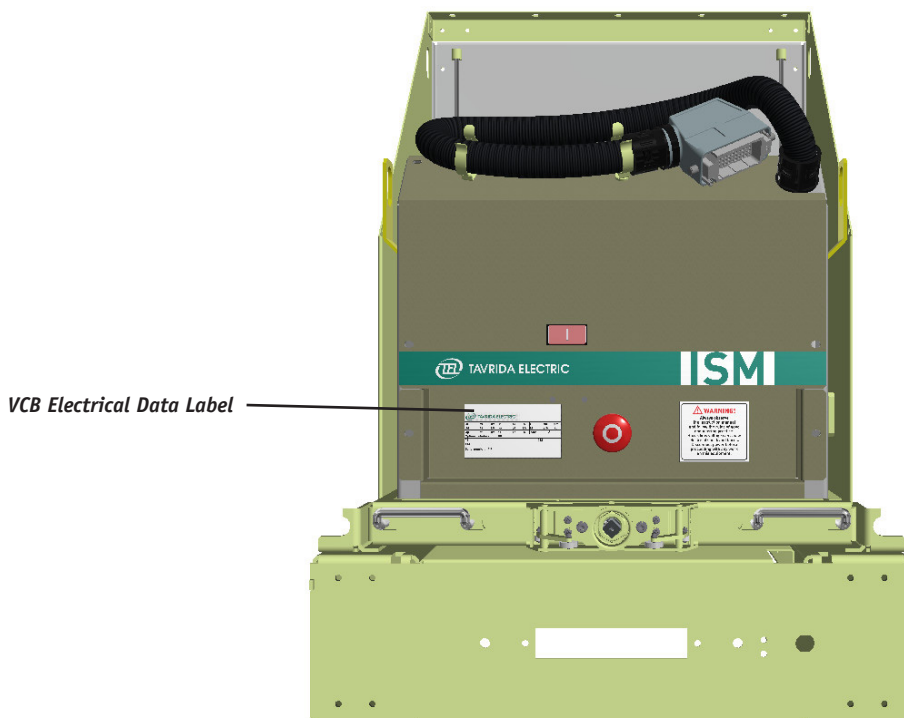


Figure 19

### Withdrawable VCB Labeling

### 3.1.1 Control Module

#### Coding

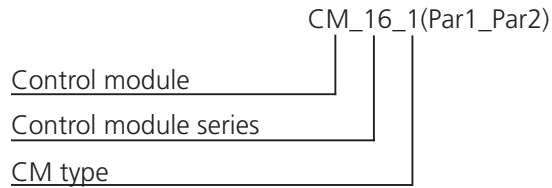


Table 9 - CM Parameters Description

Parameter	Parameter description	Applicable options	Code
Par1	Rated Voltage	19-72V DC	60
		85-265V AC/DC	220
Par2	Version	Up-to-date model	2

#### Labels and Seal

Each CM\_16\_1 has the following labels:

- Serial number label
- Information label with terminals connections and main parameters
- Information label with settings code for CM\_16\_1 modules
- Seals



Figure 20  
Serial Number Label

<b>FACTORY SETTINGS CODE:</b>  <b>10-00-160-245-1212-11</b>	<b>UNDERVOLTAGE RELEASE SETTINGS</b> UV On/Off: OFF UV Delay: 0 Seconds Reclose on UV: 0 Reclose Delay: N/A	<b>DIGITAL OUTPUTS</b> Relay 1: Breaker Position Relay 2: Ready Status Relay 3: Malfunction Status	<b>TRIP / CLOSE SETTINGS</b> Trip Delay: 12 ms Close Delay: 12 ms Trip Input: N/O Dry Contact Close Input: N/O Dry Contact
	<b>USE WITH BREAKER TYPES: ISM15_MD_1</b> Settings for this device have been pre-installed by Tavrída engineering services. Refer to the appropriate ISM user manual for detailed information or contact Tavrída at 1-866-551-8362		

Figure 21  
Information Label with Settings Code for CM\_16\_1 Modules


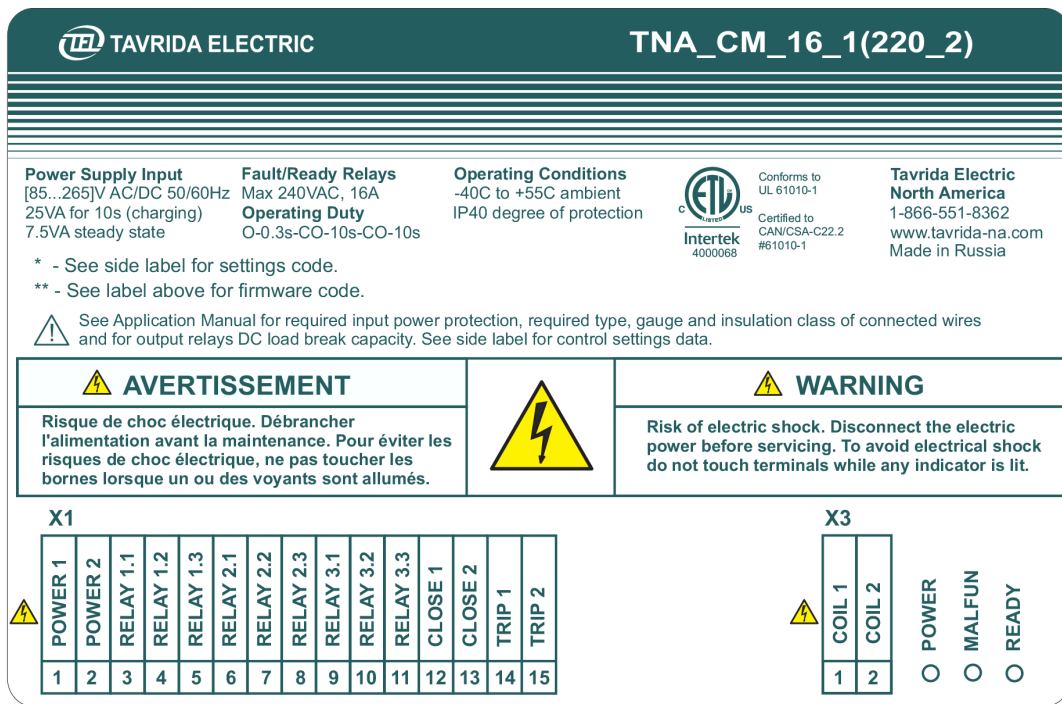


Figure 22  
**Information Label with Terminals Connections and Main Parameters**

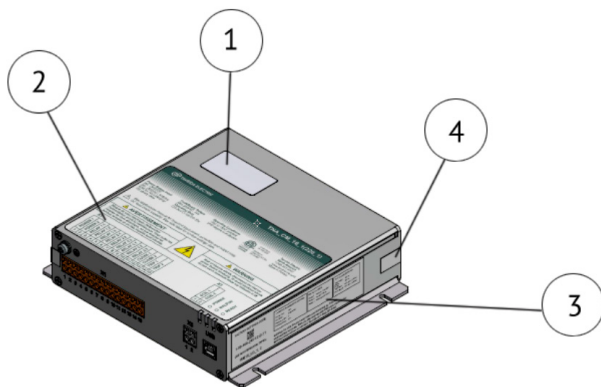

1. Serial Number Label
2. Information Label with Terminals Connections and Main Parameters Warning Label
3. Information Label with Settings Code for CM\_16\_1 Modules
4. Warranty Seal

Figure 23  
**CM Labels**

### 3.1.2 Auxiliary Plugs Kit

CBkit\_Plug\_1 is used to provide a counterpart for the DOU auxiliary circuits connector in the switchgear panel.

Drawout circuit breaker is supplied with one type of secondary plug and appropriate counterpart, which can be 72 pins Harting or 108 pins Harting, please ask your local representative for details.

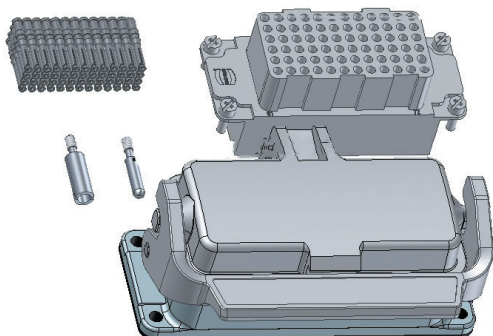


Figure 24

***Metal plug (72 pins) Scope of Supply***

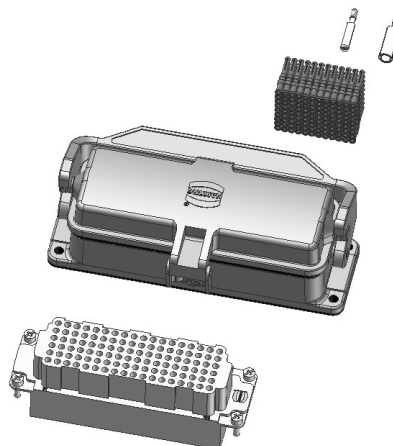


Figure 25

***Metal plug (108 pins) Scope of Supply***





## 4. Technical Parameters

Main technical data and circuit breaker technical parameters are presented in the tables below.

**Table 10 - Main Technical Parameters**

Type	CR15_MD1_16D		CR15_HD1_16D	
	Rated voltage (Ur)	15 kV		15 kV
Phase centre distance (PCD), mm	150	210	210	275
Rated normal current (Ir)	1250 A		2500 A <sup>1)</sup>	
Rated power frequency withstand voltage (Ud)	36 kV			
Rated lightning impulse withstand voltage (peak) (Up)	95 kV			
Rated short-circuit breaking current (Isc)	31.5 kA <sup>2)</sup>			
Rated peak withstand current (Ip)	82 kA			
Rated short-time withstand current (Ik)	31.5 kA			
Rated duration of short circuit (tk)	4 s			
Rated frequency (fr)	50/60 Hz			
Mechanical life (CO-cycles)	30 000			
Number of operated-isolated operations	500 cycles			
Maximum number of CO-cycles per hour	60			
Operating cycles, rated-short circuit breaking current	50			
Closing time	≤ 60 ms			
Opening time	≤ 35 ms			
Break time	≤ 45 ms			
Resistance of main circuit	≤ 31 μOhm		≤ 25 μOhm	≤ 20 μOhm
Rated operating sequence at rated normal current	O-0.3s-CO-10s-CO-10s-CO <sup>3)</sup>			
Rated operating sequence at rated short-circuit breaking current	O-0.3s-CO-15s-CO			
<b>Auxiliary Circuits Insulation Strength <sup>4)</sup></b>				
Power frequency test voltage (1 min) in accordance with IEEE C37.09	2.5 kV			
Lightning impulse 1.2ms/50ms/0.5 J in accordance with IEC60255-27	5 kV			
Insulation resistance of 1000V DC in accordance with IEC60255-27	≥ 5 MOhm			
Design class of switching module with regard to severity of service conditions in accordance with IEC 60932	Class 0			
Standards	IEEE C37.09, C37.09a, C37.09b, C37.04			
Mechanical vibration withstand capability according to IEC 60721-3-4	Class 4M4			
Weight (depending on Phase Centre Distance)	143-159.1 kg			

**Table 10 - Main Technical Parameters**

Type	CR15_MD1_16D	CR15_HD1_16D
Altitude above sea level	1000 m <sup>5)</sup>	
Relative humidity in 24 hours	≤ 95 %	
Relative humidity over 1 month	≤ 90 %	
Temperature Range	-25 °C ... +55 °C	
Degree of protection of main circuit terminals in accordance with IEC 60529	IP00	
Degree of protection of actuators compartment in accordance with IEC 60529	IP40	
Service conditions	<p>a) The ambient air is not polluted by dust, smoke, corrosive and/or flammable gases, vapors or salt and would be considered as having a site pollution severity class (SPS) "very light" according to IEEE C37.04 Table C.1.</p> <p>b) The average value of the water vapor pressure, over a period of 24 h, does not exceed 2.2 kPa.</p> <p>c) The average value of the water vapor pressure, over a period of one month, does not exceed 1.8 kPa.</p>	
Type of driving mechanism	Monostable magnetic actuator	
Operation counter	Electrical, built in into control module	
<b>Design/Switching Capacity of ISM Auxiliary Contacts</b>		
Number of available auxiliary contacts for three-phase ISM	6 NO + 6 NC	
Minimum current for 12 V AC / DC, ohmic load	100 mA	
Minimum current for 12 V AC / DC, inductive load (t=20 ms, cosj =0,3)	100 mA	
Maximum current for 30 V DC, ohmic load	10 A <sup>6)</sup>	
Maximum current for 30 V DC, inductive load (t=20 ms)	3 A	
Maximum current for 60 V DC, ohmic load	0.9 A	
Maximum current for 60 V DC, inductive load (t=20 ms)	0.9 A	
Maximum current for 125 V DC, ohmic load	0.5 A	
Maximum current for 125 V DC, inductive load (t=20 ms)	0.03 A	
Maximum current for 250 V DC, ohmic load	0.25 A	
Maximum current for 250 V DC, inductive load (t=20 ms)	0.03 A	
Maximum current for 125 V AC, ohmic load	10 A <sup>6)</sup>	
Maximum current for 125 V AC, inductive load (cosj =0,3)	5 A	
Maximum current for 250 V AC, ohmic load	10 A <sup>6)</sup>	
Maximum current for 250 V AC, inductive load (cosj =0,3)	5 A	

Table 10 - Main Technical Parameters

Type	CR15_MD1_16D	CR15_HD1_16D
<b>Design/Switching Capacity of DOU Plate Auxiliary Contacts</b>		
Number of available auxiliary contacts	5 NO + 5 NC	
Maximum current for voltage up to 660 V AC	10 A	
<b>CM Operation Times</b>		
Preparation time for the operation of the CM after switching on the auxiliary power supply	≤ 15 s	
Preparation time for the close operation of the CM after a previous close operation	≤ 10 s	
Preparation time for the trip operation of the CM after switching on the auxiliary power supply	≤ 0.1 s	
Trip capability after failure of the auxiliary power supply	≥ 60 s <sup>7)</sup>	

- 1) The rating depends on the metal-enclosed switchgear ventilation. Temperature rise type test at 2500 A in Cradle was successfully passed in KEMA.
- 2) At 40% DC component.
- 3) The number of sequential Close-Trip operations with a 10 second interval should not exceed 10. The number of Close-Trip operations should not exceed 60 per hour. Sequence of 10s Close-Trip operations can be repeated only after 260 s pause.
- 4) Isolation resistance check is not applicable for "Actuator Coil" circuits of CM.
- 5) Up to an installation altitude of 1000 m above sea level. Above 1000m, the external insulation measurement of the ISM must be increased by the atmospheric correction factor Ka according to IEEE Std C37.100.1 compared to the insulation measurement at sea level. The maximum allowed altitude is 2000 m above sea level.
- 6) At 5 min short-term duty. Continuous current – 5 A.
- 7) In case of dry contacts "close" and "trip" are open.

**Table 11 - CM Main Technical Parameters**

<b>Parameter</b>	<b>Value</b>
<b>CM Operation Times</b>	
Preparation time for the operation of the CM after switching on the auxiliary power supply	≤ 15 s
Preparation time for the close operation of the CM after a previous close operation	≤ 10 s
Preparation time for the trip operation of the CM after switching on the auxiliary power supply	≤ 0.1 s
Trip capability after failure of the auxiliary power supply	≥ 60 s <sup>1</sup>
<b>CM Supply Voltage</b>	
Rated range of supply voltage of CM_16_1(60_2)	24 V to 60 V DC
Rated range of supply voltage of CM_16_1(220_2)	110V to 220V AC/DC 50/60Hz for AC
Rated range of supply voltage of CM_16_2(220_2)	
Operating range (80-120%) of CM_16_1(60_2)	19 V to 72 V DC
Operating range (80-120%) of CM_16_1(220_2)	85V to 265V AC/DC 50/60Hz for AC
Operating range (80-120%) of CM_16_2(220_2)	
<b>CM Power Consumption of CM</b>	
Charging the close and trip capacitors of CM_16_1(60_2)	≤ 25 W
Charging the close and trip capacitors of CM_16_1(220_2)	≤ 42 W AC <sup>2</sup>
Charging the close and trip capacitors of CM_16_2(220_2)	≤ 37 W DC
Permanent power consumption (standby) of CM_16_1(60_2)	≤ 5 W
Permanent power consumption (standby) of CM_16_1(220_2)	≤ 7 W AC <sup>3</sup>
Permanent power consumption (standby) of CM_16_2(220_2)	≤ 5 W DC
Inrush current of CM_16_1(60_2) with discharged capacitors	≤ 120 A
Inrush current of CM_16_1(220_2) with discharged capacitors	≤ 18 A
Inrush current of CM_16_2(220_2) with discharged capacitors	
Inrush time constant of CM_16_1(60_2) with discharged capacitors	≤ 0.5 ms
Inrush time constant of CM_16_1(220_2) with discharged capacitors	≤ 4 ms
Inrush time constant of CM_16_2(220_2) with discharged capacitors	
<b>Design, Switching Capacity of CM Output Relays (Dry Contacts)</b>	
Number of relays in CM_16_1	3
Number of relays in CM_16_2	
Number of available contacts for one relay	1 NO + 1 NC with common point

**Table 11 - CM Main Technical Parameters**

<b>Parameter</b>	<b>Value</b>
Rated voltage	240 V
Rated current AC	16 A
Maximum breaking power AC	4000 VA
Maximum switching current 250V DC	0.35 A
Maximum switching current 125V DC	0.45 A
Maximum switching current 48V DC	1.3 A
Maximum switching current 24V DC	12 A
Switching time	5 ms
Operations counter	10 digits, available via USB port
<b>"Close" and "Trip" Dry Contacts Inputs of CM</b>	
Output voltage	≥ 30 V
Contacts closed current	≥ 50 mA
Steady state current	≥ 5 mA
Weight of CM_16_1	1 kg
Weight of CM_16_2	
Overall dimensions of CM <sup>4</sup> .	190x165x45 mm
Temperature Range	-40°C...+55°C
Service conditions	<p>a) The ambient air is not polluted by dust, smoke, corrosive and/or flammable gases, vapors or salt and would be considered as having a site pollution severity class (SPS) "very light" according to IEEE C37.04 Table C.1.</p> <p>b) The average value of the water vapor pressure, over a period of 24 h, does not exceed 2.2 kPa.</p> <p>c) The average value of the water vapor pressure, over a period of one month, does not exceed 1.8 kPa.</p>
<b>CT Power Supply Parameters (for CM_16_2(220_2) only)</b>	
Operating current range	2-300 A

**Table 11 - CM Main Technical Parameters**

<b>Parameter</b>	<b>Value</b>
Power consumption per phase during charging trip capacitors	
- 2 A	5 VA
- 5 A	12 VA
- 10 A	25 VA
- 30 A	120 VA
- 300 A	8 kVA
Preparation time for trip operation (charging of the trip capacitor), no more than	
- 2 A	1000 ms
- 5 A	400 ms
- 10 A	150 ms
- 30 A	110 ms
- 300 A	100 ms
Current carrying capacity, not less than	
- 2 A	$\infty$
- 5 A	100 s
- 10 A	10 s
- 30 A	1 s
- 300 A	0.1 s
<b>Environmental Conditions: Location, ordinary dry</b>	
Maximum operating temperature	55°C
Maximum operating altitude	2000 m
Maximum humidity, no more	98 % (no condensation)

1. In case of Dry contacts "Close" and "Trip" are open.
2. At  $\text{Cos } j > 0.66$ .
3. At  $\text{Cos } j > 0.33$ .
4. Overall dimensions of ISM are given in Appendix 3. Overall Drawings

**Table 12 - CM EMC Parameters**

Parameter	Applicable standard	Rated Value
<b>Electromagnetic Compatibility (EMC) Requirements <sup>1)</sup></b>		
Electrostatic discharge	IEC 60255-26 IEC 61000-4-2	8 kV contact 15 kV air
Radiated EM field Immunity	IEC 60255-26 IEC 61000-4-3	80 MHz – 3 GHz Sweep & spot AM 1 kHz 80% 10 V/m
Fast transient burst Immunity	IEC 60255-26 IEC62271-1 IEC 61000-4-4	4 kV common mode
Surge Immunity	IEC 60255-26 IEC 61000-4-5	4 kV common mode 2 kV differential mode
Conducted disturbance induced by Radio frequency fields	IEC 60255-26 IEC 61000-4-6	150 kHz – 80 MHz AM 1 kHz 80% 10 V
Power Frequency Magnetic Field	IEC 60255-26 IEC 61000-4-8	100 A/m continuously 1000 A/m 1 sec
Pulse Magnetic Field	IEC 61000-4-9	1000 A/m
100 kHz Damped Oscillatory Magnetic Field	IEC 61000-4-10	100 A/m
1 MHz damped oscillatory magnetic field	IEC 61000-4-10	100 A/m
AC Voltage Dips and Interruptions	IEC 60255-26 IEC 61000-4-11	$\Delta U$ 30% 1 period $\Delta U$ 60% 50 periods $\Delta U$ 100% 5 periods $\Delta U$ 100% 50 periods
Power Frequency Disturbance Voltage	IEC 60255-26 IEC 61000-4-16	300 V common mode 150 V differential mode <sup>2)</sup>
100 kHz and 1 MHz Damped Oscillatory Wave Immunity	IEC 60255-26 IEC 62271-1 IEC 61000-4-18	2.5 kV common mode 1 kV differential mode
Ripple on DC Power Supply	IEC 60255-26 I IEC 61000-4-27	10% of Supply voltage, 100 Hz
DC Voltage Dips and Interruptions	IEC 60255-26 IEC 62271-100 IEC 61000-4-29	$\Delta U$ 30% 2 sec $\Delta U$ 60% 2 sec $\Delta U$ 100% 0,3 sec $\pm 20$ % 10 sec

1) Cable from electronic relay to connector block should be shielded and the case grounded near the connector. The total length of unshielded wires from connector block to CM WAGO connector should not exceed 200 mm. Electromagnetic compatibility requirements are not applicable for the CM USB port as this port is used only for CM programming during production and not used under service conditions.

2) Test influence is not applicable for CM "Close" and "Trip" dry contacts.



# 5. Design, Installation and Operation

# 5.1 Design

## 5.1.1 Draw-Out Unit

The draw-out plate, with its racking mechanism, allows the VCB to be racked into or out of the service position to test positions inside the switchgear. The main position indicating device is mechanically joined with the synchronizing shaft of the ISM to reliably indicate the status of the ISM. The manual tripping device provides mechanical tripping for the ISM.

A series of interlocks are provided to prevent malfunctions and to ensure maximum operator safety.

The spring-loaded contact system contains insulated contact arms which create an electrical connection between the VCB main terminals and fixed contacts of the switchgear when the draw-out unit is in the service position.

The open design of the draw-out unit provides visual control of the main circuit's disconnection when it is in the test position.

The auxiliary circuit cable contains ISM and DOU auxiliary circuit switches and optional interlock wiring. The auxiliary multi-pin connector provides interconnection between the draw-out circuit breaker's secondary wiring and the switchgear's auxiliary circuits compartment. The CM is installed in the switchgear's auxiliary circuits compartment to provide all control, and the indication wiring is grouped in the low-voltage compartment of the switchgear. In case of auxiliary supply loss, manual charging of the circuit breaker can be performed by connecting to the CM in the low voltage compartment, excluding the necessity of operating inside the high-voltage compartment.

### Withdrawable VCB

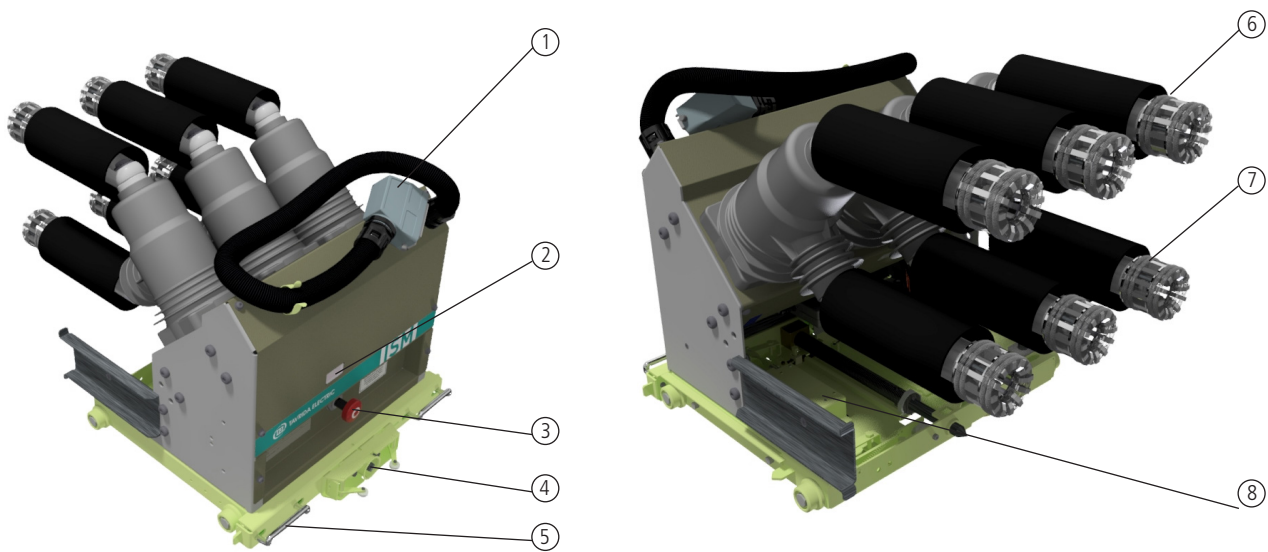


Figure 26

**CR15\_MD1\_16D Withdrawable VCB**

1. Control wiring plug
2. Main contacts position indication
3. Manual trip button
4. Racking mechanism of draw-out plate
5. Fixing mechanism of draw-out plate
6. Main contact upper terminal
7. Main contact lower terminal
8. Draw-out plate auxiliary switches module

## 5.1.2 Fixed Parts (Cradle) for Withdrawable VCB


Fixed parts (cradles) with cassette draw-out type vacuum circuit breaker based on ISM15\_MD\_1.



Figure 27  
**CR15\_MD1\_16D**


VCB with Cradles are used for replacing fixed circuit breakers with draw-out type vacuum circuit breaker, for retrofitting activities and for upgrading obsolete switchgear to the new standards.

Complete modules allow medium voltage air-insulated switchgear to be constructed with the same rated currents as those of the fixed parts.

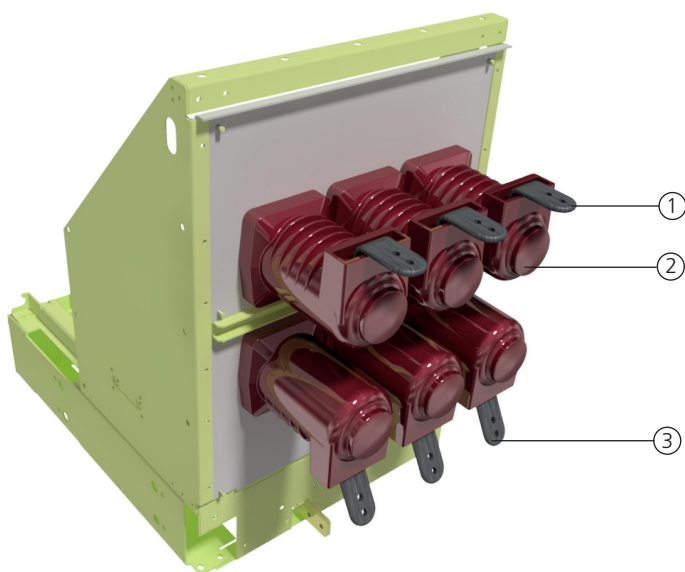

1. Top power connections
2. Insulator bushings
3. Bottom power connections

Figure 28  
**Bushings and Power Connections of the Cradle**

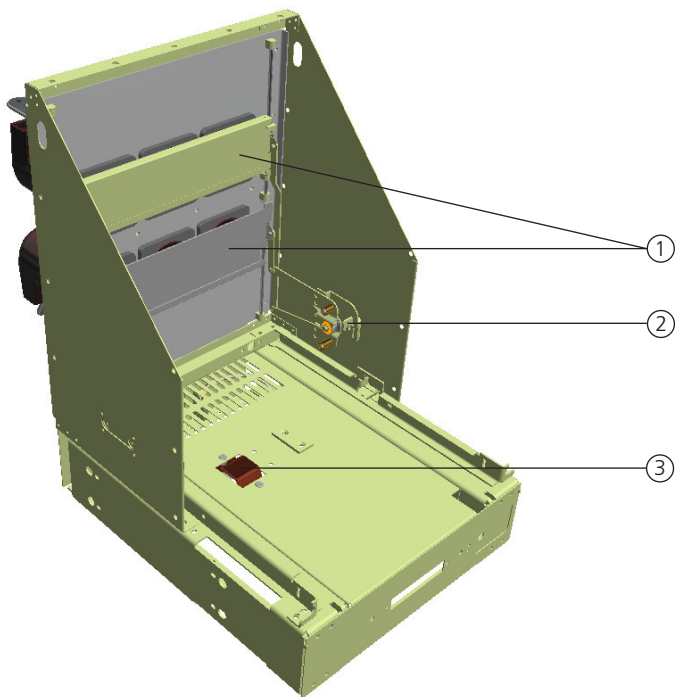

- 1. Metal shutters
- 2. Scissors (levers)
- 3. Earthing bar

Figure 29  
**Front View of the Cradle**

Holes that can be used to fix the cradle in the panel:

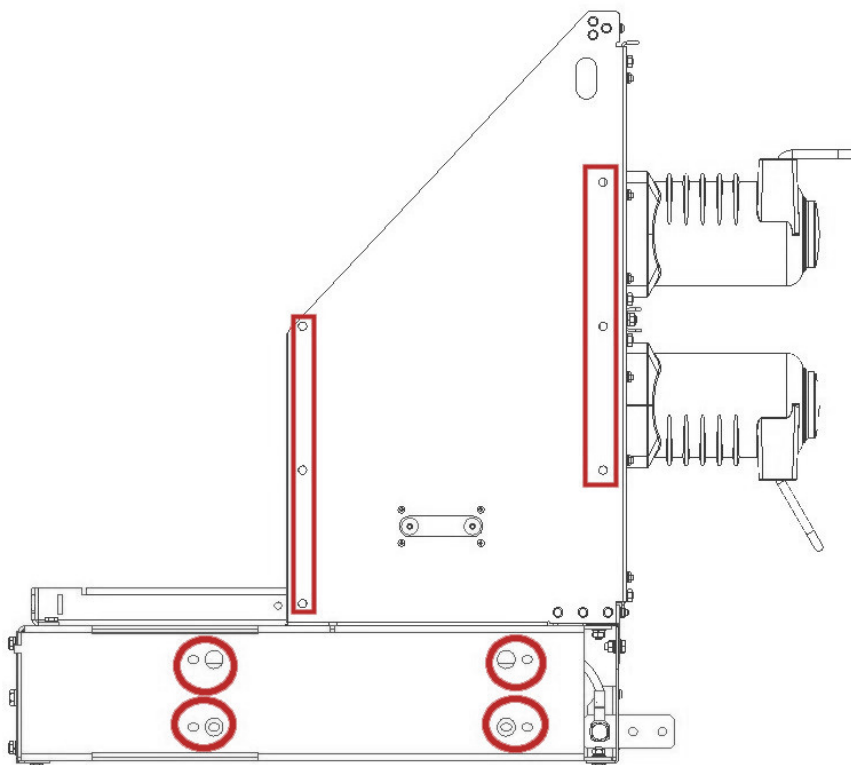


Figure 30  
**Holes for fastening the cradle**

## 5.1.3 Control Module

Tavrída Electric Control modules provide the following advantages:

### Low Power Consumption

Low energy required to close or trip the ISM, no energy consumption by the ISM in its closed or open state and optimization of the CM electrical diagrams leads to low CM power consumption – not more than 42 watts while CM capacitors are charging and no more than 7 watts in standby mode.

### Optimal ISM Control

One CM can drive several different ISM types, but is programmed for use with a particular ISM type. The result is optimal ISM close and trip through a wide range of temperatures.

### Self-Diagnostic Functionality

The CM has an internal self-diagnostic system that monitors ISM connection, power supply level and internal states of the CM. As a result, the CM can indicate issues through the use of LEDs and built-in relays. Unlikely malfunctions are indicated by the number of corresponding LED blinks.

### Wiring Optimization

The CM controls the ISM main contact state via the same circuit used to close or trip the ISM. Therefore, only one circuit connection between the ISM and the CM is required. The CM can provide external circuits with information about the ISM main contacts state through the use of built-in relays, which simplifies the switchgear secondary wiring significantly <sup>1)</sup>.

### Compact Dimensions and Small Weight of CM

The compact size and small weight of the CM (190x165x45 mm, 1 kg) simplifies the installation. The aluminum housing of the CM provides a high EMC level (Table 12 - CM EMC Parameters).

The CM is delivered with mounting brackets for mounting on fat surfaces. The LED indicators are visible from two directions.

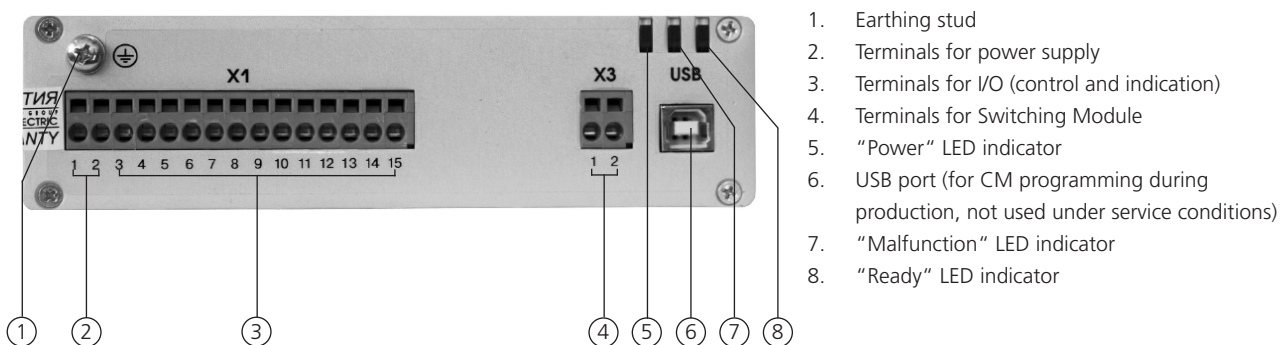


Figure 31

CM\_16\_1

1) The position indication of ISM provided by the CM can be incorrect if the CM is not operable due to an absence of auxiliary supply. The relay keeps its state after the CM power supply disconnection. For demanding applications, conventional mechanical microswitches located at the ISM can be used.

## 5.2 Installation the Primary Part

### 5.2.1 Protective Earthing

The draw-out unit is earthed through the use of truck wheels.

Optionally the earthing can be arranged via the earthing bar which is connected to the bottom of the truck.

In this case, the corresponding earthing has to be put in the switchgear (not part of the delivery).

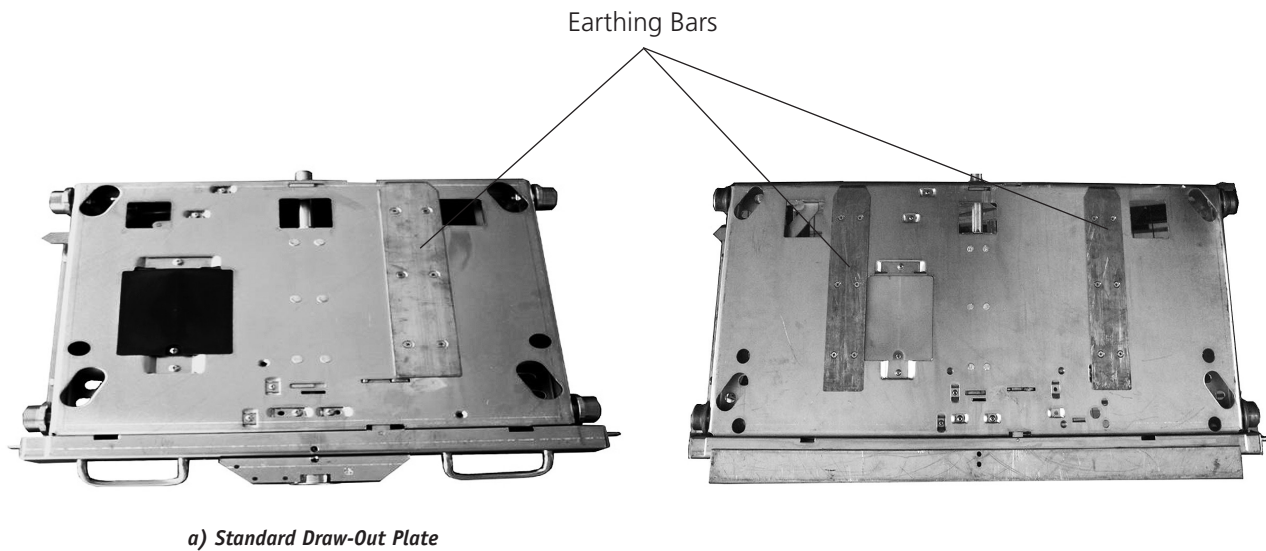


Figure 32  
**DOU Earthing Bars**

### 5.2.2 Primary Connections

Before the first VCB installation in service position it is essential to check the actual dimensions of the fixed contacts installed in the switchgear. In service position, the connection of VCB flexible contacts with fixed contacts of the switchgear should be in accordance with requirements presented in Figure 33. Otherwise, it can lead to overheating and other severe problems.

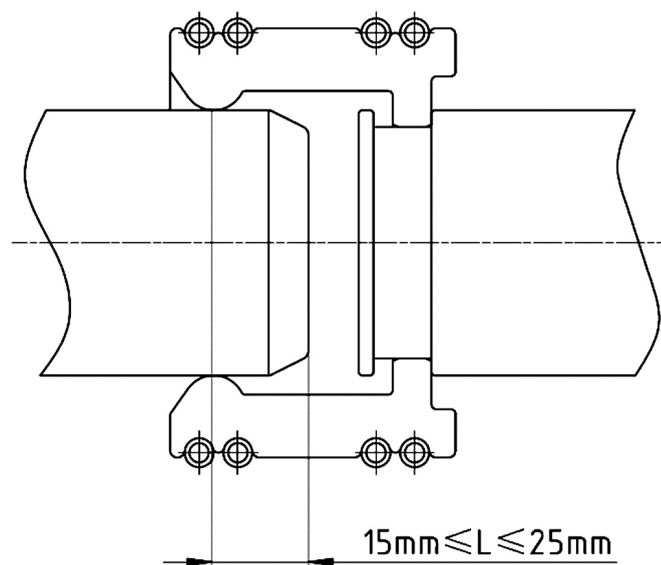


Figure 33  
**Connection of VCB Removable Contacts with Switchgear Fixed Contacts**

## 5.3 Installation the Secondary part

### 5.3.1 VCB Secondary Connections

Secondary circuits cable of the VCB can be either equipped by metal (72 or 108 pins) plug. The secondary plugs arrangement is presented in Table 13-14 (Metal pug). See Appendix 3 for the auxiliary circuits details.



Figure 34

**The Metal Plug with 72 Pins**

**Table 13 - Metal Plug 72 Pins Arrangement**

Pin No	Connection	Pin No	Connection
1	Optional interlock (solenoid) XP3.2	37	-
2	DOU plate position switch SQ2.1	38	DOU plate position switch SQ2.7
3	DOU plate position switch SQ2.2	39	DOU plate position switch SQ2.8
4	-	40	ISM auxiliary switch XT3.12
5	-	41	ISM auxiliary switch XT3.10
6	-	42	ISM auxiliary switch XT3.8
7	-	43	ISM auxiliary switch XT3.6
8	-	44	ISM auxiliary switch XT3.4
9	-	45	ISM auxiliary switch XT3.2
10	DOU plate position switch SQ1.6	46	DOU plate position switch SQ1.3
11	ISM auxiliary switch XT2.12	47	ISM auxiliary switch XT2.9
12	ISM auxiliary switch XT2.6	48	ISM auxiliary switch XT2.3
13	Optional interlock (solenoid) XP3.1	49	Actuator coil (via interlock switch) XT1.2
14	DOU plate position switch SQ2.3	50	DOU plate position switch SQ2.9
15	DOU plate position switch SQ2.4	51	DOU plate position switch SQ2.10
16	-	52	ISM auxiliary switch XT3.11
17	-	53	ISM auxiliary switch XT3.9
18	-	54	ISM auxiliary switch XT3.7
19	DOU plate position switch SQ1.12	55	-
20	DOU plate position switch SQ1.10	56	-
21	DOU plate position switch SQ1.8	57	-
22	DOU plate position switch SQ1.5	58	-
23	ISM auxiliary switch XT2.11	59	ISM auxiliary switch XT2.8
24	ISM auxiliary switch XT2.5	60	ISM auxiliary switch XT2.2
25	-	61	Actuator coil XT1.1
26	DOU plate position switch SQ2.5	62	-
27	DOU plate position switch SQ2.6	63	-
28	-	64	-
29	-	65	-
30	-	66	-
31	DOU plate position switch SQ1.11	67	ISM auxiliary switch XT3.5
32	DOU plate position switch SQ1.9	68	ISM auxiliary switch XT3.3
33	DOU plate position switch SQ1.7	69	ISM auxiliary switch XT3.1
34	DOU plate position switch SQ1.4	70	-
35	ISM auxiliary switch XT2.10	71	ISM auxiliary switch XT2.7
36	ISM auxiliary switch XT2.4	72	ISM auxiliary switch XT2.1
-	-	GND	Earthing

Table 14 - Metal Plug 108 Pins Arrangement

Pin No	Connection	Pin No	Connection
1	ISM auxiliary switch XT2.7	45	-
2	ISM auxiliary switch XT2.9	46	-
3	ISM auxiliary switch XT2.11	47	-
4	ISM auxiliary switch XT3.7	48	-
5	ISM auxiliary switch XT3.9	49	Actuator coil XT1.1
6	ISM auxiliary switch XT3.11	50	-
7	ISM auxiliary switch XT2.1	51	-
8	ISM auxiliary switch XT2.3	52	-
9	ISM auxiliary switch XT2.5	53	-
10	ISM auxiliary switch XT3.1	54	-
11	-	55	ISM auxiliary switch XT3.3
12	-	56	ISM auxiliary switch XT3.5
13	-	57	DOU plate position switch SQ2.1
14	-	58	DOU plate position switch SQ2.2
15	-	59	DOU plate position switch SQ2.3
16	-	60	DOU plate position switch SQ2.4
17	-	61	DOU plate position switch SQ2.5
18	-	62	DOU plate position switch SQ2.6
19	ISM auxiliary switch XT2.8	63	DOU plate position switch SQ2.7
20	ISM auxiliary switch XT2.10	64	DOU plate position switch SQ2.8
21	ISM auxiliary switch XT2.12	65	-
22	ISM auxiliary switch XT3.8	66	Actuator coil (via interlock switch) XT1.2
23	ISM auxiliary switch XT3.10	67	-
24	ISM auxiliary switch XT3.12	68	Optional interlock (solenoid) XP3.2
25	ISM auxiliary switch XT2.2	69	-
26	ISM auxiliary switch XT2.4	70	-
27	ISM auxiliary switch XT2.6	71	-
28	ISM auxiliary switch XT3.2	72	-
29	-	73	ISM auxiliary switch XT3.4
30	-	74	ISM auxiliary switch XT3.6
31	-	75	DOU plate position switch SQ2.9
32	Optional interlock (solenoid) XP3.1	76	DOU plate position switch SQ2.10
33	-	77	DOU plate position switch SQ1.3
34	-	78	DOU plate position switch SQ1.4
35	-	79	DOU plate position switch SQ1.5
36	-	80	DOU plate position switch SQ1.6
37	-	81	DOU plate position switch SQ1.7
38	-	82	DOU plate position switch SQ1.8
39	-	83	-
40	-	84	-
41	-	85	-
42	-	86	-
43	-	87	-
44	-	88	-



Table 14 - Metal Plug 108 Pins Arrangement

Pin No	Connection	Pin No	Connection
89	-	100	-
90	-	101	-
91	-	102	-
92	-	103	-
93	DOU plate position switch SQ1.9	104	-
94	DOU plate position switch SQ1.10	105	-
95	DOU plate position switch SQ1.11	106	-
96	DOU plate position switch SQ1.12	107	-
97	-	108	-
98	-	GND	Earthing
99	-		

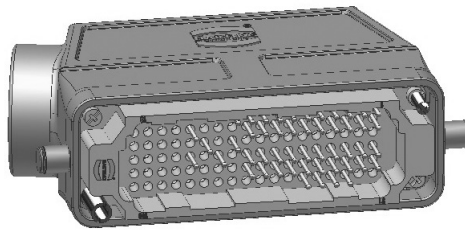


Figure 35  
**Metal Plug with 108 Pins**

### 5.3.2 DOU Auxiliary Circuits Connector Counterpart Installation

To connect the DOU auxiliary circuits to the switchgear, the counterpart for the DOU auxiliary circuits connector shall be installed at the switchgear panel. The counterpart is provided as a part of delivery set.

The type of counterpart provided in the delivery set complies with the auxiliary circuits connector the VCB has. To install the counterpart at the switchgear panel, the following provisions should be used.

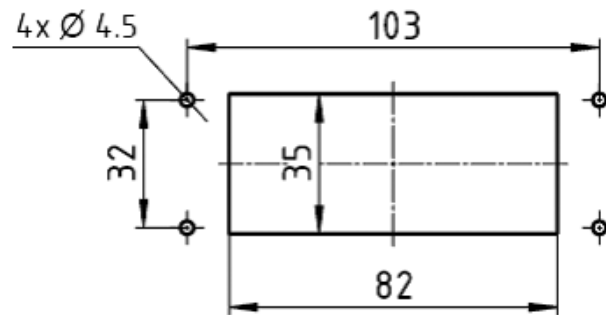


Figure 37

**Metal Plug 72 Pins Counterpart Mounting Provisions and Cut Out**

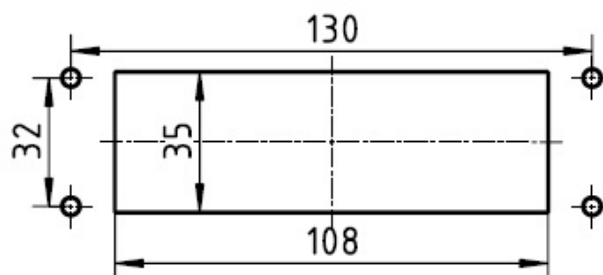


Figure 36

**Metal Plug 108 Pins Counterpart Mounting Provisions and Cut Out**

### 5.3.3 Secondary Cables Between Auxiliary Circuits Connector Counterpart and the CM


**Warning!** If the CM label does not show the correct ISM type, the connection shall not be established. It can lead to the damage of the ISM. Contact your nearest Tavrida Electric partner for replacement.

The secondary cable between auxiliary circuits connector counterpart and the CM shall be performed by a screened cable 2x1.5 mm<sup>2</sup> or equivalent. The degree of coverage of the cable shield shall be not less than 85%.

To achieve the best possible protection against electromagnetic influences, the earthing point of the cable screen shall be as close to the CM as possible. Unshielded parts of wires shall be no longer than 10 cm.

### 5.3.4 CM Installation

The installation of the CM is carried out in the low voltage compartment of the switchboard. It must be separated from the high-voltage compartment.

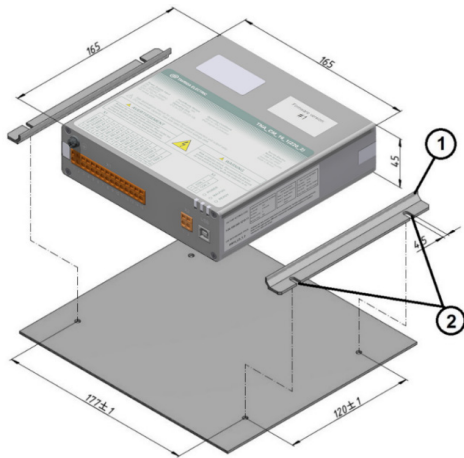

1. CM holders
2. Slots for CM mounting (by M4 screws)

Figure 38

#### **Provisions for CM<sub>16</sub> Installation**

With help of the CBmount\_CM\_1 the CM can be mounted on DIN rail in the low voltage compartment of the Switchgear. There are two variants of the CM installation available.

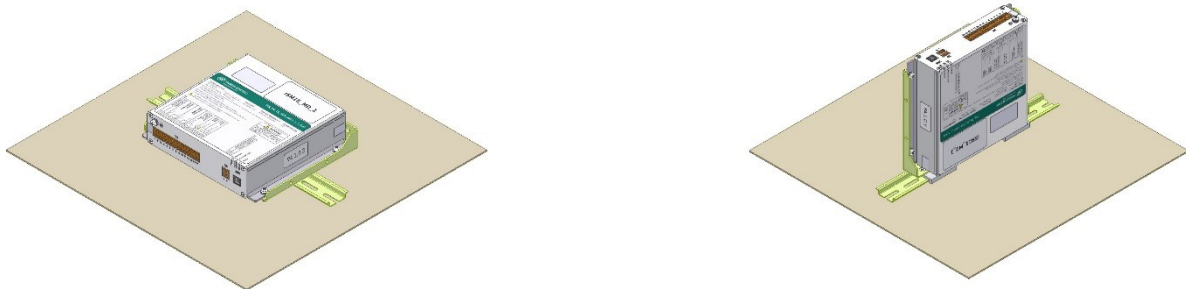


Figure 39

#### **Variants of the CM Installation on the DIN Rail**

The CM can operate in any mounting position. Care must be taken for good access and visibility of the terminals and LEDs.

Wires are connected to the CM terminals by using a screwdriver (Figure 13). The terminals can accept solid and stranded wire within the range 0.5-2.5 mm (14 - 18 AWG). Use copper conductors only. All wires insulation must be rated 600V or better. The insulation stripping length shall be 6-10 mm. Insulated auxiliary circuits shall provide 2 kV power frequency dielectric strength. Only ring type cable lug or similar should be used for CM16 earthing point connection.

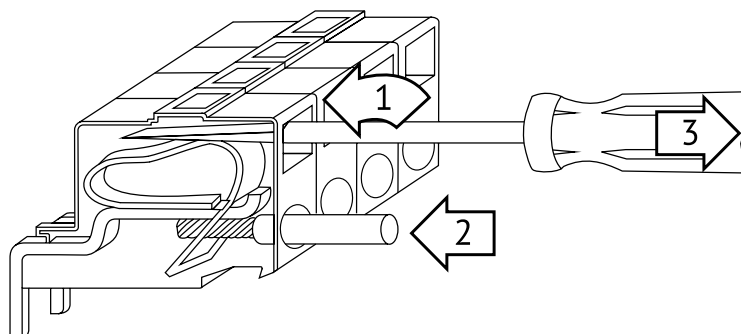


Figure 40

#### **Installation to CM Terminals**

### 5.3.5 CM Secondary Connections

The CM\_16\_1 secondary connections are shown below.

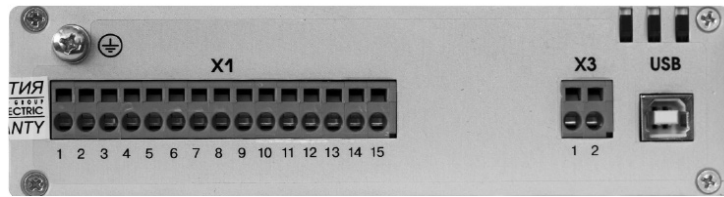


Figure 41  
**Terminal Arrangement of the CM**

**Table 15 - CM Terminal Arrangement**

XT1		XT3	
Terminal No.	Connection	Terminal No.	Connection
1	Power supply input (+)	1	Actuator coil output
2	Power supply input (-)	2	Actuator coil output
3	Relay output 1 NO		
4	Relay output 1 Com		
5	Relay output 1 NC		
6	Relay output 2 NO		
7	Relay output 2 Com		
8	Relay output 2 NC		
9	Relay output 3 NO		
10	Relay output 3 Com		
11	Relay output 3 NC		
12	Close input		
13	Close input		
14	Trip input		
15	Trip input		

CM relay functionality:

- Relay 1 – “ISM main contact position” relay
- Relay 2 – “Ready” relay
- Relay 3 – “Malfunction or Loss of auxiliary supply” relay

The “ISM main contact position” relay keeps its state (1 NO and 1 NC contacts with common point) after the CM power supply disconnection.

The relay’s functionality and the number of relays with the same functionality can be changed upon request. Please contact the nearest Tavrida Electric sales representative for more information.

The CM is connected only to the ISM actuator coil circuits. The position of the ISM main contacts is determined by detecting the ISM coil inductance level. The CM “ISM main contact position” relay indicates the result.

### 5.3.6 Auxiliary Supply

The connection of CM\_16\_1 to the power supply is shown below.

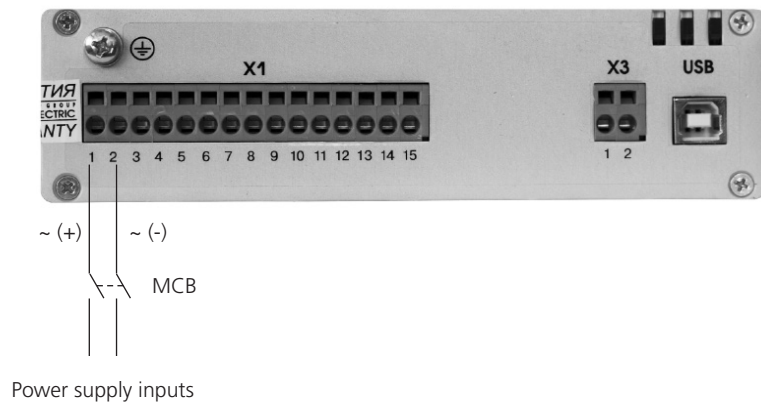


Figure 42  
**CM\_16 Power Supply Connection**

The type of MCB shall be selected according to the CM consumption data provided in Chapter 1.

Pay special attention to the correct polarity for the low-voltage version of the CM (CM\_16\_1(Par1\_60.1\_Par3\_Par4\_Par5)).

## 5.4 Operation

### 5.4.1 VCB Racking In and Out of the Switchgear

To change the VCB position from test to service and vice versa, the DOU plate is equipped with a racking mechanism. To operate it, a handle is used. VCB movement is provided by handle rotation in a clockwise direction for moving to service position and a counterclockwise direction for moving to test position.

Movement is available while the ISM is open.

3 main provisions of the DOU:

1. Test Position - Completely Draw Out;
2. Intermediate Position - Between Test and Service Position;
3. Service Position - Completely Draw In.

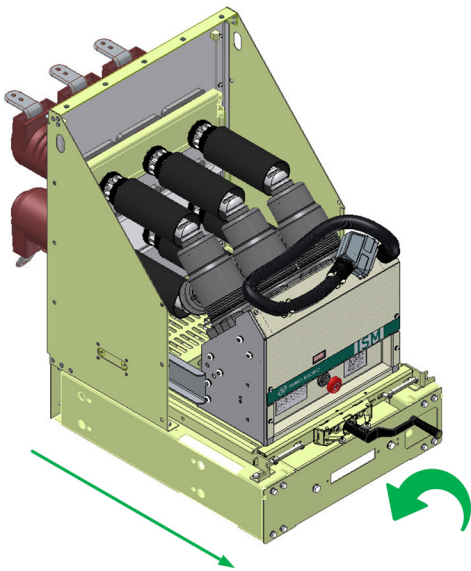


Figure 43  
**VCB in Test Position**

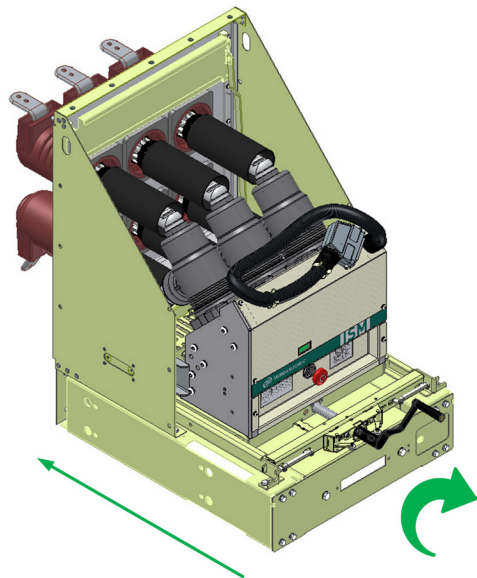


Figure 44  
**VCB in Intermediate Position**

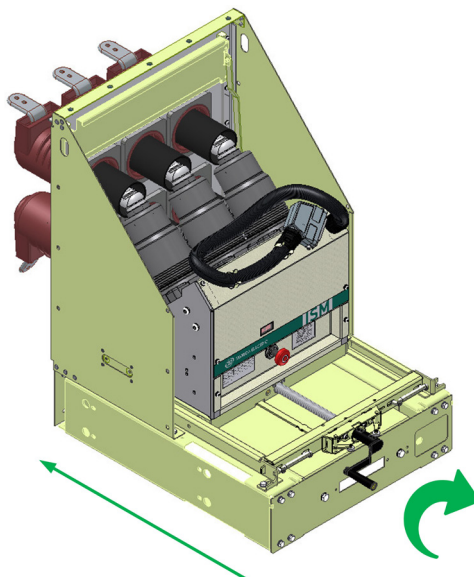


Figure 45  
**VCB in Service Position**

## 5.4.2 ISM Closing

To close the ISM main contacts, the CM close command should be applied. It is a “dry contact” input; no external voltage is required.

The close command will be accepted in the following cases:

- The CM state is “Ready” (Ready LED flashes green).
- No Trip command is applied.
- Mechanical and electrical interlock is unlocked.

If the “Close” command is applied and held before the CM is in a “Ready” state, the Close command will not be accepted.

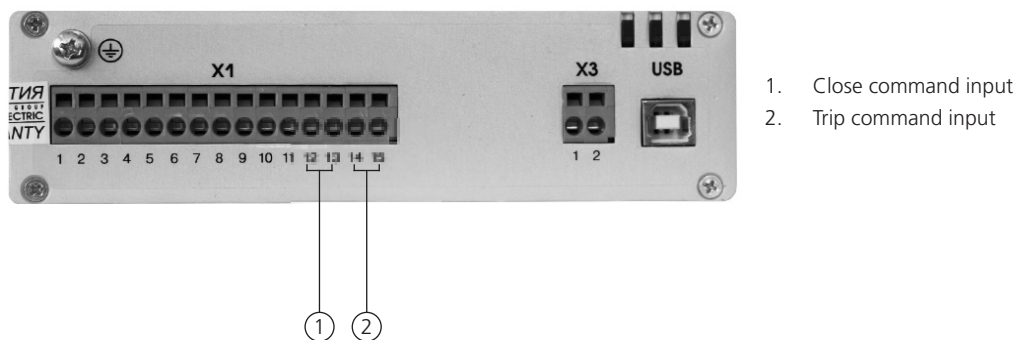


Figure 46

**CM\_16\_1 Close and Trip Inputs**

## 5.4.3 ISM Opening

To open the ISM main circuits, a trip command should be applied to the CM trip command input. It is a “dry contact” input, so no external voltage should be applied.

The trip command will be accepted if CM state is “Ready” (Ready LED flashes green), even up to 60 seconds after a loss of auxiliary power supply.

If the trip command is applied and kept before the CM is in a “Ready” state, the trip command will be accepted after the CM is in a “Ready” state. Holding the “Trip” command will block the “Close” command execution.

## 5.4.4 ISM Emergency Opening

The ISM can also be opened manually. To open the ISM manually, apply force to the manual trip button. See Figure 51 below.

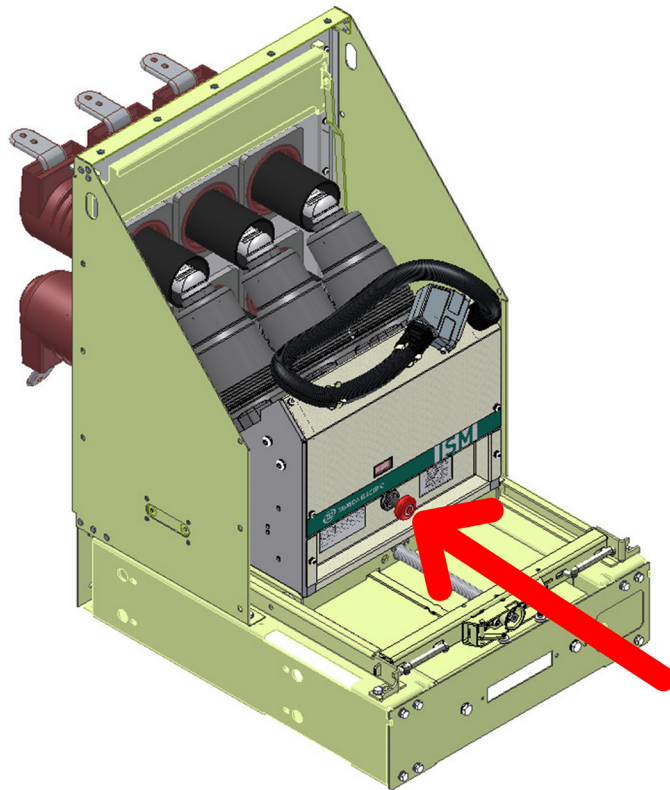


Figure 47  
**ISM Manual Trip Execution**

The button moves the ISM synchronization plate. When the synchronizing plate is moved, a force exceeding the magnetic attraction forces of the ring magnet is applied to the ISM armature, which subsequently starts to move. As the air gap increases, the opening springs and the contact pressure springs exceed the magnetic holding force and the vacuum interrupter opens.



## 6. Functionality

# 6.1 Interlocks

The VCB provides all the interlocks required to provide high level of safety and reliability during installation, commissioning and operation.

Standard safety interlocks included:

- The draw-out unit can only be moved in case the ISM is open and locked against closing.
- The ISM can only be unlocked and operated in case the draw-out unit is exactly in the test or service position.
- The interlocks can only be unlocked and operated if the draw-out unit is in the test or service position.

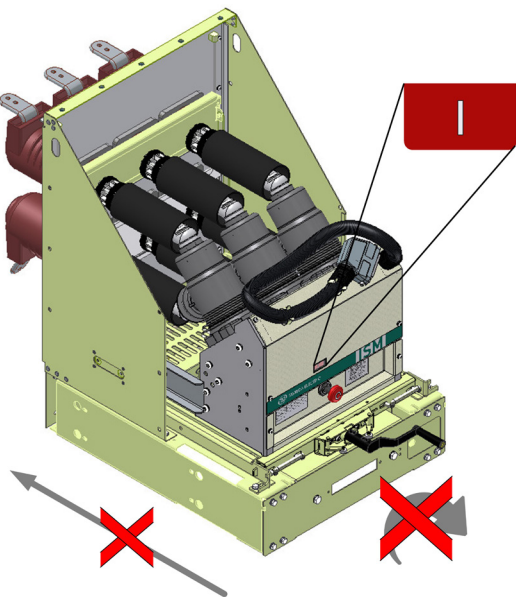


Figure 48  
**Draw-Out Unit is in the Test Position.**  
**The DOU Cannot Be Moved While the ISM is Closed.**

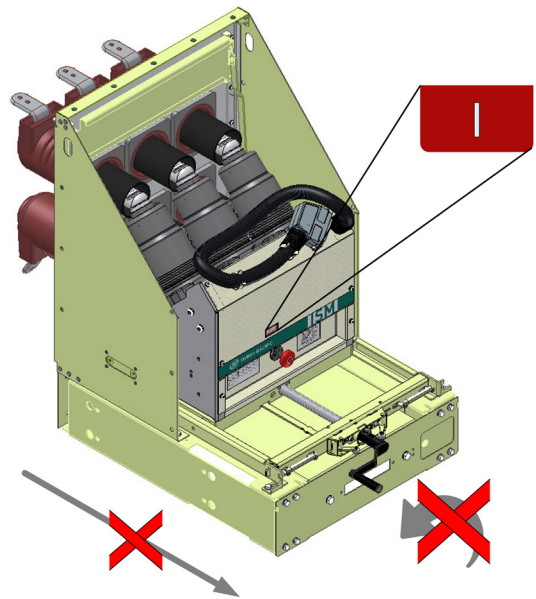


Figure 50  
**Draw-Out Unit is in the Service Position.**  
**The DOU Cannot Be Moved While the ISM is Closed.**

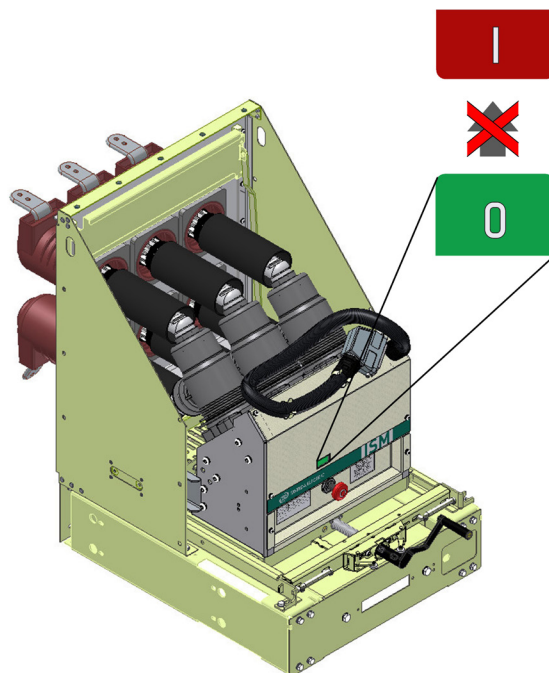


Figure 49  
**The ISM Cannot Be Closed While the DOU is in The Intermediate Position**

Interlocks related to the draw-out unit located inside the switchgear:

- The draw-out unit can only be moved when the earthing switch is open.
- The earthing switch can only be closed when the draw-out unit is in the test position.
- The draw-out unit can only be moved to the service position when the switchgear circuit breaker's compartment door is closed.
- The draw-out unit can only be removed from the switchgear when the draw-out unit is in the test position.

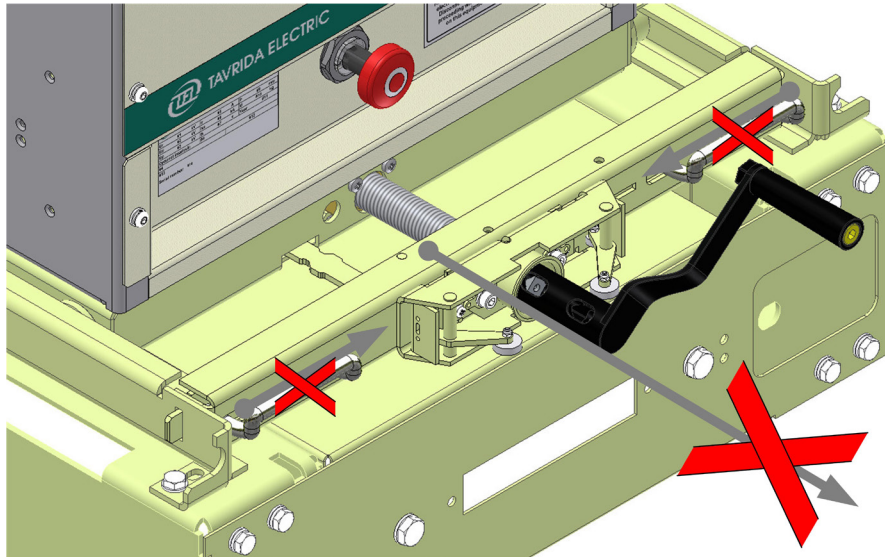


Figure 51

***The DOU Cannot Be Removed from the Switchgear When the DOU is Not in the Test Position.***


## 6.2 CM Indication

The VCB has the following indication functionality:

- indication provided by the DOU plate:
  - DOU plate position – DOU plate auxiliary switches (5 NO+5 NC switches).
- indication provided by the ISM:
  - ISM main contacts position (visual indication);
  - ISM main contacts position (electrical indication) – ISM auxiliary switches (6 NO+6 NC switches).
- indication provided by the CM (not in the Scope of Supply):
  - ISM main contacts position (electrical indication) – one <sup>1)</sup> built-in CM relay (1 NO + 1 NC with common point);
  - CM "Power" indication – LED indicator;
  - CM "Ready" state indication – LED indicator and one built in CM relay (1 NO + 1 NC with common point);
  - CM "Malfunction" state indication – LED indicator and one built-in CM relay (1 NO + 1 NC with common point).

Technical data for the ISM and the DOU plate auxiliary switches load and built-in and CM relays is provided in Chapter 4. Technical Parameters.

1) The number of CM relays indicating ISM main circuits position can be increased for certain applications, please contact your nearest sales representative for details.

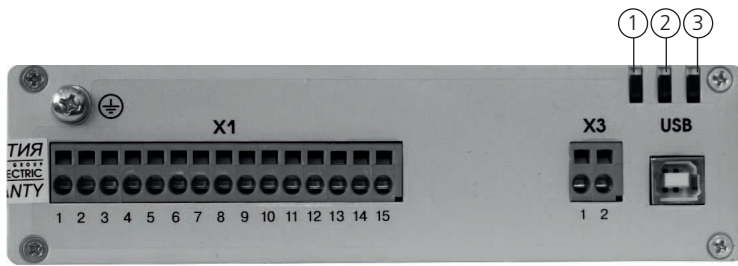

1. "Power" LED indicator
2. "Malfunction" LED indicator
3. "Ready" LED indicator

Figure 52

**CM\_16 LED Indicators**

The self-diagnostic system inside the CM detects possible malfunctions and reports them via the Malfunction LED blink signals and "Malfunction or Loss of auxiliary supply" relay state. Detailed explanations of the blink codes are provided in the Table 16.

**Table 16 - CM Self-Diagnostic Indication**

CM State	Type of Indication	Indication				
		LED Power	LED Ready	LED Malfunction	Relay Ready	Relay Malfunction or Loss of auxiliary supply
Power supply voltage is absent more than 3 minutes	Warning and Loss of auxiliary supply	off	off	off	O	C
"Close" operation is preparing	Normal	continuous	off	off	O	O
CM is ready and operable	Normal	continuous	continuous	off	C	O
Power supply voltage is absent for more than 1.5 seconds	Warning and Loss of auxiliary supply	off	continuous	1 blink	C	C
Excessive trip or close time	Malfunction	continuous	off	2 blinks	O	C
Actuator coil isolated	Malfunction	continuous	off	3 blinks	O	C
Short circuit of Actuator coil	Malfunction	continuous	off	4 blinks	O	C
Manual Trip and Lock	Warning	continuous	off	5 blinks	O	O
Out of temperature range	Warning	continuous	off	6 blinks	O	O
ISM state is open without command from the CM	Malfunction	continuous	off	7 blinks	O	C
Internal fault of the CM	Malfunction	continuous	off	continuous	O	C

The following information is provided in Table 16:

1. The number of blinks in a series followed by 1.5 s intervals, continuous light or off state are shown for the LED indicators.
2. State of relay contact groups (C – closed, O – opened) is indicated for the NC Ready Relay and the Malfunction or Loss of Auxiliary Supply relay.
3. Period of checking the actuator coil state (short-circuit / isolated) – 10 s.

Priority of the fault indication (from highest to lowest priority):

1. CM is out of temperature range
2. The ISM state is open without a command from the CM
3. Excessive trip or close time

4. Manual trip and lock
5. Short-circuit of actuator coil
6. Actuator coil isolated
7. Power supply voltage is absent more than 1.5 seconds

The CM performs the checkup of ISM main contacts position and updates the “ISM Main Contacts Position” relay status in the following cases:

- If the Close command was applied from the CM. In this case, the update is performed within 150 ms after the ISM main contacts closing.
- If the Trip command was applied from the CM. In this case the update is performed not later than in 70 ms after ISM main contacts opening.
- Periodically every 10 s if no Close or Open command was applied from the CM.

If the application project requires you to define the main contacts position faster than the timing mentioned above, please use the auxiliary switches installed in the ISM.

## 6.2.1 CM Relay Contacts Operation

The relay contacts of CM\_16\_1 change their state as described below.

**Table 17 - CM Relay “Ready” Contacts Operation**

CM State	Relay “Ready” Contacts State	
	NC (terminals 7-8 by default)	NO (terminals 6-7 by default)
CM is ready for close or open operation	Open	Closed
CM is not ready for close or open operation	Closed	Open

**Table 18 - CM Relay “ISM Main Contact Position” Contacts Operation**

ISM State	Relay “ISM Main Contact Position” Contacts State	
	NC (terminals 4-5 by default)	NO (terminals 3-4 by default)
ISM is closed	Open	Closed
ISM is open	Closed	Open

The CM performs the checkup of the ISM main contacts position and updates the “ISM main contacts position” relay status in the following cases:

- If the close command was applied from the CM. In this case, the update is performed not later than in 150 ms after the ISM main contacts closing;
- In case Trip command was applied from the CM. In this case the update is performed not later than in 70 ms after ISM main contacts opening;
- Periodically every 10 s if no close or open command was applied from the CM.

If the application project requires you to define the main contacts position faster than the timing mentioned above, it is recommended to use auxiliary switches installed at the ISM. The position indication of ISM provided by CM can be incorrect if the CM is not operable due to an absence of auxiliary supply.

**Table 19 - CM Relay “Malfunction or Loss of Auxiliary Supply” Contacts Operation**

CM State	Relay “Malfunction or Loss of Auxiliary Supply” Contacts State	
	NC	NO
Power supply voltage is absent for more than 1.5 seconds (1 blink of LED Malfunction)	Open	Closed
Excessive trip or close time (2 blinks of LED Malfunction)	Open	Closed
Actuator coil isolated (3 blinks of LED Malfunction)	Open	Closed
Short circuit of Actuator coil (4 blinks of LED Malfunction)	Open	Closed
Manual Trip and Lock (5 blinks of LED Malfunction)	Closed	Open
Out of temperature range (6 blinks of LED Malfunction)	Closed	Open
ISM state is open without command from the CM (7 blinks of LED Malfunction)	Open	Closed
Internal fault of CM (continuous light of LED Malfunction)	Open	Closed

# 7. Commissioning

The list of commissioning operations and checks is shown in Table 20 below. Initial state of VCB components before checks: ISM – open, CM – deenergized. Main circuits of VCB shall be disconnected/isolated from the main circuits of substation to avoid high-voltage being applied to the VCB before the commissioning procedure completion. Commissioning and maintenance should only be performed by qualified and trained personnel.

**Table 20 - List of Commissioning Operations and Check-Ups**

Operation Description	Required Tool	Approximate Timing
<b>Tests at the end of installation</b>		
Check for damage, remove any dirt, contamination or moisture <sup>1)</sup>	Visual check, no tool is required	2 minutes
Protective earthing shall be according to subchapter 4.1.1	Visual check, no tool is required	1 minute
Check actual dimensions of the fixed contacts installed in the Switchgear according to subchapter 4.1.2	Ruler	2 minutes
Insert withdrawable VCB in the switchgear panel and check that the DOU plate of the ISM can be properly fixed in the panel according to Figure 52	Visual check, no tool is required	2 minutes
Installation of CM shall be according to subchapter 4.2.4	Visual check, no tool is required	1 minute
Availability of the CM auxiliary power supply. It is recommended to use the same auxiliary power supply as for protection and control devices. Type of voltage and voltage level should be according to selected CM type	Voltmeter with measurement range according to expected power supply voltage value	2 minutes
The polarity of auxiliary power supply and selection of MCB shall be according to subchapter 4.2.5. Check for compliance between ISM type on VCB electrical data label and on CM designation label	DC voltmeter with measurement range according to expected power supply voltage value – for voltage polarity check. Visual check, no tool is required – for MCB check	2 minutes
The connection between the auxiliary circuits connector counterpart and CM shall be according to subchapters 4.2.1, 4.2.3, 4.2.4 and to the circuit diagrams in Appendix 3: Secondary schemes	Multimeter – for validation of correct wiring connections (utilizing the continuity function of the meter)	5 minutes
Check that all secondary connections have been secured adequately and that the VCB auxiliary circuits connector and its counterpart are properly connected	Visual and mechanical check of connections, no tool is required	1 minute
Turn on the CM auxiliary power supply, then check the following: <ul style="list-style-type: none"> <li>• The “Power” LED must light up immediately.</li> <li>• The “Ready” LED must light up continuously within 15 s after switching on.</li> <li>• The “Malfunction” LED must not light up.</li> <li>• The “Ready” relay contact must close within 15 s.</li> <li>• The “Malfunction or Loss of auxiliary supply” relay contact must change its state <sup>2)</sup>.</li> <li>• The “ISM main contact position” relay contact must not change its state.</li> <li>• ISM main contacts must not change their state (ISM shall remain open).</li> </ul>	Visual check, no tool is required	1 minute

1) Including the check of fixed contacts and bushings in the switchgear panel where these contacts are installed.

2) As mentioned earlier, after CM power supply disconnection this relay indicated the CM state: “Power supply voltage is absent for more than 1.5 seconds”.



Table 20 - List of Commissioning Operations and Check-Ups

Operation Description	Required Tool	Approximate Timing
<b>Tests at the end of installation</b>		
Apply the close command to the CM, then check the following: <ul style="list-style-type: none"> <li>• The "Power" LED must light up continuously.</li> <li>• The "Ready" LED must light up continuously.</li> <li>• The "Malfunction" LED must not light up.</li> <li>• The "Ready" relay contact must not change its state.</li> <li>• The "Malfunction or Loss of Auxiliary Supply" relay contact must not change its state.</li> <li>• The "ISM main contact position" relay contact must change its state.</li> <li>• ISM main contacts must change their state (ISM shall be closed).</li> </ul>	Visual check, no tool is required	1 minute
Apply the trip command to the CM, then check the following: <ul style="list-style-type: none"> <li>• The "Power" LED must light up continuously.</li> <li>• The "Ready" LED must light up continuously.</li> <li>• The "Malfunction" LED must not light up.</li> <li>• The "Ready" relay contact must not change its state.</li> <li>• The "Malfunction of Loss of auxiliary supply" relay contact must not change its state.</li> <li>• The "ISM main contact position" relay contact must change its state.</li> <li>• VCB main contacts must change their state (ISM shall be open).</li> </ul>	Visual check, no tool is required	1 minute
Do not remove trip command and apply close command to the CM, then check the following: <ul style="list-style-type: none"> <li>• The "Power" LED must light continuously.</li> <li>• The "Ready" LED must light continuously.</li> <li>• The "Malfunction" LED must not light up.</li> <li>• The "Ready" relay contact must not change its state.</li> <li>• The "Malfunction or Loss of auxiliary supply" relay contact must not change its state.</li> <li>• The "ISM main contact position" relay contact must not change its state.</li> <li>• VCB main contacts must not change their state (ISM shall remain open).</li> </ul>	Visual check, no tool is required	1 minute
Remove close and trip commands to the CM then check the following: <ul style="list-style-type: none"> <li>• The "Power" LED must light up continuously.</li> <li>• The "Ready" LED must light up continuously.</li> <li>• The "Malfunction" LED must not light up.</li> <li>• The "Ready" relay contact must not change its state.</li> <li>• The "Malfunction or Loss of auxiliary supply" relay contact must not change its state.</li> <li>• The "ISM main contact position" relay must not change its state.</li> <li>• VCB main contacts must not change their state (ISM shall remain open).</li> </ul>	Visual check, no tool is required	1 minute

**Table 20 - List of Commissioning Operations and Check-Ups**

Operation Description	Required Tool	Approximate Timing
<b>Tests at the end of installation</b>		
Apply and keep the close command and then apply the trip command to the CM, then check the following: <ul style="list-style-type: none"> <li>The "Power" LED must light up continuously.</li> <li>The "Ready" LED must go out after the trip of the ISM and then light up continuously within 10 s.</li> <li>The "Malfunction" LED must not light up.</li> <li>The "Ready" relay contact must change its state after the trip of the ISM and then change its state again within 10 s.</li> <li>The "Malfunction or Loss of Auxiliary Supply" relay contact must not change its state.</li> <li>The "ISM main contact position" relay contact must change its state each time when ISM is closed and open.</li> <li>VCB main contacts must change their state each time the ISM is closed and opened.</li> </ul>	Visual check, no tool is required	1 minute
Close ISM and try to rack VCB in the switchgear panel according to the Figure 53. It shall be impossible to rack the VCB in the panel.	Visual check, no tool is required	1 minute
Open ISM and try to rack VCB in the switchgear panel according to the Figure 54. by making one turn of the DOU plate operation lever. It shall be possible to rack the VCB in the panel.	Visual check, no tool is required	1 minute
Try to close ISM while the DOU plate in the intermediate position according to the Figure 55. It shall be impossible to close the ISM.	Visual check, no tool is required	1 minute
Rack out the DOU plate and close the ISM. Then trip the ISM mechanically by manual trip button according to the Figure 56. The VCB main contacts must change their state each time the ISM is closed and opened.	Visual check, no tool is required	1 minute
<b>Primary Circuits Insulation Check <sup>3)</sup></b>		
Remove withdrawable VCB from the switchgear panel <sup>4)</sup> .	-	2 minutes
Observe safety precautions listed in the danger and warning advisories. Construct proper barriers and warning light systems <sup>5)</sup> .	Equipment to provide safety in the test area	10 minutes
Ground each pole of VCB that is not being tested <sup>6)</sup>	Wires	2 minutes
Apply slowly rising 100% <sup>7)</sup> of test voltage <sup>8)</sup> (50 or 60 Hz) across each pole for one minute <sup>9)</sup> . (ISM is open).	Power frequency withstand voltage test set	2 minutes

3) This test includes not only the vacuum interrupter test, but also the other insulation components tested in parallel with the interrupter. These include the standoff insulators and the insulated drive links, as well as the insulating (tension) struts between the upper and lower vacuum interrupter supports. If these insulation components are contaminated or defective, the test voltage will not be sustained. If so, clean or replace the affected components, and retest.

4) In cases where the VCB is tested separately from the switchgear panel.

5) The insulation barriers shall be also installed between the movable contacts of the withdrawable VCB to prevent the discharges appearance in this area for cases where the VCB is tested separately from the switchgear panel.

6) The VCB should be tested phase by phase only. Therefore, poles not under test should be grounded.

7) For test of separate VCB - 100% level of test voltage, for test of Switchgear with installed VCB - 80% level of test voltage in accordance with IEC 62271-200.

8) Rated test voltage levels (Ud) are given in Table 10.

9) To apply the test voltage, single-core short cables should be used. The application of high-voltage coaxial cables is strictly prohibited. To coordinate the surge impedance between the test set and ISM extra resistor (as shown in Figure 57) shall be used.

Table 20 - List of Commissioning Operations and Check-Ups

Operation Description	Required Tool	Approximate Timing
<b>Tests at the end of installation</b>		
If the pole sustains the test voltage for that period, its vacuum integrity has been verified <sup>10)</sup> .	Power frequency withstand voltage test set	-
Repeat actions above to check each pole of VCB.	Power frequency withstand voltage test set	8 minutes
Close the ISM. Ground each pole of VCB that is not under test <sup>6)</sup> .	Wires	1 minute
Apply slowly rising 100% <sup>7)</sup> of test voltage <sup>8)</sup> (50 or 60 Hz) between a primary conductor of the pole and ground for one minute, repeat test for each pole of VCB	Power frequency withstand voltage test set	12 minutes
If no disruptive discharge occurs, the insulation system is satisfactory.	Power frequency withstand voltage test set	-
After the test, ground all main circuit terminals to dissipate any static charge.	Wires	2 minutes
<b>Auxiliary Circuits Insulation Check</b>		
Connect all points of the withdrawable VCB secondary circuits with a shorting wire <sup>11)</sup> . VCB shall not be connected to the CM before the test.	Wires	5 minutes
Connect the shorting wire to the high potential lead of the high-voltage tester and ground the circuit breaker housing. Starting with zero volts, gradually increase the test voltage to 2000 V RMS, 50 or 60 Hz. Maintain test voltage for one minute.	Power frequency withstand voltage test set	3 minutes
If no disruptive discharge occurs, the secondary circuits insulation level is satisfactory.	Power frequency withstand voltage test set	-
Disconnect the shorting wire.	Visual check, no tool is required	2 minutes
<b>Primary Circuits Contact Resistance Check</b>		
ISM shall be closed before the test. There should not be any external circuits connected to VCB main terminals that provide parallel circuit with the VCB main circuits otherwise tests will be invalid.	Visual check, no tool is required	1 minute
Test equipment shall be connected to VCB main circuits terminals according to Figure 58 to exclude any additional contact resistance and to decrease measurement error. Main contact resistance shall be measured by appropriate equipment at test current not less than 50 A.	Resistance measurement test equipment with test current not less than 50 A	10 minutes
Measured values must not exceed limits specified in Table 1.	Visual check, no tool is required	-

10) During testing of vacuum interrupter, self-fading restrikes may appear. In case of restrikes, reduce the voltage slightly until the restrikes disappear (for 10-15 seconds) and then increase again.

11) The VCB auxiliary circuits connector counterpart may be used for this.

After these tests have been performed successfully, the VCB can be put into operation.

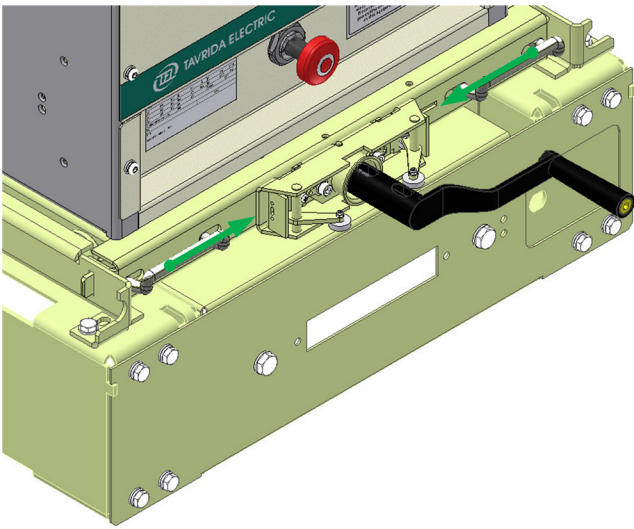


Figure 53  
**Checkup of the Withdrawable VCB Fixing lin the Switchgear Panel**

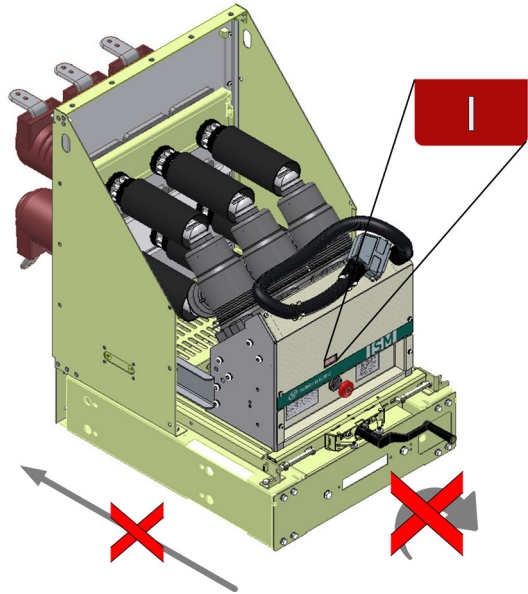


Figure 54  
**The DOU Cannot Be Moved While the ISM is Closed**

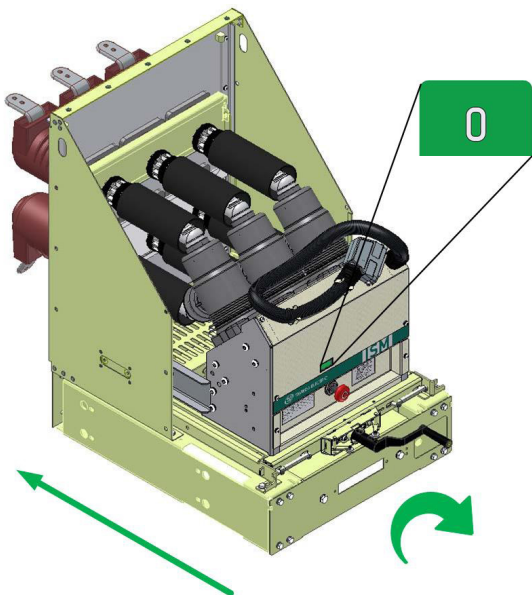


Figure 55  
**The DOU Plate Can Be Racked in While ISM is Open**

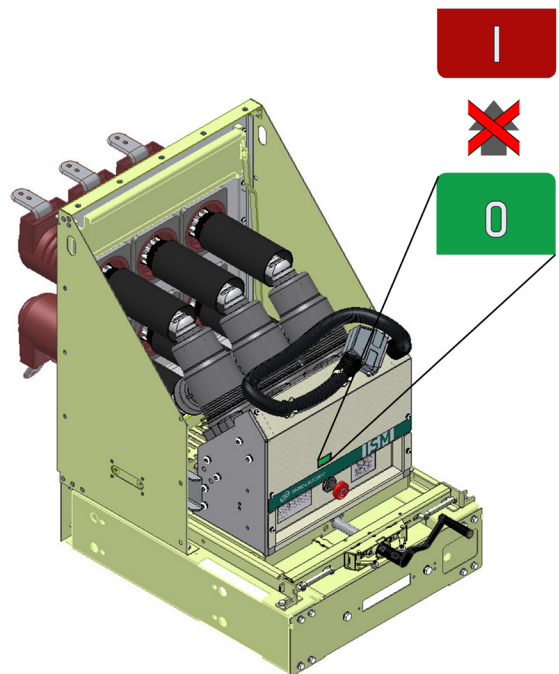


Figure 56  
**The ISM Cannot Be Closed While DOU in the Intermediate Position**

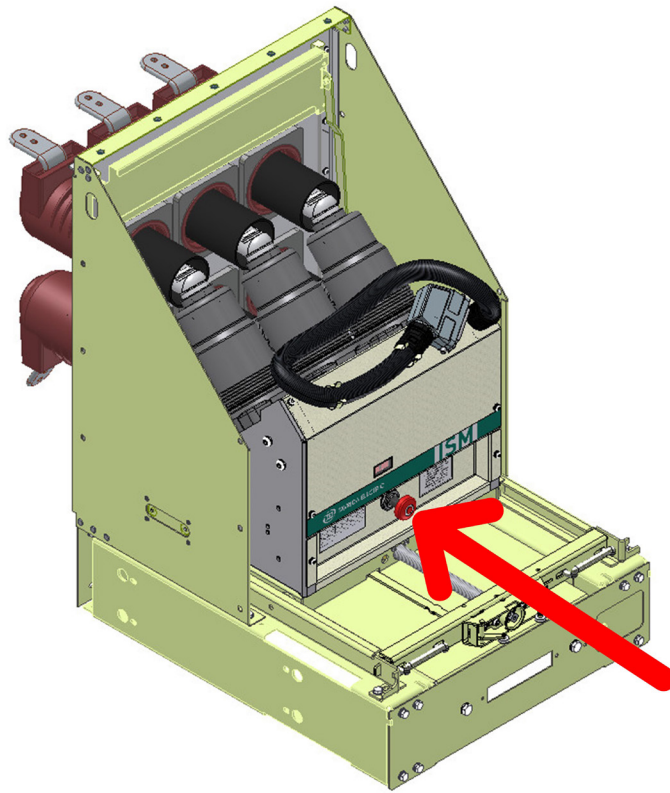


Figure 57  
*The ISM Manual Trip Execution*



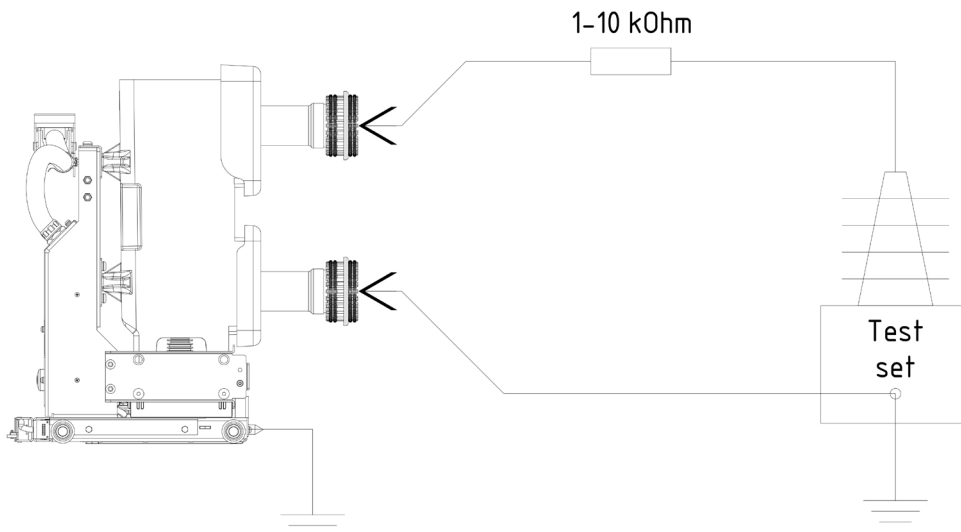


Figure 58  
*The Vacuum Integrity and Solid Insulation Test Installation*

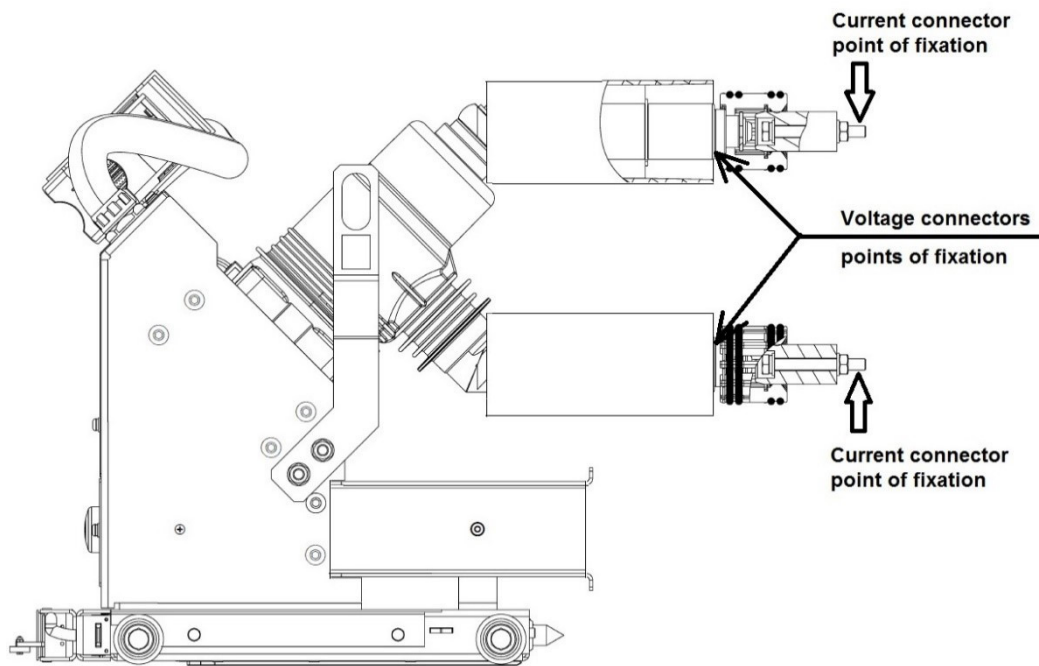

a) VCB15\_MD1\_16D

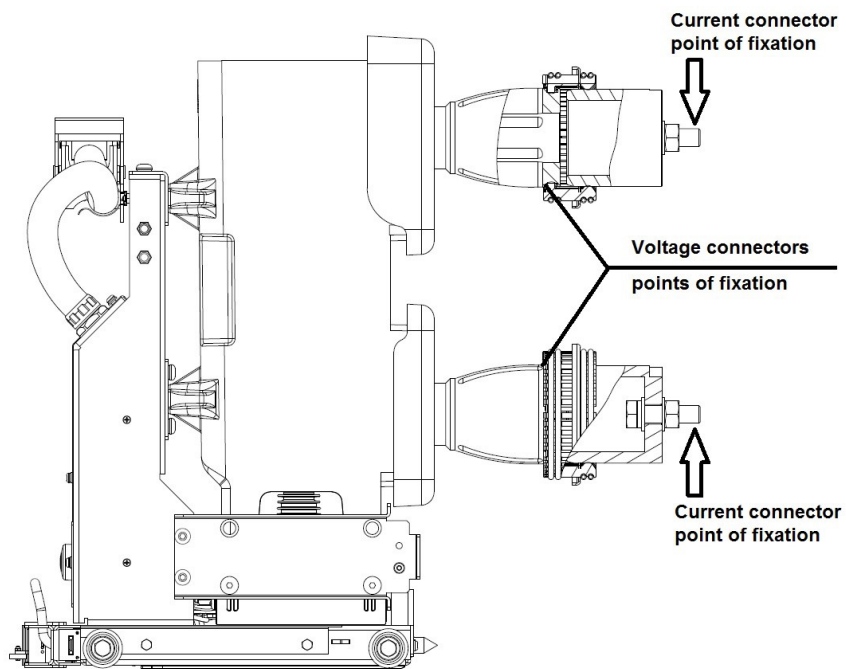

b) VCB15\_HD1\_16D

Figure 59  
**The Connection Points of the Contact Resistance Meter**

Note:

To conveniently attach the current connectors and to prevent damage to the fixed contacts surface, please insert bolts (used for the contacts attachment in the switchgear panel) in the fixed contacts and screw them tightly with nuts. Then use these bolts as points to attach the current connectors.

# 8. Maintenance and Troubleshooting



## 8.1 Primary Circuits

Under normal operating conditions (see Table 10), the ISM is maintenance-free until it has reached the permissible number of operating cycles.

However, when maintenance is carried out on the complete switchgear, the commissioning tests should be repeated. Check that the VCB is disconnected from all voltage sources before inspecting its insulating parts. The withdrawable VCB should be inspected at least once every 5 years. More frequent inspections (up to one time per six months) are recommended when the VCB works in unfavorable conditions such as dust and moisture. Test results should be treated as given in Table 21.

**Table 21 - List of Tests and Check-Ups of the Withdrawable ISM During Maintenance**

Operation Description	Required Tool	Approximate Timing
Check for damage, remove any dirt, contamination or moisture.	Dry napless cloth or a napless cloth soaked in alcohol to clean the insulation	5 minutes
Check the moveable contacts condition – absence of any main contacts overheating tracks and damages of silver coating should be ascertained.	Visual check, no tool is required	1 minute
<b>ISM Operation Check</b>		
Perform close and open operation of the ISM. Modules shall be operable, VCB contacts position indicator shall properly work. Otherwise, check the control circuit.	Visual check, no tool is required	1 minute
Perform interlocks check. Interlocks shall work properly.	Visual check, no tool is required	5 minutes
<b>Primary Circuits Insulation Check <sup>1)</sup></b>		
Observe safety precautions listed in the danger and warning advisories. Construct the proper barrier and warning light system <sup>2)</sup> .	Equipment to provide safety in test area	10 minutes
Ground each pole which is not under test	Wires	2 minutes
Apply slowly rising 100% <sup>3)</sup> of test voltage <sup>4)</sup> (50 or 60 Hz) across each pole for one minute <sup>5)</sup> . (ISM is open.)	Power frequency withstand voltage test set	2 minutes
If the pole sustains the test voltage for that period, its vacuum integrity has been verified <sup>6)</sup> .	Power frequency withstand voltage test set	-

- 1) This test includes not only the vacuum interrupter test, but also the other insulation components tested in parallel with the interrupter. These include the support insulators and the insulated drive links, as well as the insulating (tension) struts between the upper and lower vacuum interrupter supports. If these insulation components are contaminated or defective, the test voltage will not be sustained. If so, clean or replace the affected components and retest.
- 2) The insulation barriers shall be also installed between the movable contacts of the withdrawable VCB to prevent the discharges appearance in this area - in cases where the VCB is tested separately from the switchgear panel.
- 3) For test of separate VCB - 100% level of test voltage, for test of switchgear with installed VCB - 80% level of test voltage according to IEC 62271-200.
- 4) Rated test voltage levels (Ud) are given in Table 10 above.
- 5) To apply test voltage, the single-core short cables should be used. Application of high-voltage coaxial cables is strictly prohibited. To coordinate the surge impedance between the test set and the VCB, the extra resistor (as shown in Figure 58) shall be used.
- 6) During testing of vacuum interrupter, self-fading restrikes may appear. In case of restrikes, reduce the voltage slightly until the restrikes disappear (for 10-15 seconds) and then increase again.



**Table 21 - List of Tests and Check-Ups of the Withdrawable ISM During Maintenance**

Operation Description	Required Tool	Approximate Timing
Repeat actions above to check each pole of the VCB.	Power frequency withstand voltage test set	8 minutes
Close the ISM. Ground each pole not under test.	Wires	1 minute
Apply slowly rising 80% of test voltage <sup>3)</sup> (50 or 60 Hz) between a primary conductor of the pole and ground for one minute, repeat test for each pole of VCB.	Power frequency withstand voltage test set	12 minutes
If no disruptive discharge occurs, the insulation system is satisfactory	Power frequency withstand voltage test set	-
After the test, ground all main circuit terminals to dissipate any static charge.	Wires	2 minutes
<b>Primary Circuits Contact Resistance Check <sup>7)</sup></b>		
ISM shall be closed before the test. There should not be any external circuits connected to VCB main terminals that provide parallel circuit with the VCB main circuits, otherwise the tests will be invalid.	Visual check, no tool is required	1 minute
Test equipment shall be connected to VCB main circuits terminals according to Figure 58 to exclude any additional contact resistance and to decrease measurement error. Main contact resistance shall be measured by appropriate equipment at test current not less than 50 A.	Resistance measurement test equipment with test current not less than 50 A	10 minutes
Measured values must not exceed limits specified in Table 10.	Visual check, no tool is required	-

7) If the module has contact resistance which exceeds the specified limit but is less than twice this limit, continuation of use is possible, if actual continuous current does not exceed the following value:

$$I_a < I_r \sqrt{\frac{R_r}{R_a}}$$

where:

$I_a$ ,  $R_a$  — actual current and corresponding contact resistance,

$I_r$ ,  $R_r$  — rated values (Table 10).

If the contact resistance is at least twice as high as the specified limit, the VCB must be replaced.

Additionally, switchboards can be subjected to extra tests that are specified in corresponding documentation for the switchboards.

## DOU Plate Maintenance

Bearing points and sliding surfaces of DOU plate should be lubricated at least once per five years with a thin film of GE Lubricant D6A15A1 (MobilGrease 28, catalog number 193A1751P1). Clean the surfaces to be lubricated with an industry-approved solvent.

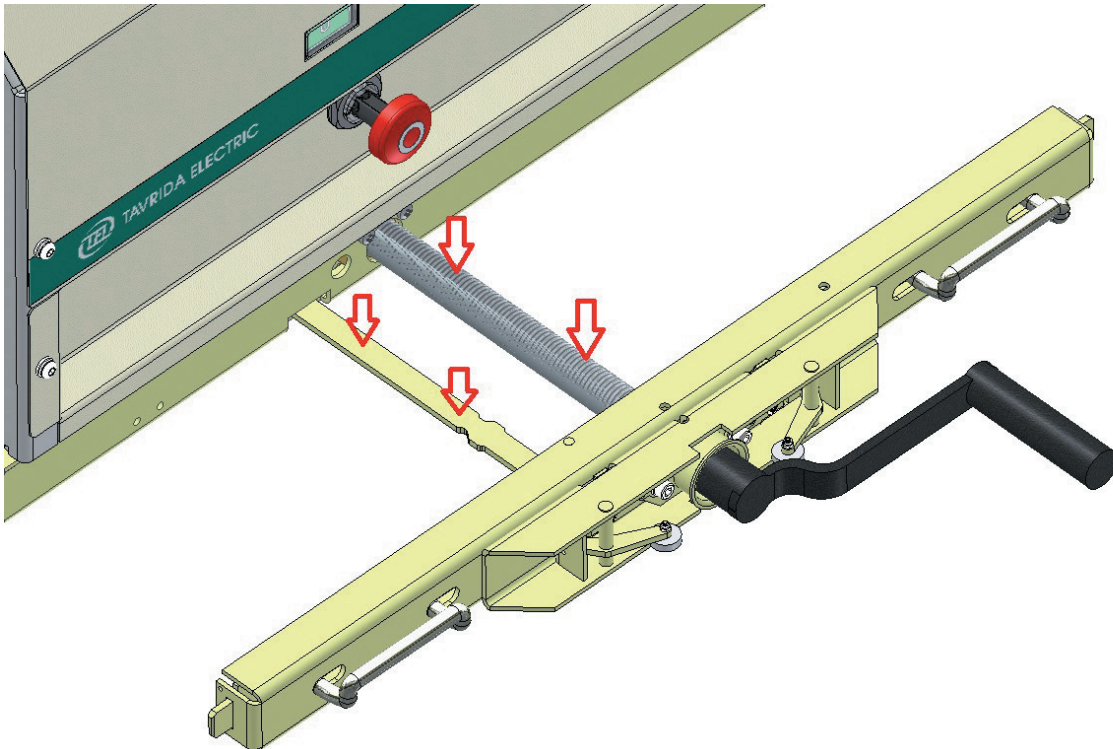
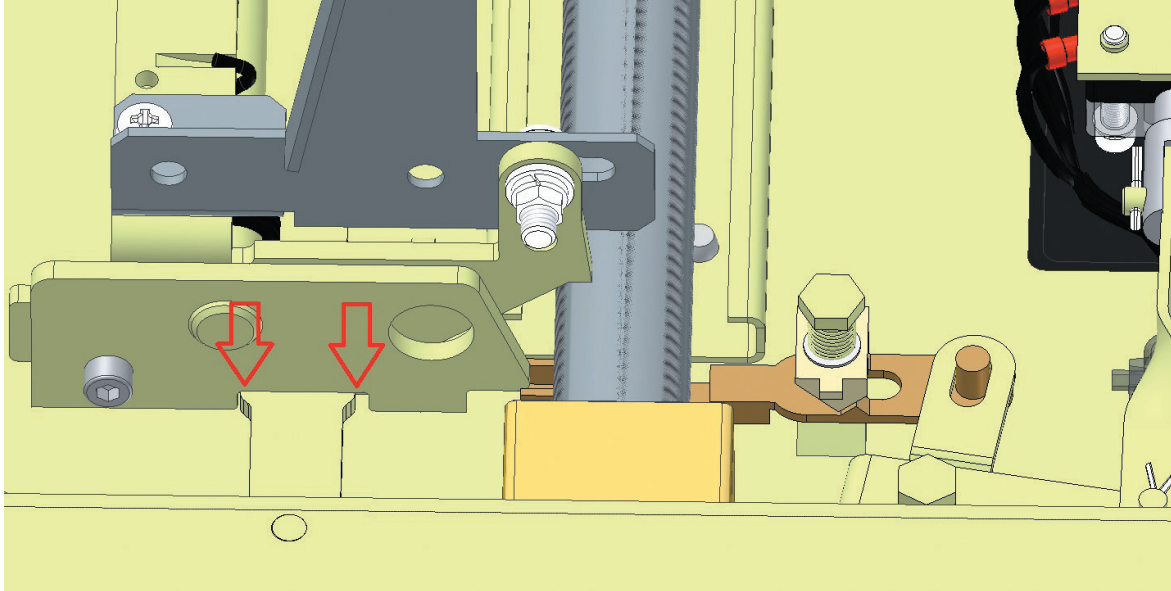


Figure 60  
*DOU plate lubricated surfaces*

Remove all excess lubricant with a clean, lint-free cloth to avoid the accumulation of dirt or dust. Do not lubricate the outside diameters of the DOU plate rollers.

## Main Contacts

The fixed contacts in the switchgear panel and the contact surfaces of the ISM movable contacts should be lubricated at least once per five years with a thin film of GE Lubricant D6A15A1 (MobilGrease 28, catalog number 193A1751P1). Clean the surfaces to be lubricated with an industry-approved solvent.

Remove all excess lubricant with a clean, lint-free cloth to avoid accumulation of dirt or dust.

## 8.2 Secondary Circuits

The CM is inherently maintenance-free. However when maintenance is carried out on the complete switchgear then commissioning tests should be repeated. It is also recommended to conduct regular visual checks of the module housing and insulation of the wires connected to the CM. Test results should be treated as given in the Table 22.

**Table 22 - List of Tests and Checkups of the CM During Maintenance**

Operation Description	Required Tool	Approximate Timing
<b>Auxiliary Circuits Insulation Check</b>		
Connect all points of the withdrawable VCB secondary circuits with a shorting wire. VCB shall be disconnected from the CM before the test.	Wires	5 minutes
Connect the shorting wire mentioned in previous clause to the high potential lead of the high-voltage tester and ground the circuit breaker housing. Starting with zero volts, gradually increase the test voltage to 1500 V RMS, 50 or 60 Hz. Maintain test voltage for one minute.	Power frequency withstand voltage test set	3 minutes
If no disruptive discharge occurs, the secondary circuits insulation level is satisfactory.	Power frequency withstand voltage test set	-
Disconnect the shorting wire.	Visual check, no tool is required	2 minutes

## 8.3 Troubleshooting

If during installation, commissioning, operation or maintenance any non-conformity occurs, contact your nearest Tavrida Electric sales representative. The contact data and web site links are listed at the end of this document. In case of non-conformity, any repairs are strictly prohibited without permission from the sales representative.

If you suspect a failure has occurred, perform the checks as mentioned in Table 23 prior to contacting our regional representative.

**Table 23 - Typical Failure Symptoms and Methods of Their Elimination**

Failure Description	Possible Reason	Method of Elimination
Appearance failure.	Mechanical or arc damage, breach of service conditions.	Replacement of failed component.
Excessive contact resistance of VCB.	VCB internal failure.	Replacement of VCB.
VCB cannot pass power frequency voltage withstand test at 80 % of rated voltage.	VCB internal failure.	Replacement of VCB.

**Table 23 - Typical Failure Symptoms and Methods of Their Elimination**

<b>Failure Description</b>	<b>Possible Reason</b>	<b>Method of Elimination</b>
ISM cannot perform close/trip operation.	ISM is interlocked.	Check VCB interlocks state and its actuator coil connection with connector CM.
	CM failure.	Check CM LED states.
	VCB internal failure.	Replacement of VCB.
1 blink of CM "Malfunction" LED.	Absence of CM power supply.	Check presence of CM power supply, its polarity and voltage level.
2 blinks of CM "Malfunction" LED.	ISM cannot be closed / tripped.	Check the circuit of ISM actuator coil connection with CM, check state of VCB electrical interlocks.
3 blinks of CM "Malfunction" LED.	ISM actuator coil circuit is interrupted.	Check the circuit of ISM actuator coil connection with CM, check state of VCB electrical interlocks
4 blinks of CM "Malfunction" LED.	Short circuit of ISM actuator coil circuit.	Check the circuit of ISM actuator coil connection with CM, check state of VCB electrical interlocks.
Failure description	Possible reason	Method of elimination
5 blinks of CM "Malfunction" LED.	Manual trip of ISM and ISM is electrically interlocked.	Check the ISM and VCB interlock state
6 blinks of CM "Malfunction" LED.	Overheating of CM.	Stop performing CO operations until the blinks stop if temperature is above the temperature range or move CM into environment with higher temperature if temperature is below the temperature range.
7 blinks of CM "Malfunction" LED.	ISM state is open without command from the CM.	Check the ISM and VCB interlock state.
CM "Malfunction" LED lights continuously.	CM internal failure.	Replacement of CM.
None of CM LEDs lights.	Absence of CM power supply.	Check presence of CM power supply, its polarity and voltage level.
	CM internal failure.	Replacement of CM.

The VCB or CM removal and the installation of the new one should be performed according to chapter 4. The checks and tests after substitution are described in chapter 5.

# 9. Disposal

All Tavrida Electric vacuum circuit breakers and their components are manufactured from environmentally friendly materials, therefore no special waste disposal is required.

# Appendix 1.

## Type Tests

# Type Tests of ISM15\_MD

Standard	Chapter	Test name	Test center name	Test report
IEC 62271-100	6.2.6.1	Power-frequency withstand voltage test	KEMA	KEMA 1398-18
IEC 62271-100	6.2.6.2	Lightning impulse withstand voltage test	KEMA	KEMA 1398-18
IEC 62271-100	6.2.9	Partial discharge tests	KEMA	KEMA 1398-18
IEC 62271-100 IEC 60255-27	6.2.10 10.6.4.2	Dielectric tests on auxiliary and control circuits	KEMA	KEMA 1398-18
IEC 62271-100	6.10.3	Electrical continuity of earthed metallic parts test	KEMA	KEMA 1398-18
IEC 62271-100	6.4	Measurement of the resistance of the main circuit	KEMA	KEMA 1399-18
IEC 62271-100	6.5	Temperature-rise tests on the main circuits	KEMA	KEMA 1399-18
IEC 62271-100	6.5.5	Temperature-rise tests on auxiliary and control equipment	KEMA	KEMA 1399-18
IEC 62271-200	6.102.2	Mechanical and electromechanical interlocks tests	KEMA	KEMA 2221-18
IEC 62271-100	6.6	Short-time withstand current and peak withstand current tests	KEMA	KEMA 2222-18
IEC 62271-100	6.102-6.106	Short-circuit current making and breaking tests	KEMA	KEMA 2085-19
IEC 62271-100	6.102-6.105, 6.108	Single-phase earth fault test	KEMA	KEMA 2222-18
IEC 62271-100	6.102-6.105, 6.108	Double-earth fault test	KEMA	KEMA 2222-18
IEC 62271-100	6.102-6.105, 6.112	Making and breaking tests on class E2	KEMA	KEMA 2085-19
IEC 62271-100	6.101.2	Mechanical operation test at ambient temperature	KEMA	KEMA 2324-18
IEC 62271-100	6.101.3	Low and high temperature tests	KEMA	KEMA 2324-18
IEC 62271-100	6.111.5.1	Line-charging and cable-charging current switching tests	KEMA	KEMA 2269-18
IEC 62271-1	6.11 7.11	X-radiation test for vacuum interrupters	CESI	CESI B8012097
IEEE C37.09	4.4 4.4.7	Continuous current-carrying tests. Measurement of resistance of the main circuits	KEMA	KEMA 1504-18
IEEE C37.09	4.5 5.16	Dielectric withstand tests. Power frequency withstand voltage tests. Dry	KEMA	KEMA 1503-18
IEEE C37.09	4.5.5	Dielectric withstand tests. Lightening impulse voltage test	KEMA	KEMA 1503-18
IEEE C37.09	4.6	Standard operating duty (standard duty cycle) tests	KEMA	KEMA 2086-19
IEEE C37.09	4.7	Interrupting time tests	KEMA	KEMA 2086-19
IEEE C37.09	4.8	TRV tests	KEMA	KEMA 2086-19
IEEE C37.09	4.8	Short-circuit current interrupting tests	KEMA	KEMA 2086-19 KEMA 2267-18
IEEE C37.09	4.9	Load current	KEMA	KEMA 2086-19
IEEE C37.09a	4.10	Cable capacitive current switching test	KEMA	KEMA 2270-18
IEEE C37.09a	4.10	Line capacitive current switching test	KEMA	KEMA 2270-18
IEEE C37.09	4.13	Mechanical endurance tests. Low temperature	KEMA	KEMA 2325-18
IEEE C37.09	4.13	Mechanical endurance tests. Normal conditions	KEMA	KEMA 2325-18



# Type Tests of ISM15\_HD

Standard	Chapter	Test name	Test center name	Test report
IEC 62271-100	6.2.6.1	Power-frequency withstand voltage test	KEMA	KEMA 1656-18 KEMA 1717-18
IEC 62271-100	6.2.6.2	Lightning impulse withstand voltage test	KEMA	KEMA 1656-18 KEMA 1717-18
IEC 62271-100	6.2.9	Partial discharge tests	KEMA	KEMA 1656-18 KEMA 1717-18
IEC 62271-100 IEC 60255-27	6.2.10 10.6.4.2	Dielectric tests on auxiliary and control circuits	KEMA	KEMA 1656-18
IEC 62271-100	6.10.3	Electrical continuity of earthed metallic parts test	KEMA	KEMA 1656-18 KEMA 1717-18
IEC 62271-100	6.4	Measurement of the resistance of the main circuit	KEMA	KEMA 1719-18 KEMA 1721-18
IEC 62271-100	6.5	Temperature-rise tests on the main circuits	KEMA	KEMA 1719-18 KEMA 1721-18
IEC 62271-100	6.5.5	Temperature-rise tests on auxiliary and control equipment	KEMA	KEMA 1719-18 KEMA 1721-18
IEC 62271-200	6.102.2	Mechanical and electromechanical interlocks tests	KEMA	KEMA 2355-18 KEMA 2370-18
IEC 62271-100	6.6	Short-time withstand current and peak withstand current tests	KEMA	KEMA 2351-18
IEC 62271-100	6.102-6.106	Short-circuit current making and breaking tests	KEMA	KEMA 2351-18
IEC 62271-100	6.102-6.105, 6.108	Single-phase earth fault test	KEMA	KEMA 2351-18
IEC 62271-100	6.102-6.105, 6.108	Double-earth fault test	KEMA	KEMA 2351-18
IEC 62271-100	6.102-6.105, 6.112	Making and breaking tests on class E2	KEMA	KEMA 2351-18
IEC 62271-100	6.101.2	Mechanical operation test at ambient temperature	KEMA	KEMA 2343-18
IEC 62271-100	6.101.3	Low and high temperature tests	KEMA	KEMA 2343-18
IEC 62271-100	6.111.5.1	Line-charging and cable-charging current switching tests	KEMA	KEMA 2353-18
IEC 62271-1	6.11 7.11	X-radiation test for vacuum interrupters	CESI	CESI B8012097

## Type Tests of CM\_16

Standard	Test name	Test center name	Test report
IEC 60255-26 IEC 61000-4-2	Electrostatic discharge immunity test	KEMA	KEMA TIC 1371-14
IEC 60255-26 IEC 61000-4-3	Radiated electromagnetic field immunity test	KEMA	KEMA TIC 1371-14
IEC 60255-26 IEC 62271-1 IEC 61000-4-4	Fast transient burst immunity test	KEMA	KEMA TIC 1371-14
IEC 60255-26 IEC 61000-4-5	Surge immunity test	KEMA	KEMA TIC 1371-14
IEC 60255-26 IEC 61000-4-6	Conducted disturbance induced by radio frequency fields immunity test	KEMA	KEMA TIC 1371-14
IEC 60255-26 IEC 61000-4-8	Power frequency magnetic field immunity test	KEMA	KEMA TIC 1371-14
IEC 61000-4-9	Pulse magnetic field immunity test	KEMA	KEMA TIC 1371-14
IEC 61000-4-10	100 kHz damped oscillatory magnetic field immunity test	KEMA	KEMA TIC 1371-14
IEC 61000-4-10	1 MHz damped oscillatory magnetic field immunity test	KEMA	KEMA TIC 1371-14
IEC 60255-26 IEC 61000-4-11	AC voltage dips and interruptions immunity test	KEMA	KEMA TIC 1371-14
IEC 60255-26 IEC 61000-4-16	Power frequency disturbance voltage immunity test	KEMA	KEMA TIC 1371-14
IEC 60255-26 IEC 62271-1 IEC 61000-4-18	100 kHz damped oscillatory wave immunity test	KEMA	KEMA TIC 1371-14
IEC 60255-26 IEC 62271-1 IEC 61000-4-18	1 MHz damped oscillatory wave immunity test	KEMA	KEMA TIC 1371-14
IEC 60255-26 IEC 61000-4-27	Ripple on DC power supply immunity test	KEMA	KEMA TIC 1371-14
IEC 60255-26 IEC 62271-100 IEC 61000-4-29	DC voltage dips and interruptions immunity test	KEMA	KEMA TIC 1371-14
IEC 60255-27 IEC 62271-100	Power frequency withstand voltage test	KEMA	KEMA TIC 1371-14
IEC 60255-27	Insulation resistance test	KEMA	KEMA TIC 1371-14
IEC 60255-27	Impulse withstand voltage test	KEMA	KEMA TIC 1371-14

# Appendix 2. Withdrawable VCB Package Dimensions






## Withdrawable VCB Package Dimensions

Withdrawable VCB	PCD	Package Dimensions, not more than (LxWxH), mm
CR15_MD1_16D	150	1150x990x1080
	210	
CR15_HD1_16D	210	1150x990x1320
	275	

# Appendix 3.

## Overall Drawings






# CR15\_MD1\_16D PCD 150 mm

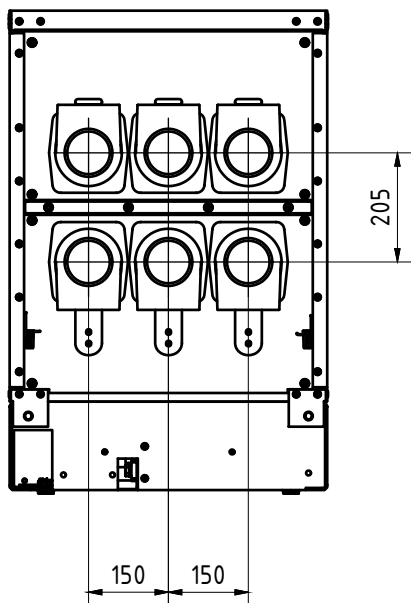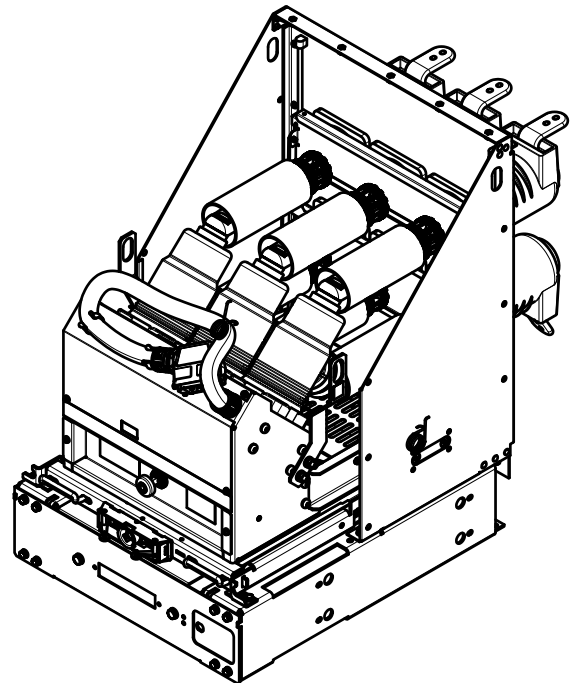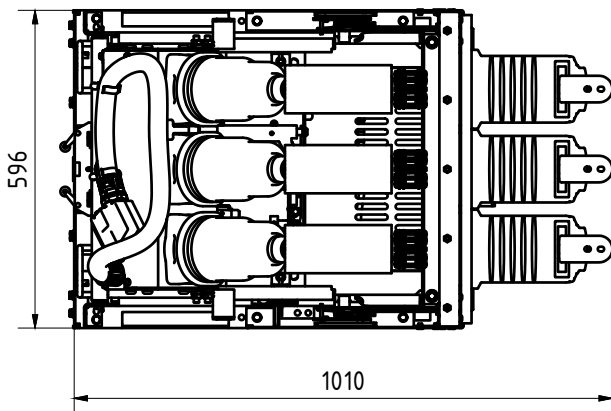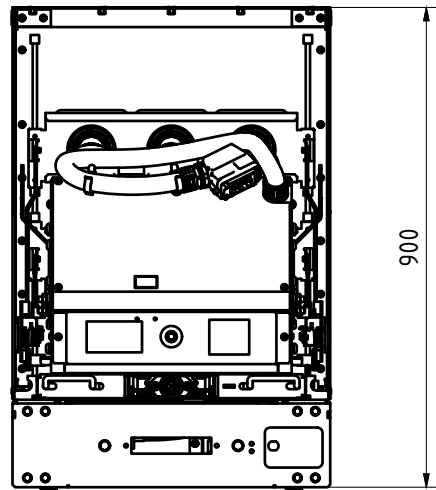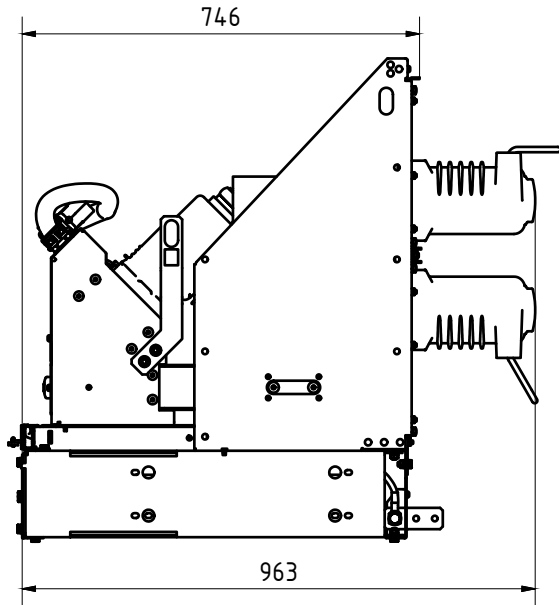

**CR15\_MD1\_16D**  
 15 kV, 1250 A, PCD: 150 mm,  
 weight: 143 kg

$L_{max} = 1010 \text{ mm}$   
 $W_{max} = 596 \text{ mm}$   
 $H_{max} = 900 \text{ mm}$


# CR15\_MD1\_16D PCD 210 mm

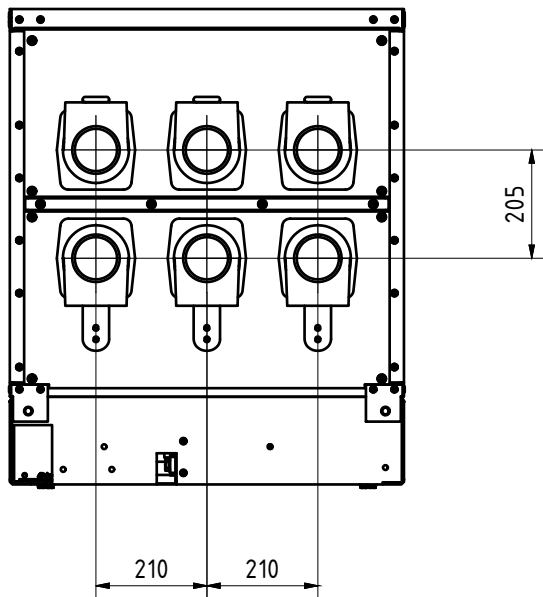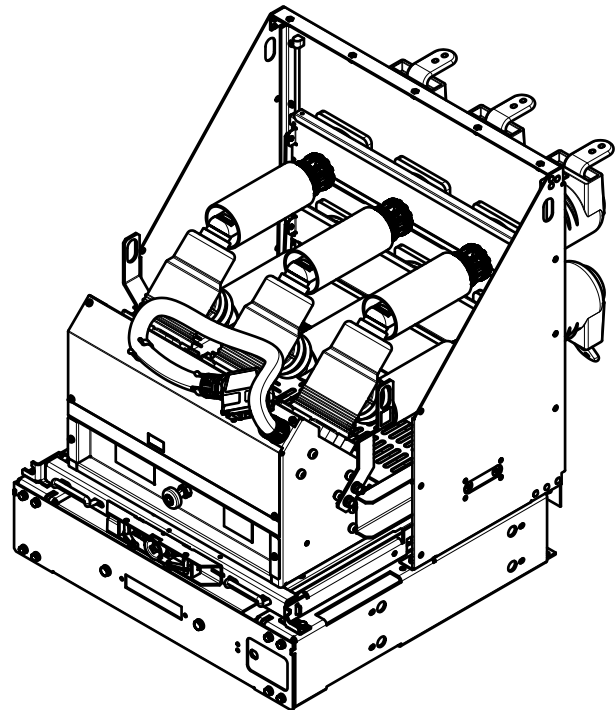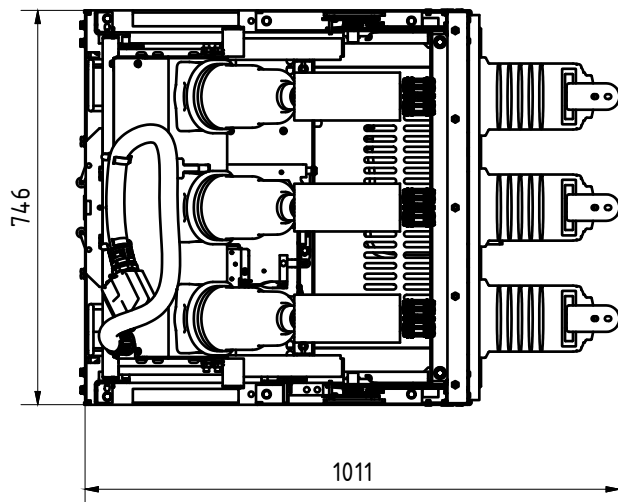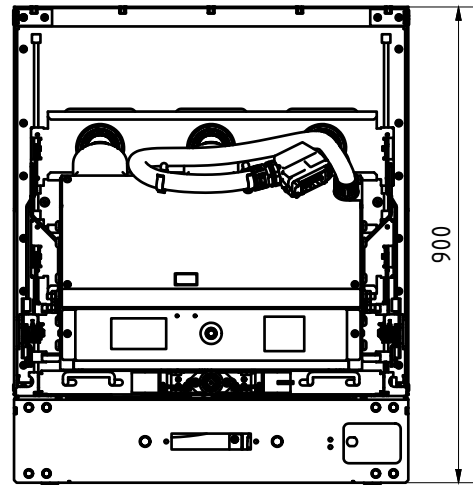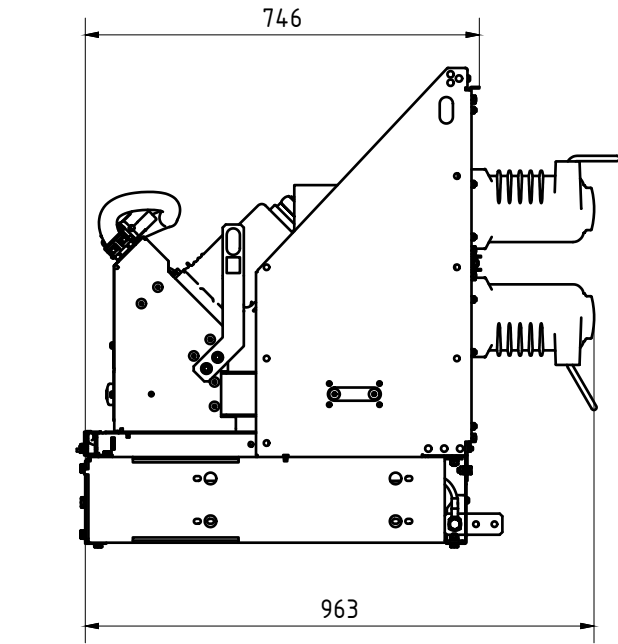

**CR15\_MD1\_16D**  
 15 kV, 1250 A, PCD: 210mm,  
 weight: 159.1 kg

$L_{max} = 1011 \text{ mm}$   
 $W_{max} = 746 \text{ mm}$   
 $H_{max} = 900 \text{ mm}$


# CR15\_HD1\_16D PCD 210 mm

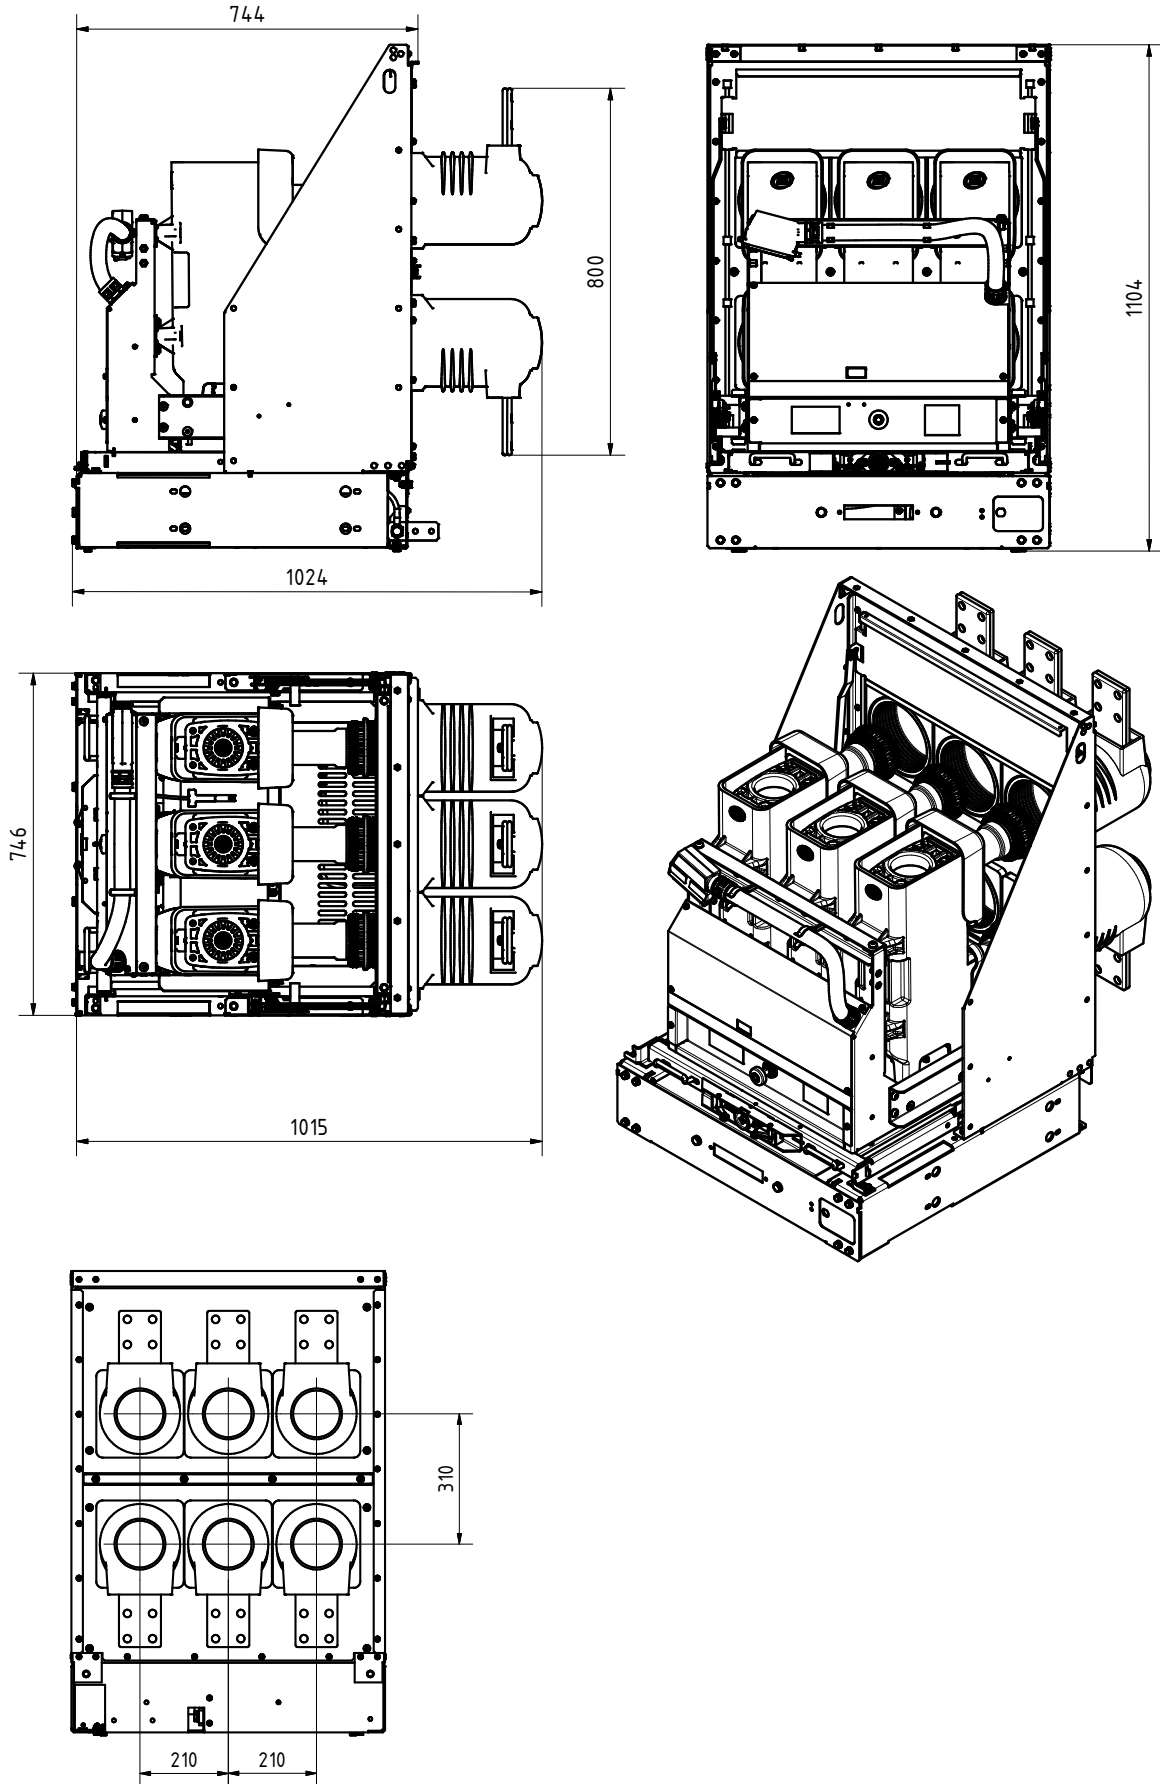


**CR15\_HD1\_16D**  
 15 kV, 2500 A, PCD: 210 mm,  
 weight: 143 kg

$L_{max} = 1024 \text{ mm}$   
 $W_{max} = 746 \text{ mm}$   
 $H_{max} = 1104 \text{ mm}$



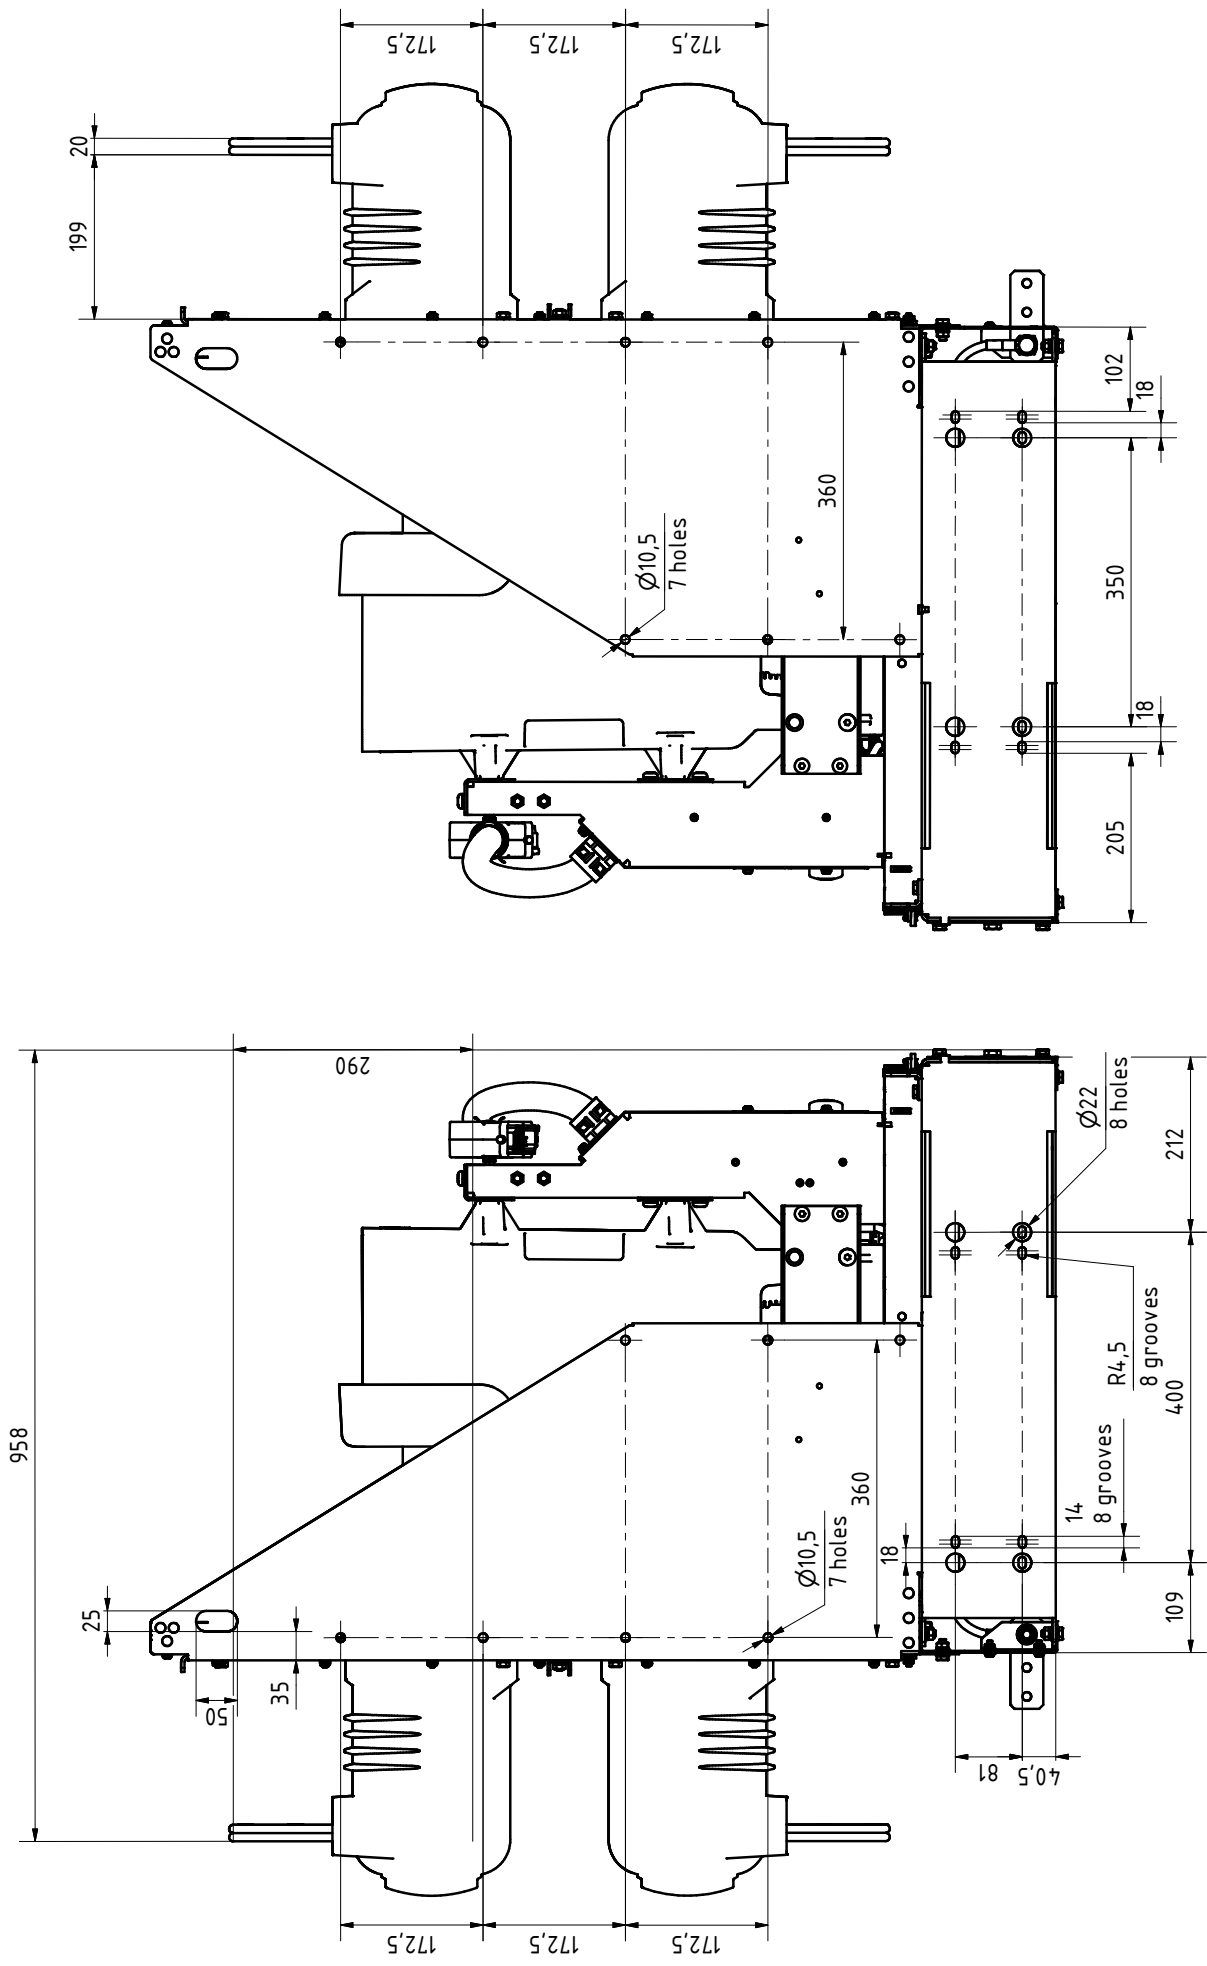


# Dimensions of Control Module

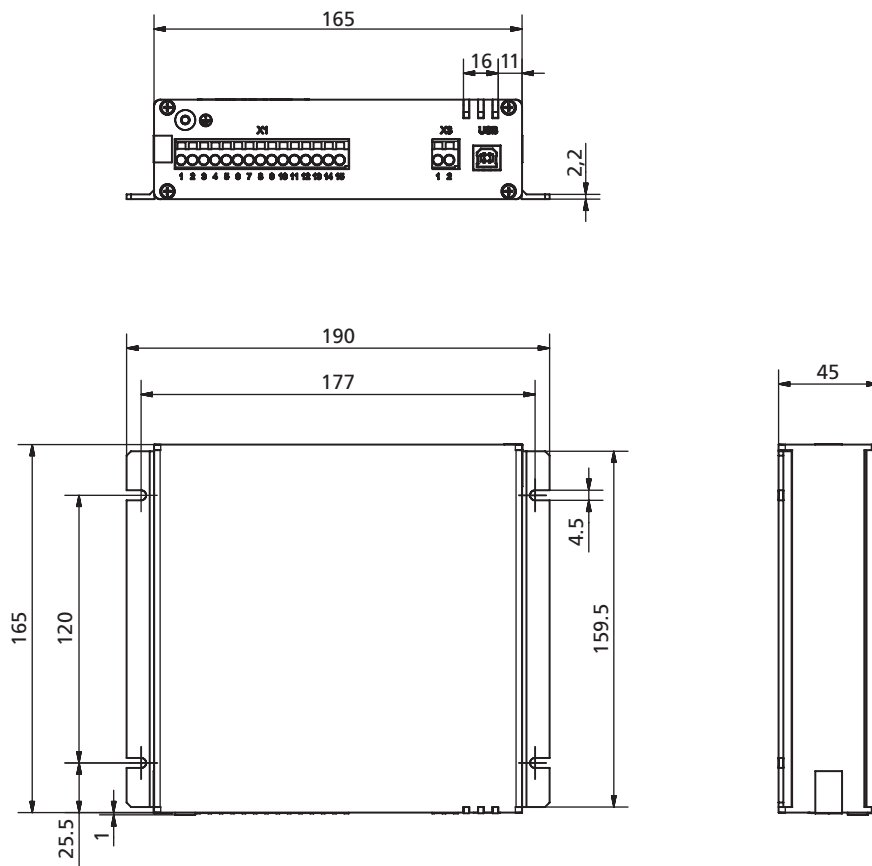


CM\_16\_1(Par1\_Par2\_Par3\_Par4\_Par5)  
Weight: 1 kg

$L_{max} = 165 \text{ mm}$   
 $W_{max} = 190 \text{ mm}$   
 $H_{max} = 45 \text{ mm}$

# Control Wiring Plug Counterparts

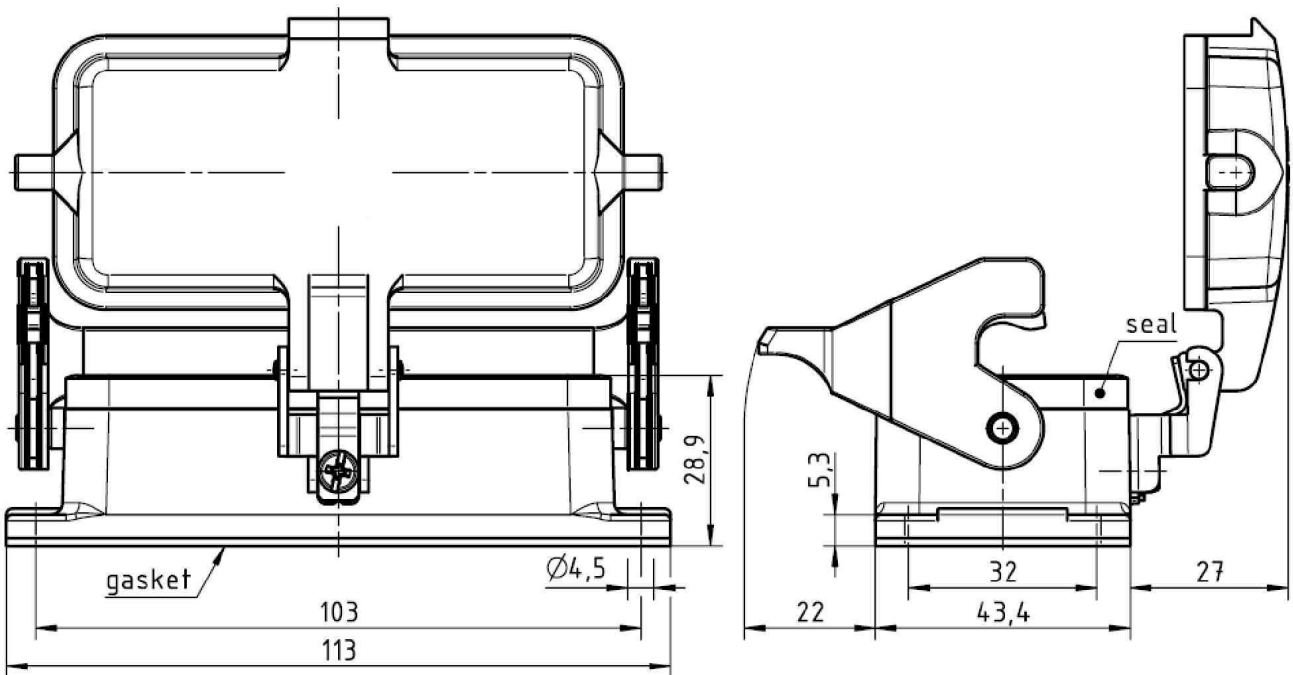

Control wiring metal plug 72 pins counterpart

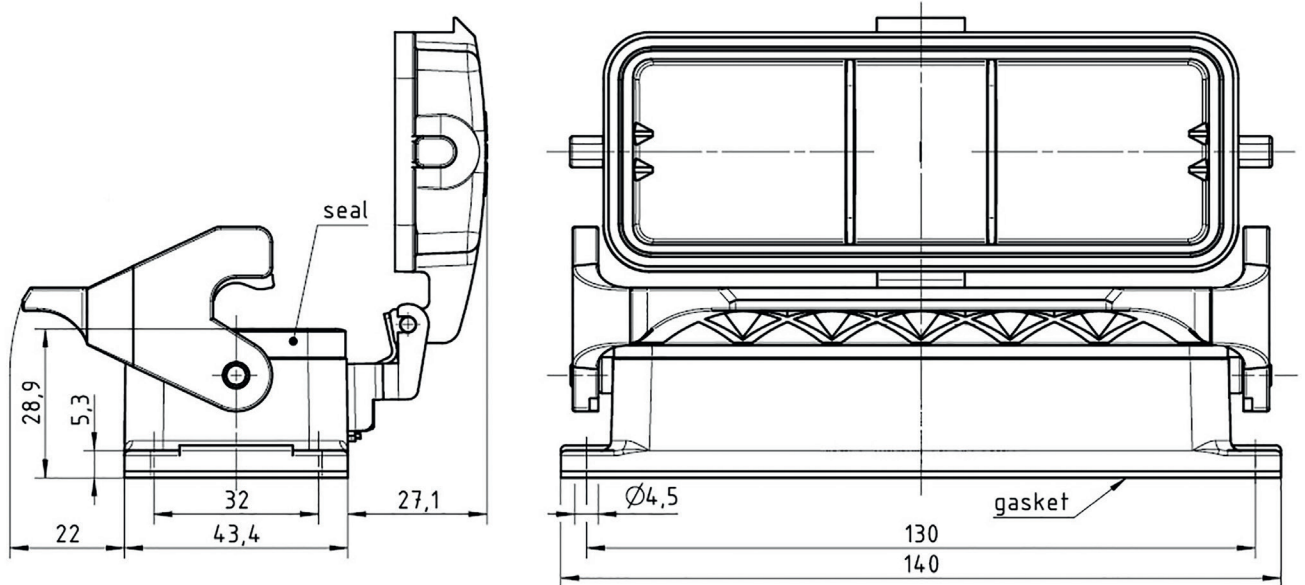

Control wiring metal plug 108 pins counterpart




# Appendix 4.

## Secondary Schemes

# CR15\_MD1\_16D with Metal Plug (72 pins)

## CR15\_MD1\_16D Standard circuit breaker application (CB)

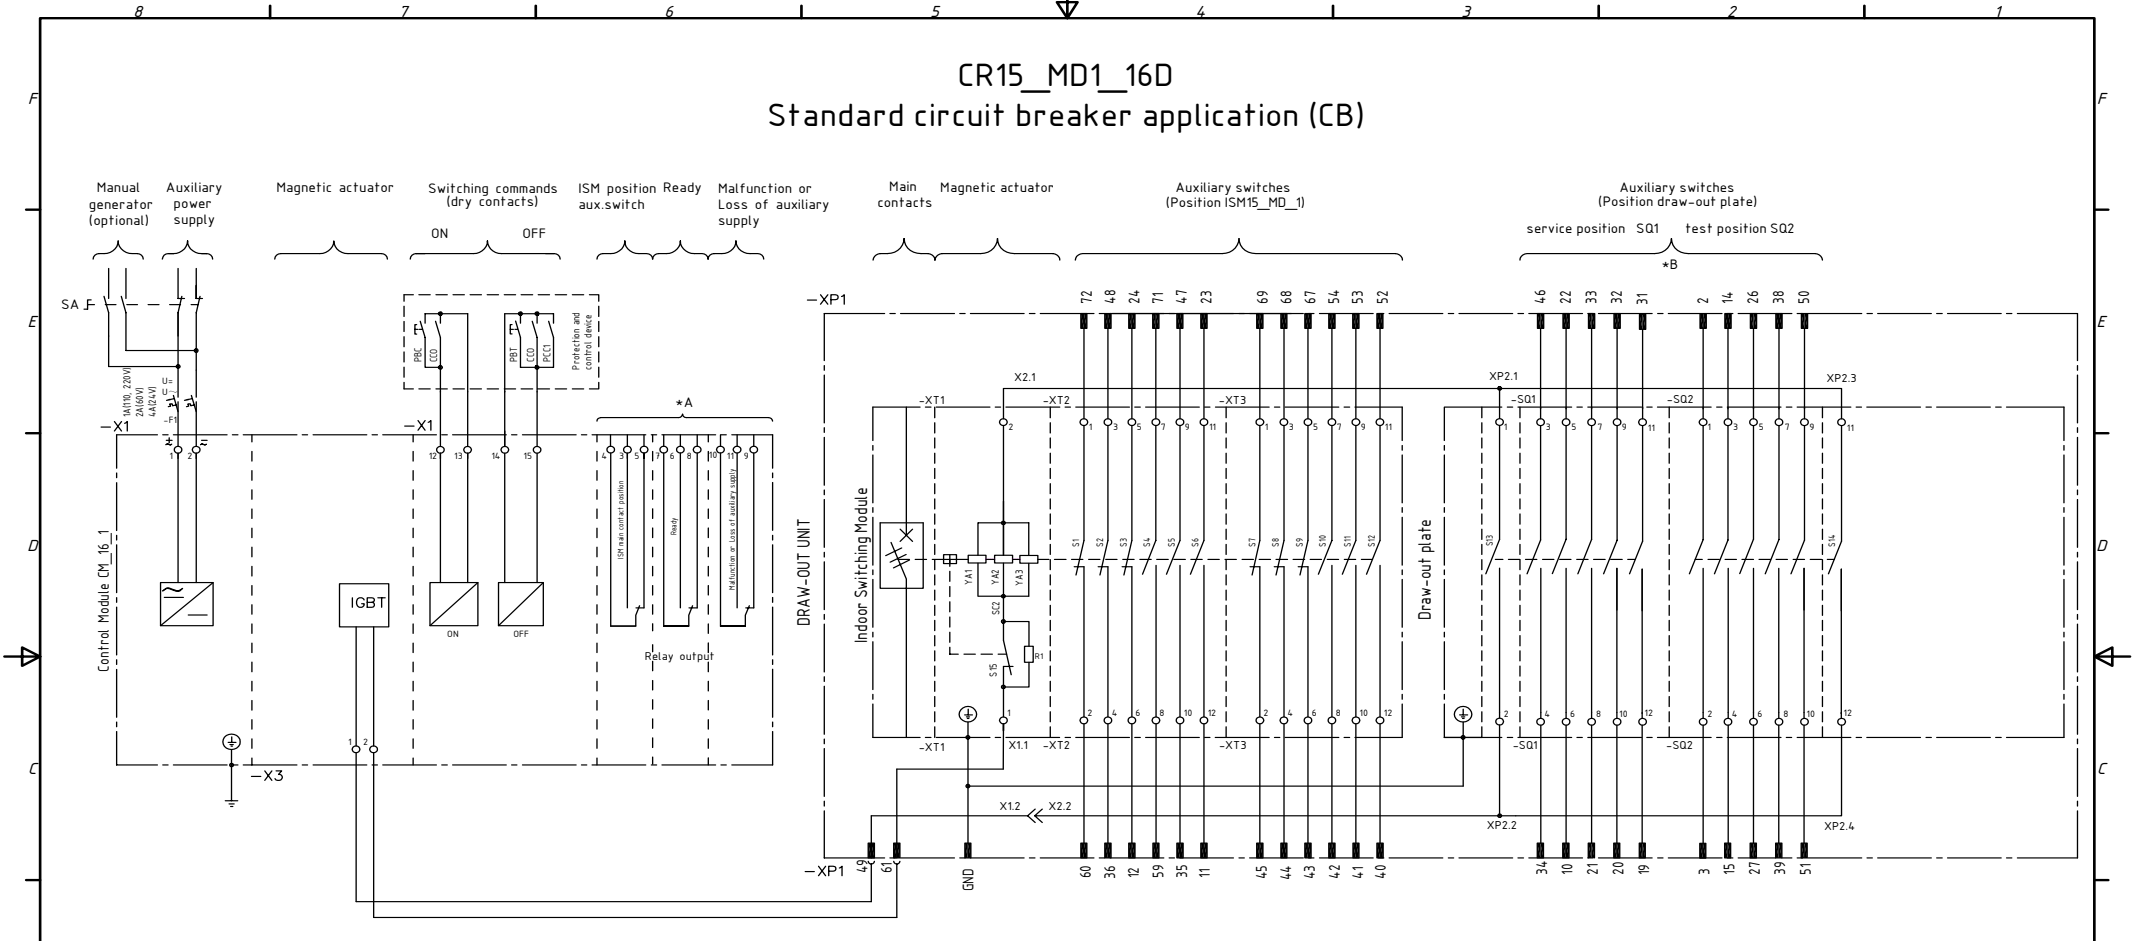

**Legend:**

- \*A Wiring of auxiliary switches, relay outputs, according to customer specification;
- \*B SQ1, SQ2 are shown in free position; SQ1 is pressed at service position; SQ2 is pressed at test position; Indoor switching module;
- ISM Transistor bridge (coils control);
- IGBT Auxiliary switch of ISM;
- S1~S12 Auxiliary switch for ISM electrical interlock;
- S13, S14 are at inactivated position;
- S15 Auxiliary switch for ISM interlock;
- S15 is at inactivated position, is not used in DOU.

- YA1, YA2, YA3 Terminal block of Control module;
- X1, X3 Plug connector for DOU;
- XP1, XP2.1, XP2.2, XP2.3, XP2.4 Intermediate wiring connectors
- SQ1, SQ2 Auxiliary switches of DOU position
- F1 Miniature protective circuit breaker (MPCB);

- Actuator coils;
- Terminal block of Control module;
- Plug connector for DOU;
- Intermediate wiring connectors
- Auxiliary switches of DOU position
- Miniature protective circuit breaker (MPCB);
- F1 should be selected to withstand Control module inrush current levels given in VCB Product Guide;


- PBC Push button close;
- PBT Push button open; Control command ON, OFF;
- CCO Protection control contact;
- PCC1 Resistor 22kOhm;
- R1 Resistor 22kOhm;

States of the relays „Malfunction or Loss of auxiliary supply“ and „Ready“ are shown at power supply off.  
 State of the relay „ISM main contact position“ is shown at ISM open state. It keeps its position at absent of power supply.  
 State of the auxiliary switches S1-S12 is shown at ISM open state.

Designed by A. Ishchenko	Checked by A. Miguonov	Approved by V. Minaev	Date 18.02.2020	Filename MD1_16D_2_ED5	Date 18.02.2020	Weight -	Scale -
Projection TAVRIDA ELECTRIC				Switching module Electrical Interconnection Diagram			
MD1_16D_2_ED5				Edition A		Sheet 1 / 1	


# CR15\_MD1\_16D with Metal Plug (108 pins)

## CR15\_MD1\_16D Standard circuit breaker application (CB)

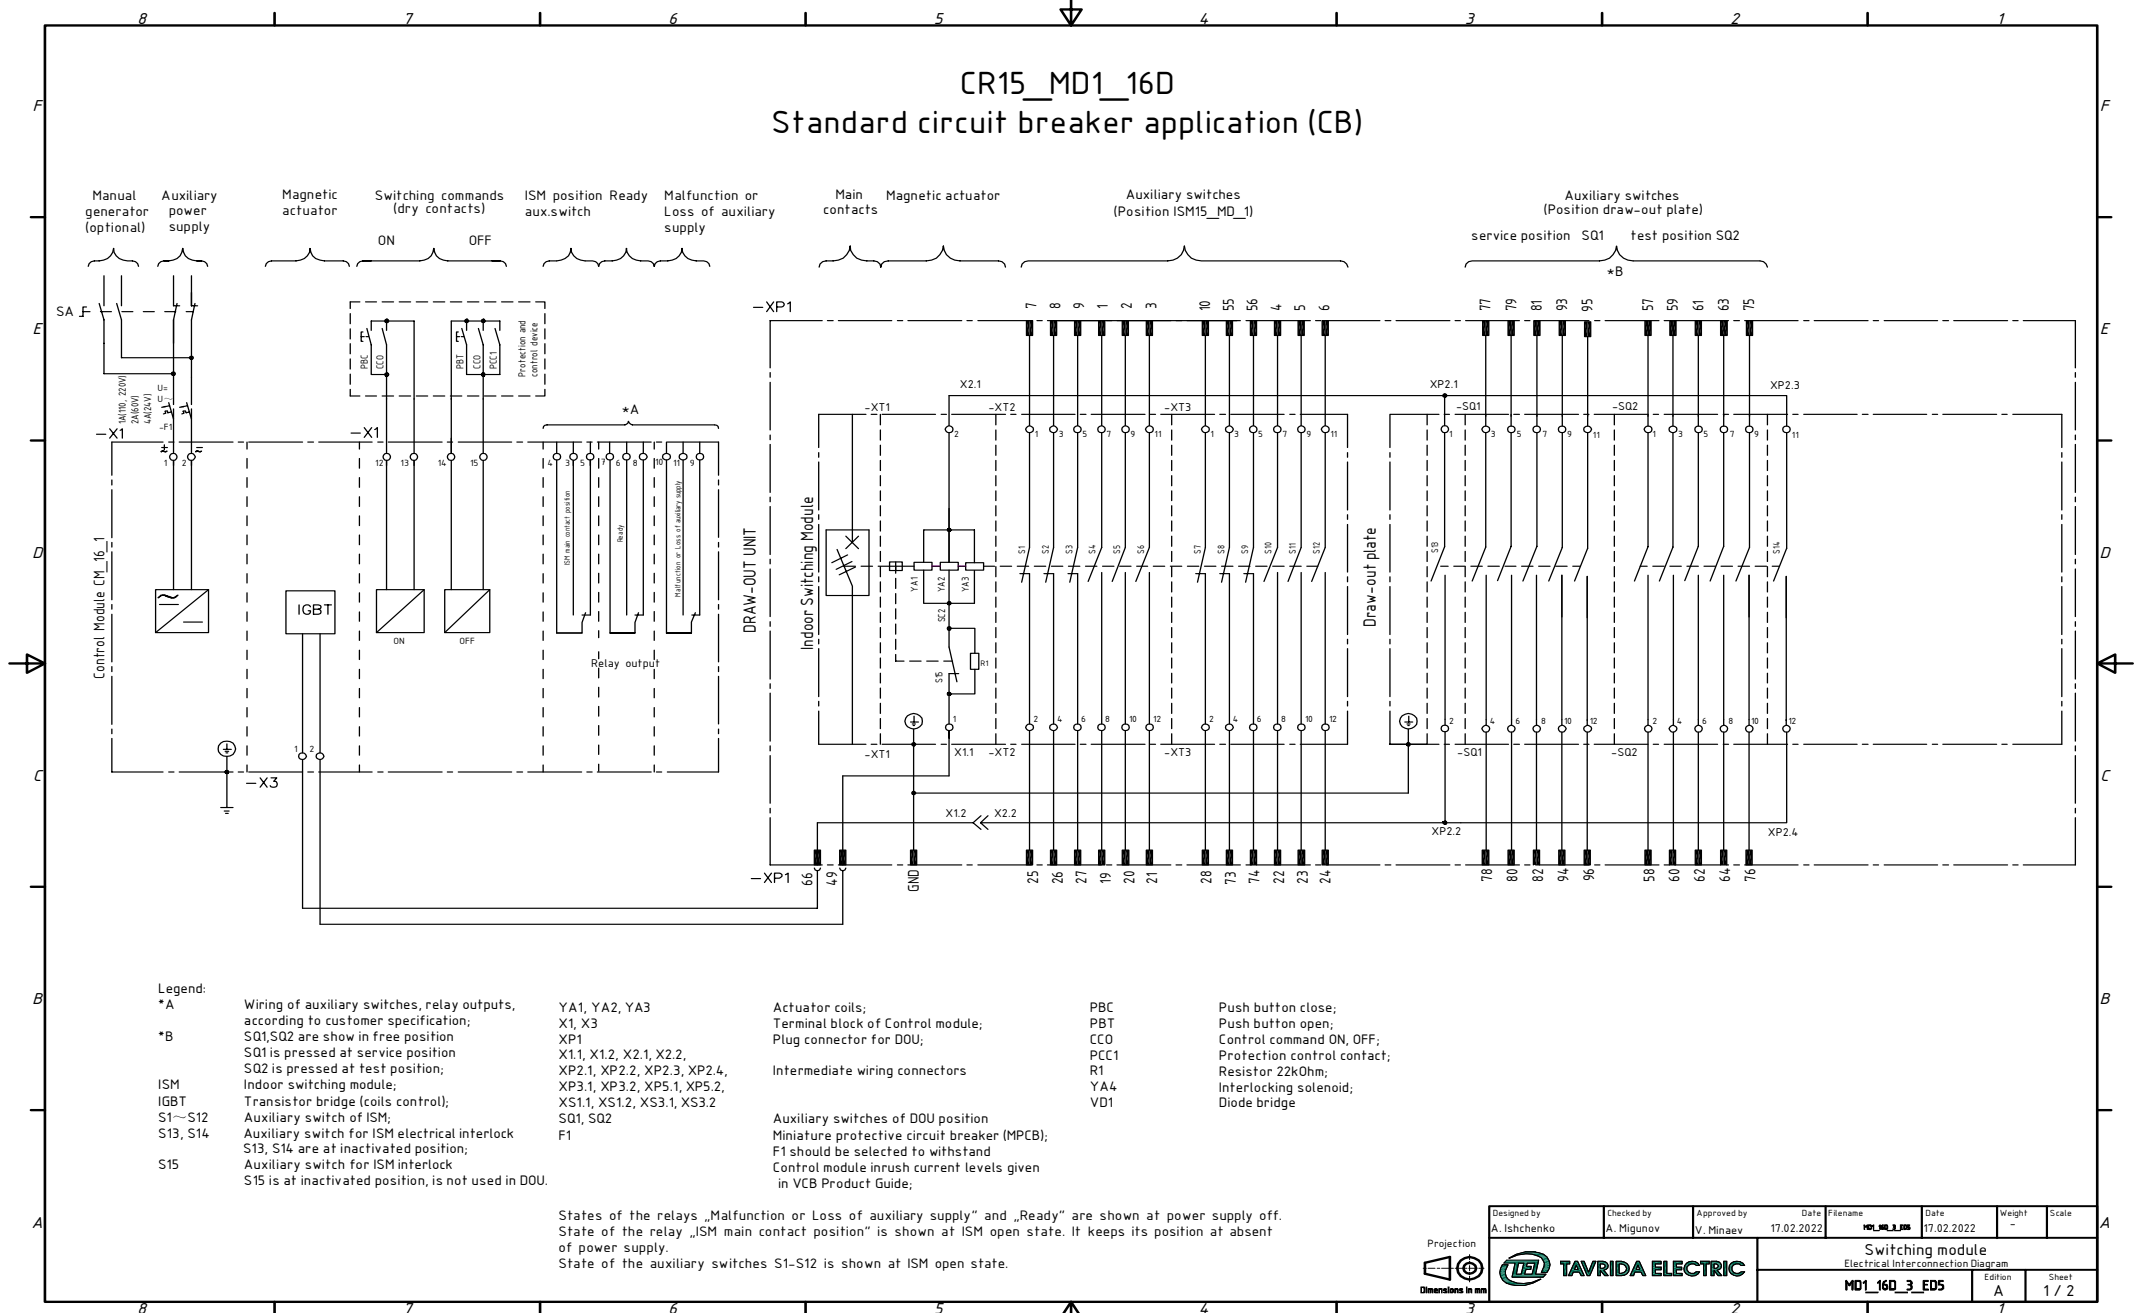

# CR15\_HD1\_16D with Metal Plug (72 pins)

## CR15\_HD1\_16D Standard circuit breaker application (CB)

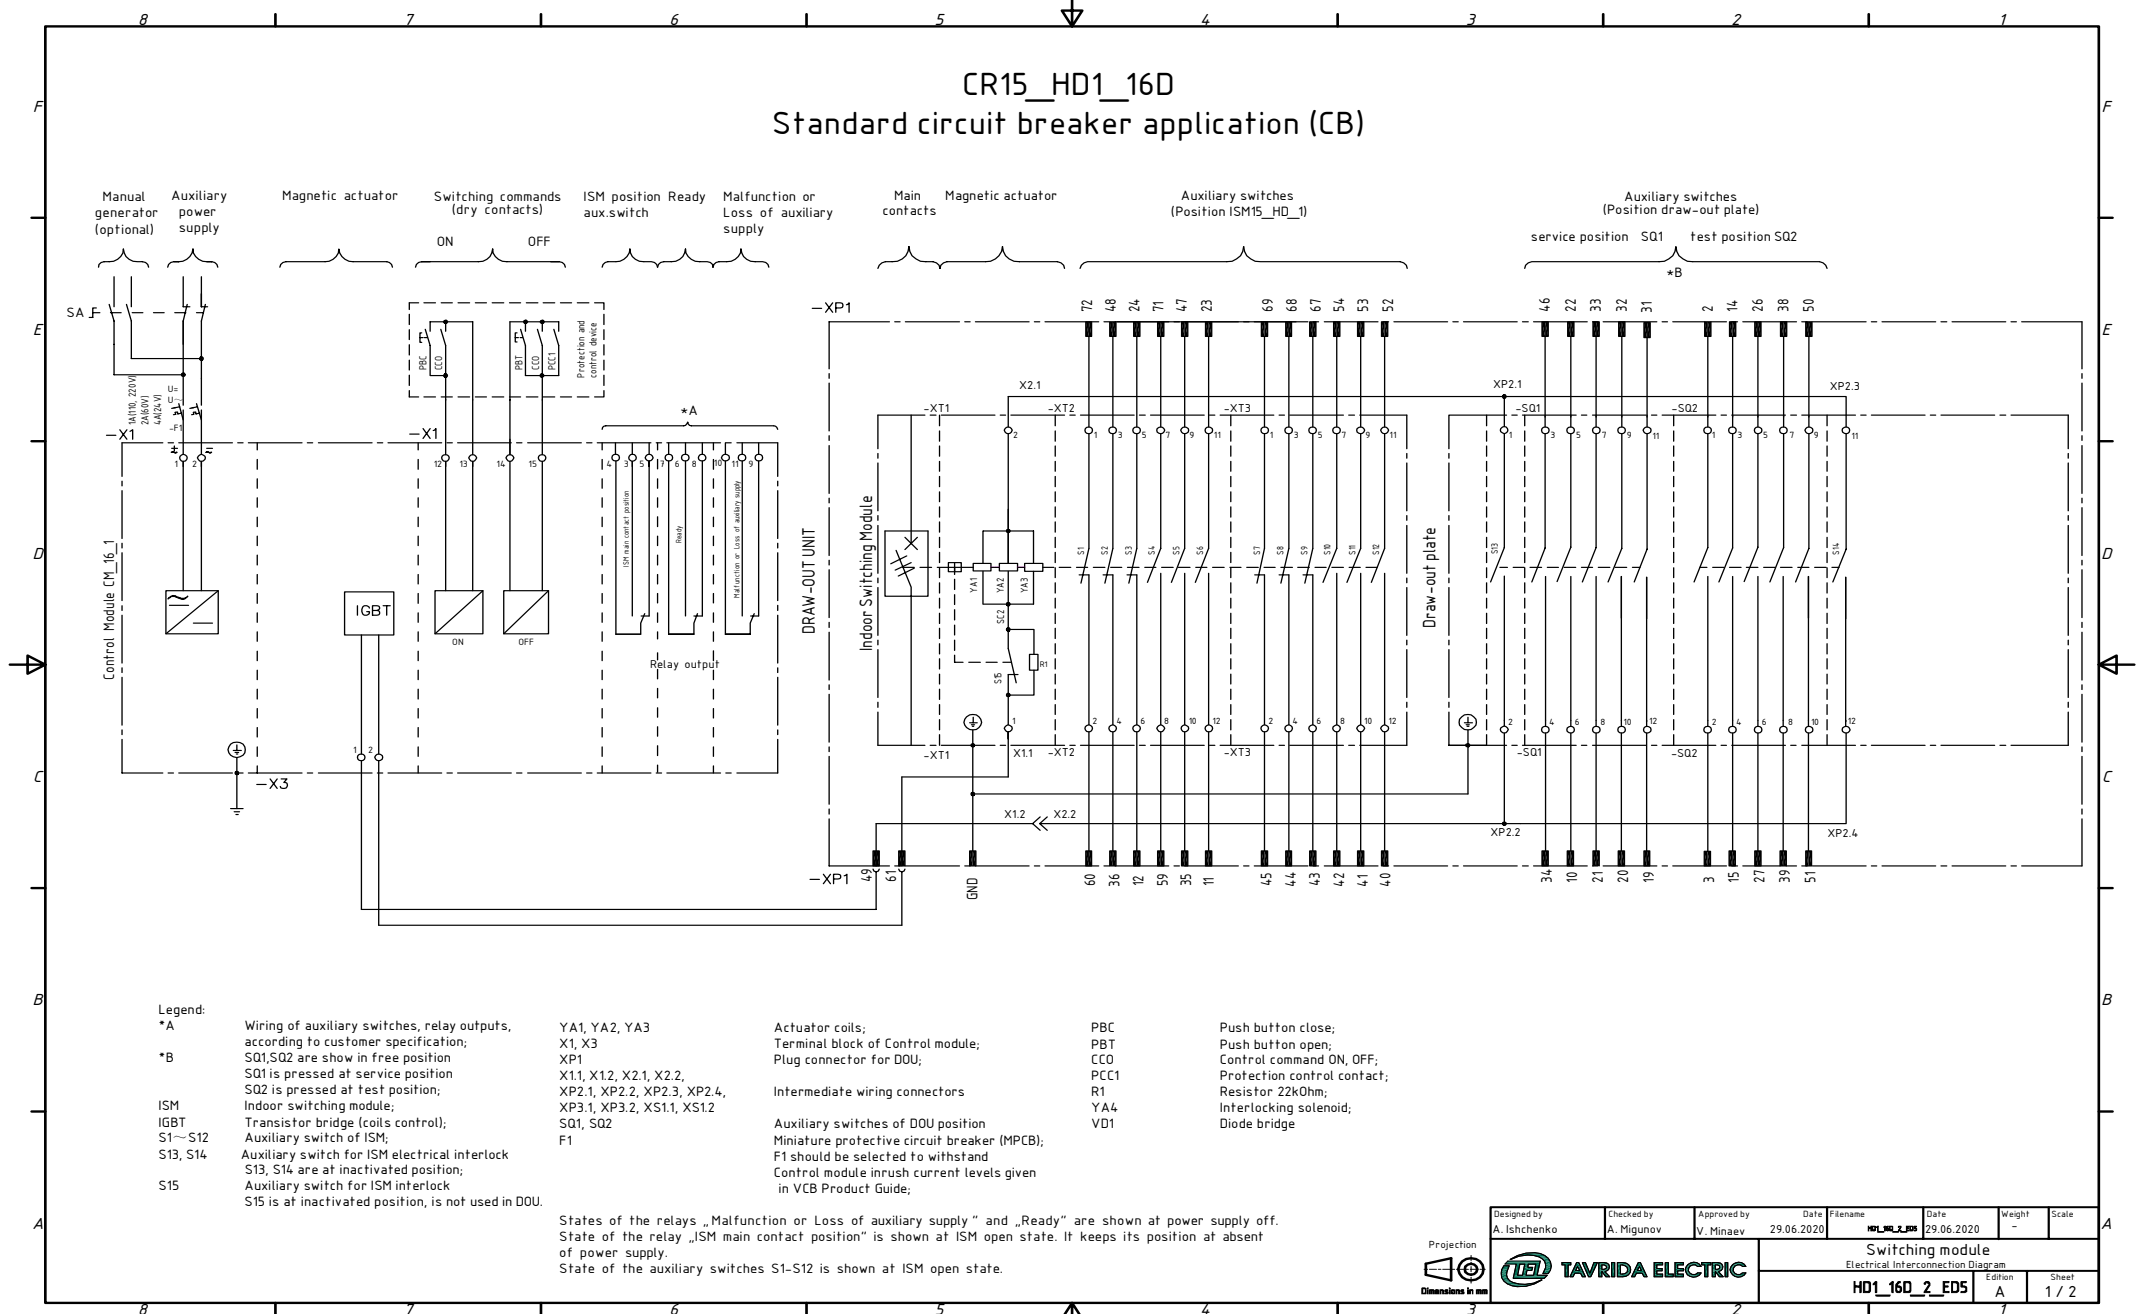

**Legend:**

- \*A Wiring of auxiliary switches, relay outputs, according to customer specification;
- \*B SQ1, SQ2 are shown in free position  
SQ1 is pressed at service position  
SQ2 is pressed at test position;
- ISM Indoor switching module;
- IGBT Transistor bridge (coils control);
- S1~S12 Auxiliary switch of ISM;
- S13, S14 Auxiliary switch for ISM electrical interlock  
S13, S14 are at inactivated position;
- S15 Auxiliary switch for ISM interlock  
S15 is at inactivated position, is not used in DOU.
- YA1, YA2, YA3 Terminal block of Control module;
- X1, X3 Plug connector for DOU;
- XP1 Intermediate wiring connectors
- XP2.1, XP2.2, XP2.3, XP2.4, XP3.1, XP3.2, XS1.1, XS1.2 Auxiliary switches of DOU position
- F1 Miniature protective circuit breaker (MPCB);  
F1 should be selected to withstand Control module inrush current levels given in VCB Product Guide;

- Actuator coils;
- Terminal block of Control module;
- Plug connector for DOU;
- Intermediate wiring connectors
- Auxiliary switches of DOU position
- Miniature protective circuit breaker (MPCB);  
F1 should be selected to withstand Control module inrush current levels given in VCB Product Guide;

- PBC Push button close;
- PBT Push button open;
- CCO Control command ON, OFF;
- PCC1 Protection control contact;
- R1 Resistor 22kOhm;
- YA4 Interlocking solenoid;
- VD1 Diode bridge


States of the relays „Malfunction or Loss of auxiliary supply“ and „Ready“ are shown at power supply off.  
State of the relay „ISM main contact position“ is shown at ISM open state. It keeps its position at absent of power supply.  
State of the auxiliary switches S1-S12 is shown at ISM open state.

Designed by A. Ishchenko	Checked by A. Miguinov	Approved by V. Minaev	Date 29.06.2020	Filename HD1_16D_2	Date 29.06.2020	Weight -	Scale -
				Switching module			
				Electrical Interconnection Diagram			



# CR15\_HD1\_16D with Metal Plug (108 pins)

## CR15\_HD1\_16D Standard circuit breaker application (CB)

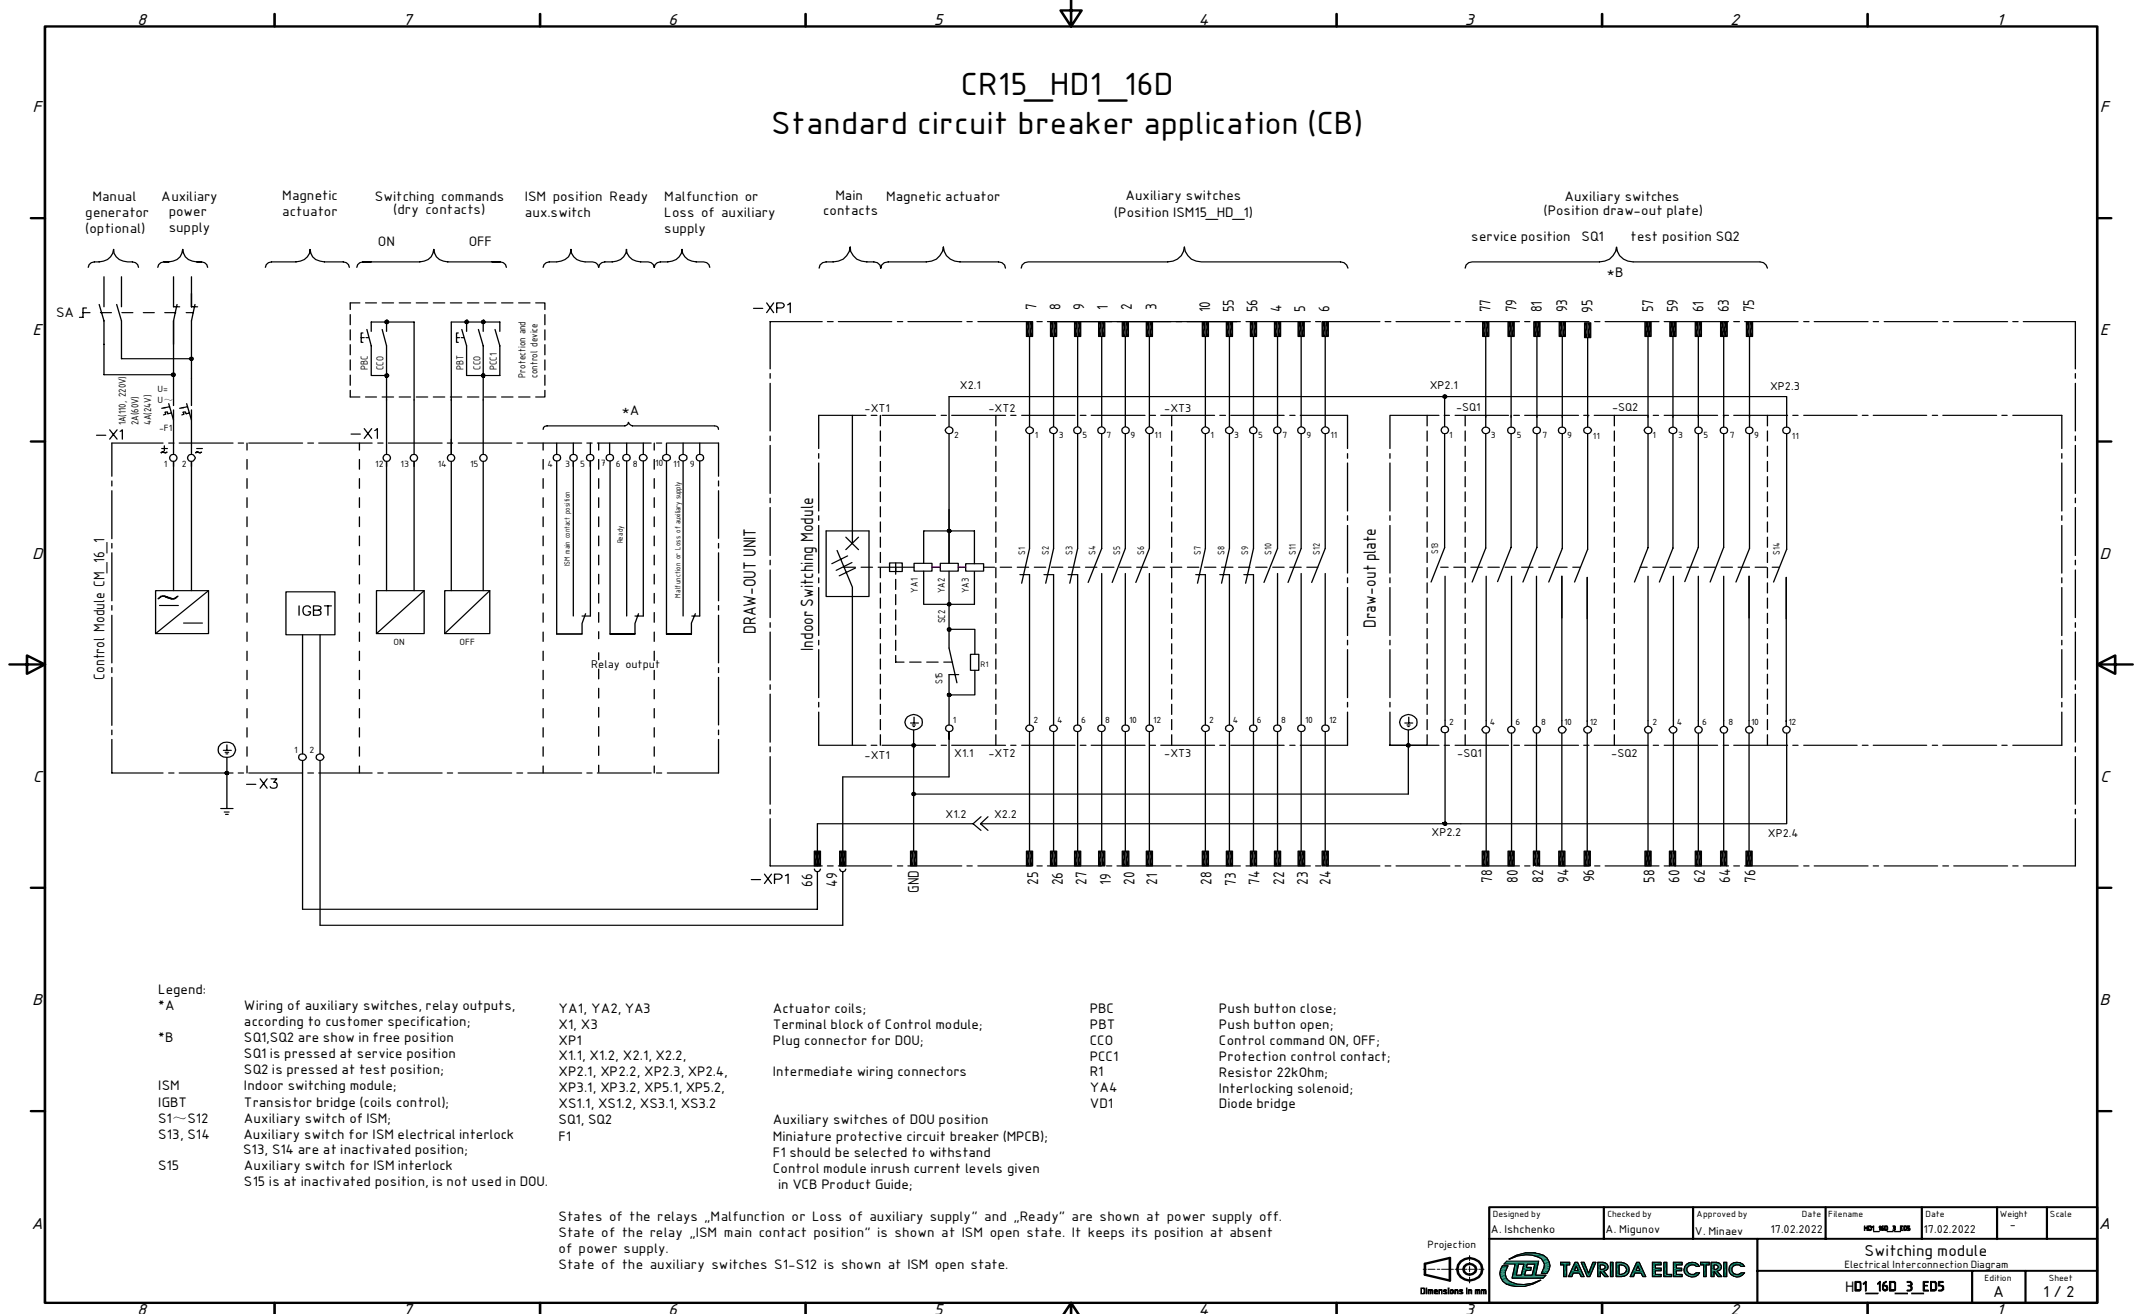

# List of Changes

<b>Documents Version</b>	<b>Change Date</b>	<b>Scope of Change</b>	<b>Reason of Change</b>	<b>Version Author</b>
1	28.02.2023	Document Creation	Products Development	mary
2	03.10.2023	Errors correction	Request	mary



**Europe****Tavrída Electric GmbH**

Im Leimen 14,  
88069 Tettngang,  
Germany  
Phone: +49 7542 94 678 51  
Fax: +49 7542 94 678 61  
E-mail: [info@tavrida.de](mailto:info@tavrida.de)

**Latin America****Tavrída Electric do Brazil**

Av. Ireño da Silva Venâncio,  
199 GP04A – Protestantes,  
Votorantim / SP, 18111-100, Brazil  
Phone: +55 15 3243-2555  
Fax: +55 15 3243-4233  
E-Mail: [info@tavrida.com.br](mailto:info@tavrida.com.br)

**North America****Tavrída Electric North America Inc.**

1105 Cliveden Ave.,  
Delta, BC V3M 6G9,  
Canada  
Phone: +1 866 5511-8362  
Fax: +55 15 3243-4233  
E-Mail: [info@tavrida.com.br](mailto:info@tavrida.com.br)

**Worldwide****Tavrída Electric AG**

Bahnhofstrasse 27,  
6300 Zug,  
Switzerland  
Phone: +49 7542 94 678 51  
Fax: +49 7542 94 678 61  
E-mail: [info@tavrida.ch](mailto:info@tavrida.ch)

**South Africa****Tavrída Electric Africa (Pty) Ltd.**

Unit 8, N12 Industrial Park,  
188 Dr Vosloo Road, Bartlett,  
Boksburg, 1459, South Africa  
Phone: +27 11 9142199  
Fax: +27 11 9142323  
E-mail: [support@tavrida.co.za](mailto:support@tavrida.co.za)

**China****Tavrída Electric Qindao Co. Ltd.**

No. 336, Songling Road, Laoshan District,  
266104 Qingdao,  
China  
Phone: +86 532 55552366  
Fax: +86 532 55552377  
E-mail: [info@tavrida.cn](mailto:info@tavrida.cn)

[www.tavrida.com](http://www.tavrida.com)

This document is copyright and is intended for users and distributors of Tavrída Electric product. It contains information that is the intellectual property of Tavrída Electric and the document, or any part thereof, should not be copied or reproduced in any form without written permission from Tavrída Electric.

Tavrída Electric applies a policy of ongoing development and reserves the right to change product without notice. Tavrída Electric does not accept any responsibility for loss or damage incurred as a result of acting or refraining from action based on information in this document.